




Depth from cover level to soffit of pipe 3 m to 6 m with ladder and reducing slab
Rigid material construction with concrete surround

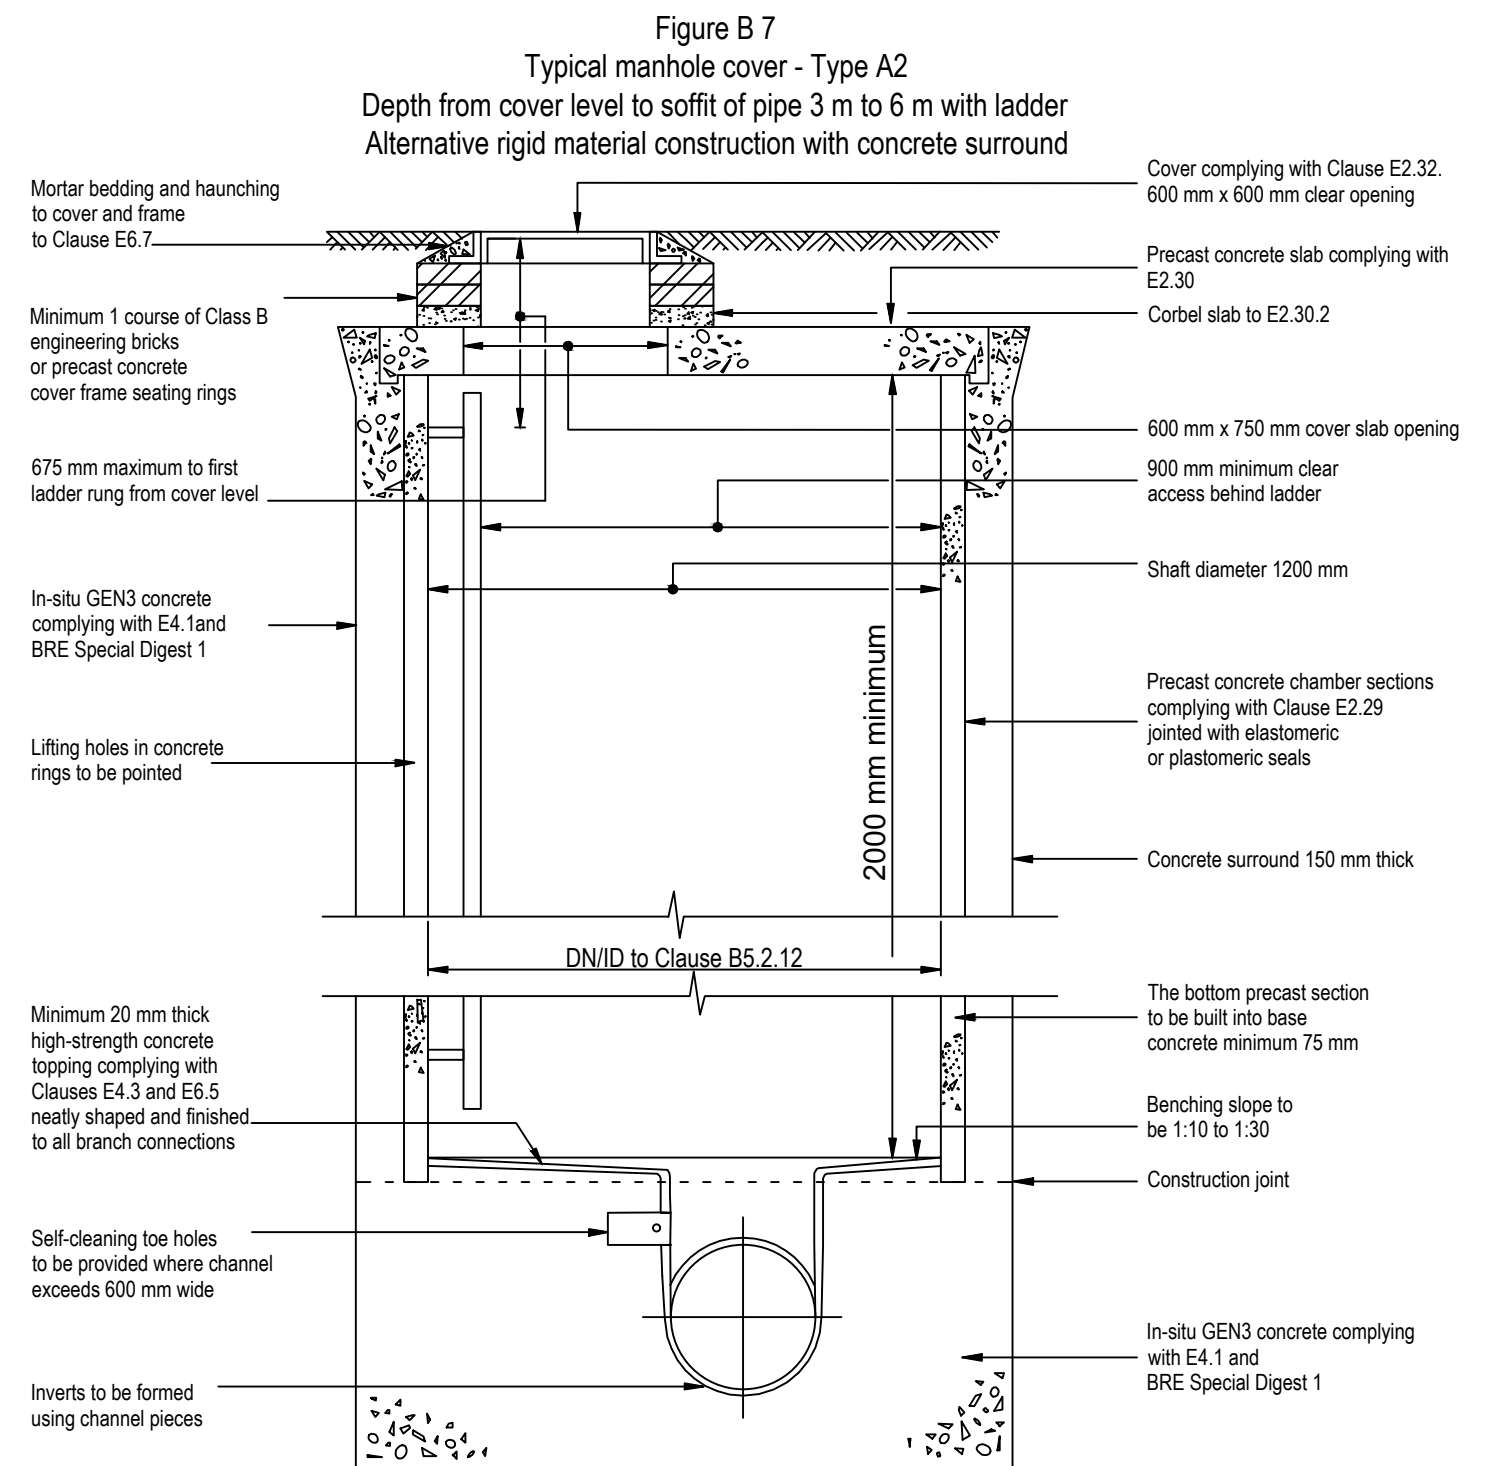

Depth from cover level to soffit of pipe 1.5 m to 3.0 m
Alternative Rigid material construction with concrete surround

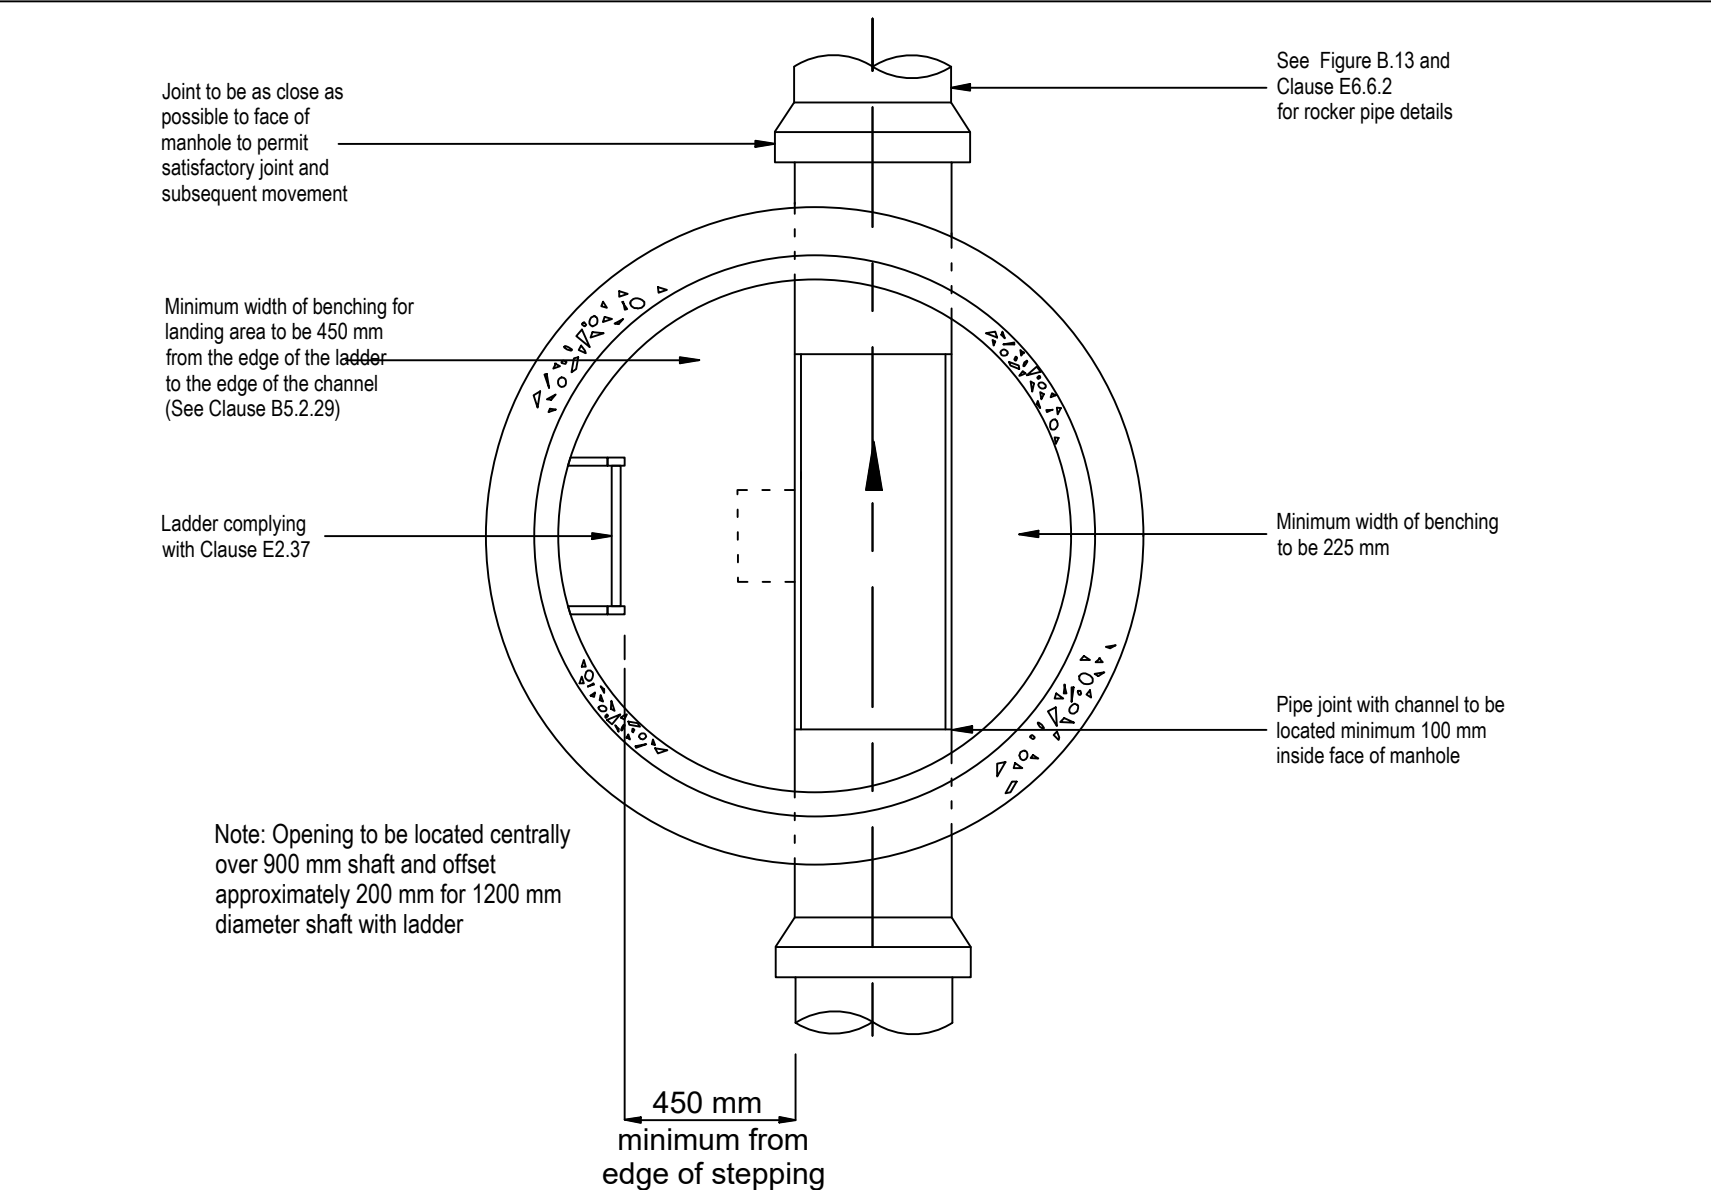

Depth from cover level to soffit of pipe less than 1.5 m
Rigid material construction

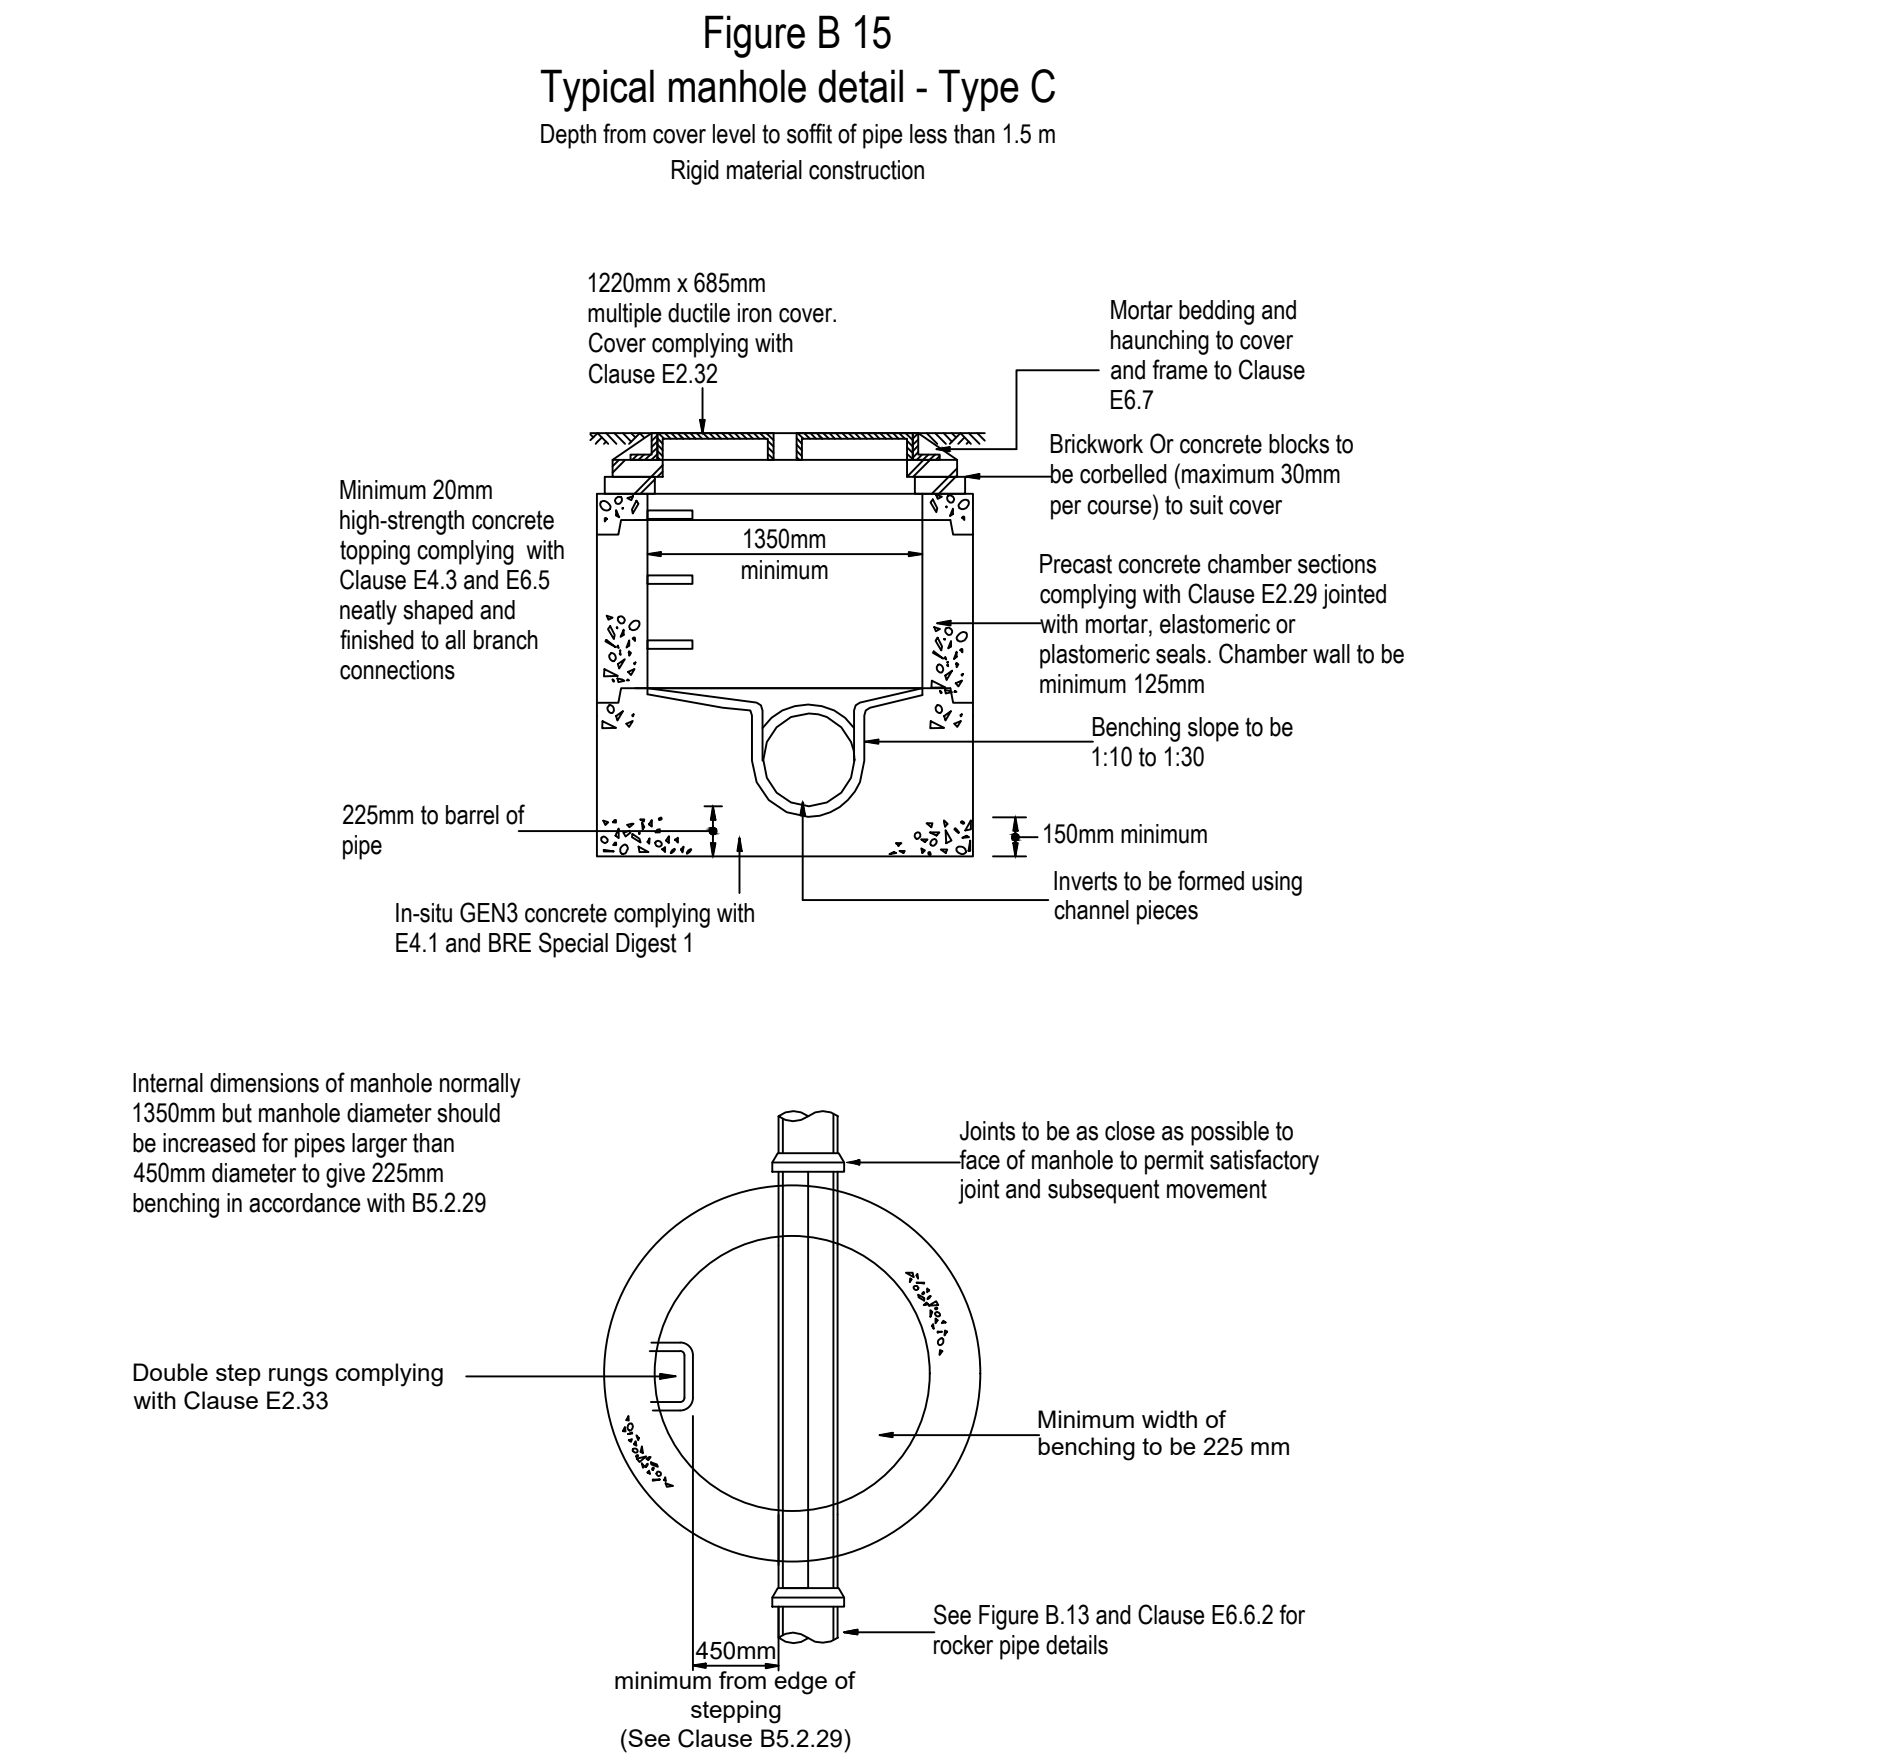

1. ALL DRAINAGE AND MATERIALS AND SPECIFICATIONS TO BE IN ACCORDANCE WITH DESIGN AND CONSTRUCTION GUIDANCE APPROVED VERSION 2.3 11 NOVEMBER 2024
2. REFER TO MJM CONSULTING ENGINEERS DRAWING NO. FOR DRAINAGE LAYOUT AND MANHOLE SCHEDULE
3. ALL PIPES AND FITTINGS ARE TO BE LAID IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS.
4. RIGID PIPES BUILT INTO MANHOLES SHOULD HAVE A FLEXIBLE JOINT AS CLOSE AS FEASIBLE TO THE EXTERNAL FACE OF THE STRUCTURE AND THE LENGTH OF THE NEXT ROCKER PIPE SHOULD BE AS PER TABLE BELOW

5. ALL PIPES ENTERING THE BOTTOM OF THE MANGOLE TO HAVE SOFFITS LEVEL.

5. ALL PIPES ENTERING THE BOTTOM OF THE MANGOLE TO HAVE SOFFITS LEVEL.

11	20.05.28	FIRST ISSUE	NT
12	Date	Amendment	

mjm Consulting Engineers
Southgate House, 38 Southgate, Wakefield WF1 1TL
T: 01924 811 000 mjm.co.uk

Client: J CHURCHILL

Drawing Title:
STANDARD DRAINAGE DETAILS - 1 of 3

 NT	 CB	 CB
JMC Ref: 8663	Scale: NTS	Sheet Size: A1
Revision Status: P01	Suitability Status: S4	Date: APRIL '2

Approval:

Drawing Reference:
Project - Originator - Zone - Level - File Type - Discipline - Number

8663-MJM-00-ZZ-DR-D-5210

THIS DRAWING MAY NOT BE COPIED WITHOUT PRIOR WRITTEN PERMISSION