




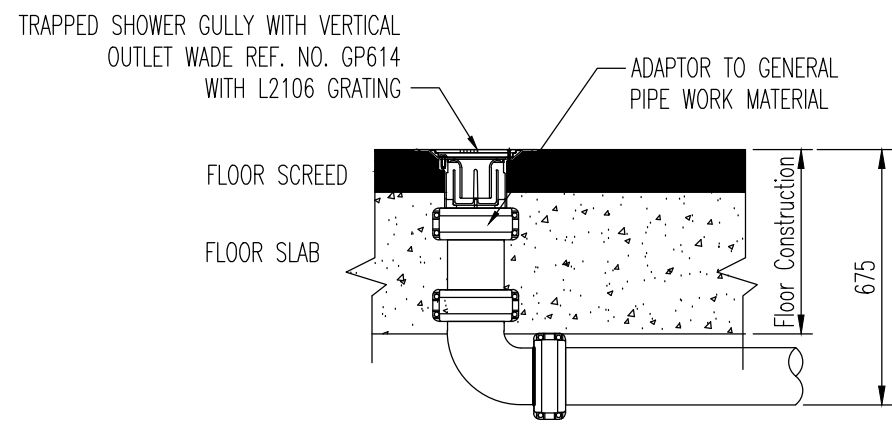


TYPICAL SHOWER GULLY
SCALE 1:20

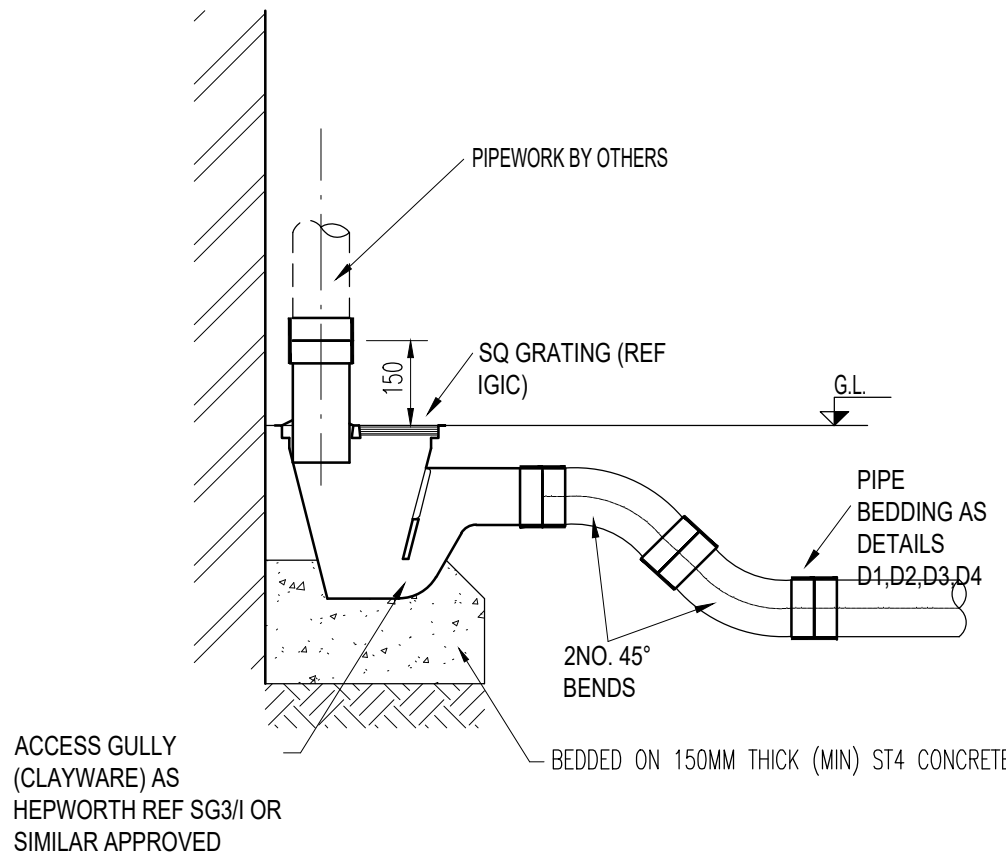

TYPICAL RWP TRAPPED BACK INLET GULLY
SCALE 1:20

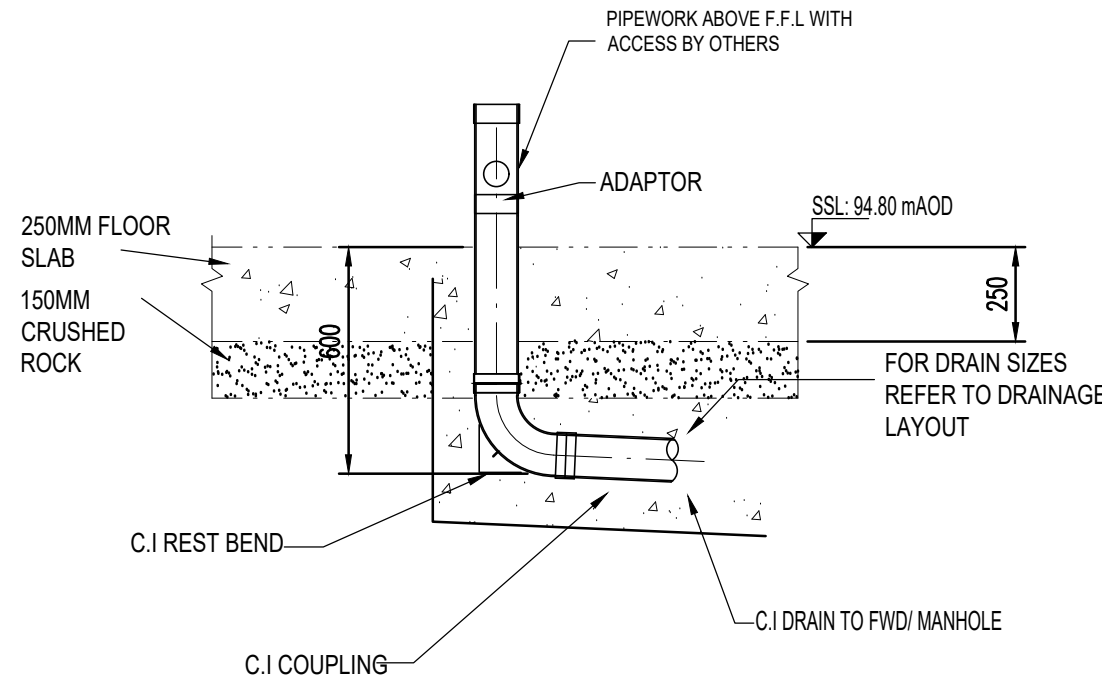


DOWNPOINT DRAINS(SVP+ RWP) FOR WORKSHOP
SCALE 1:20

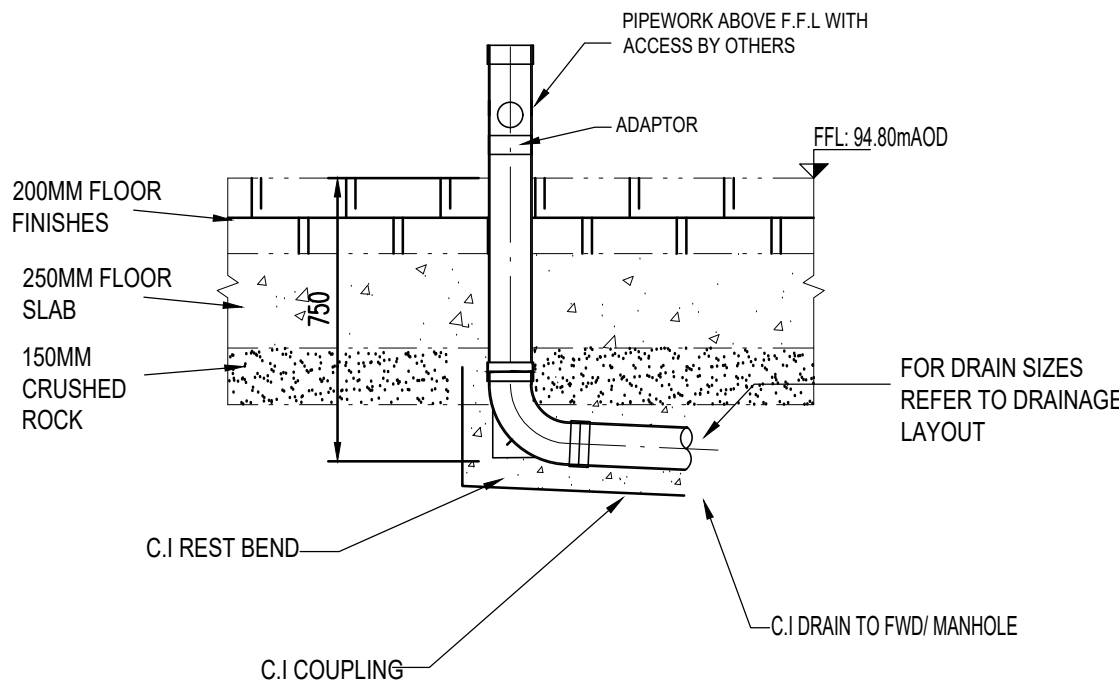


DOWNPOINT DRAINS(SVP+ RWP) FOR OFFICE
SCALE 1:20


EXACT REQUIREMENTS TO BE CONFIRMED

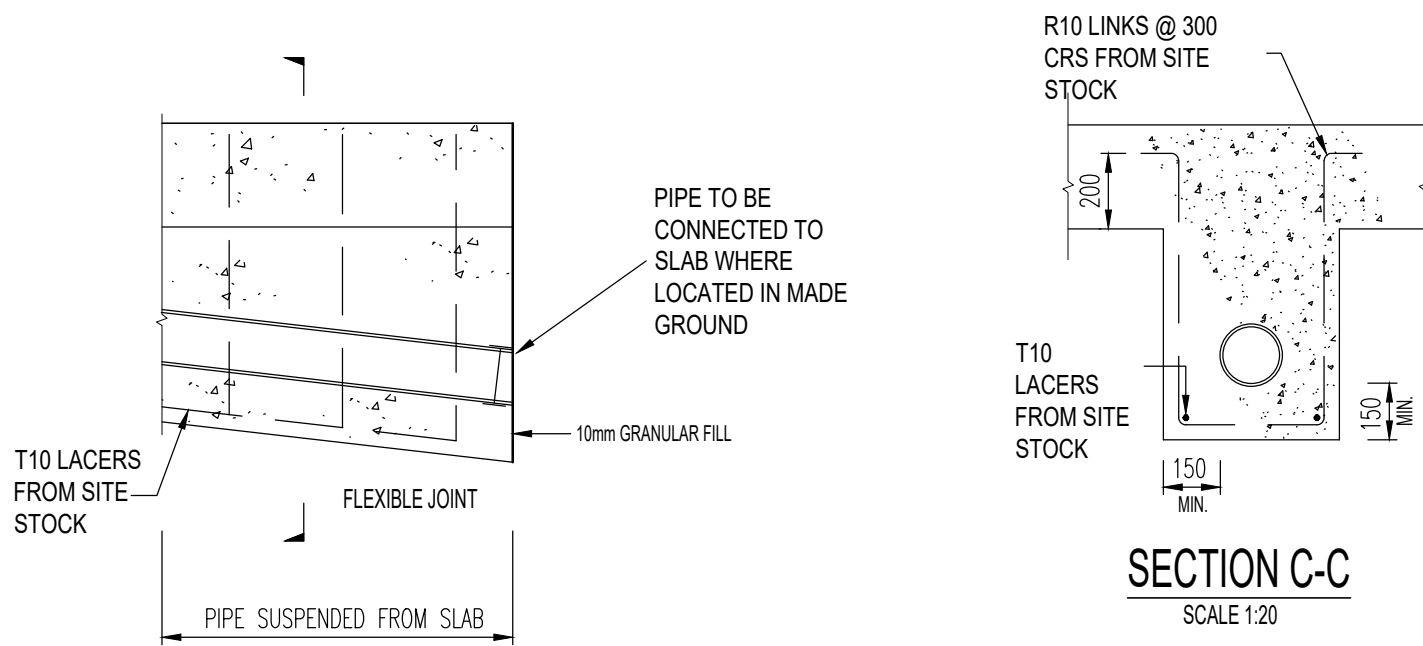

INTERNAL BEDDING DETAILS
SCALE 1:20



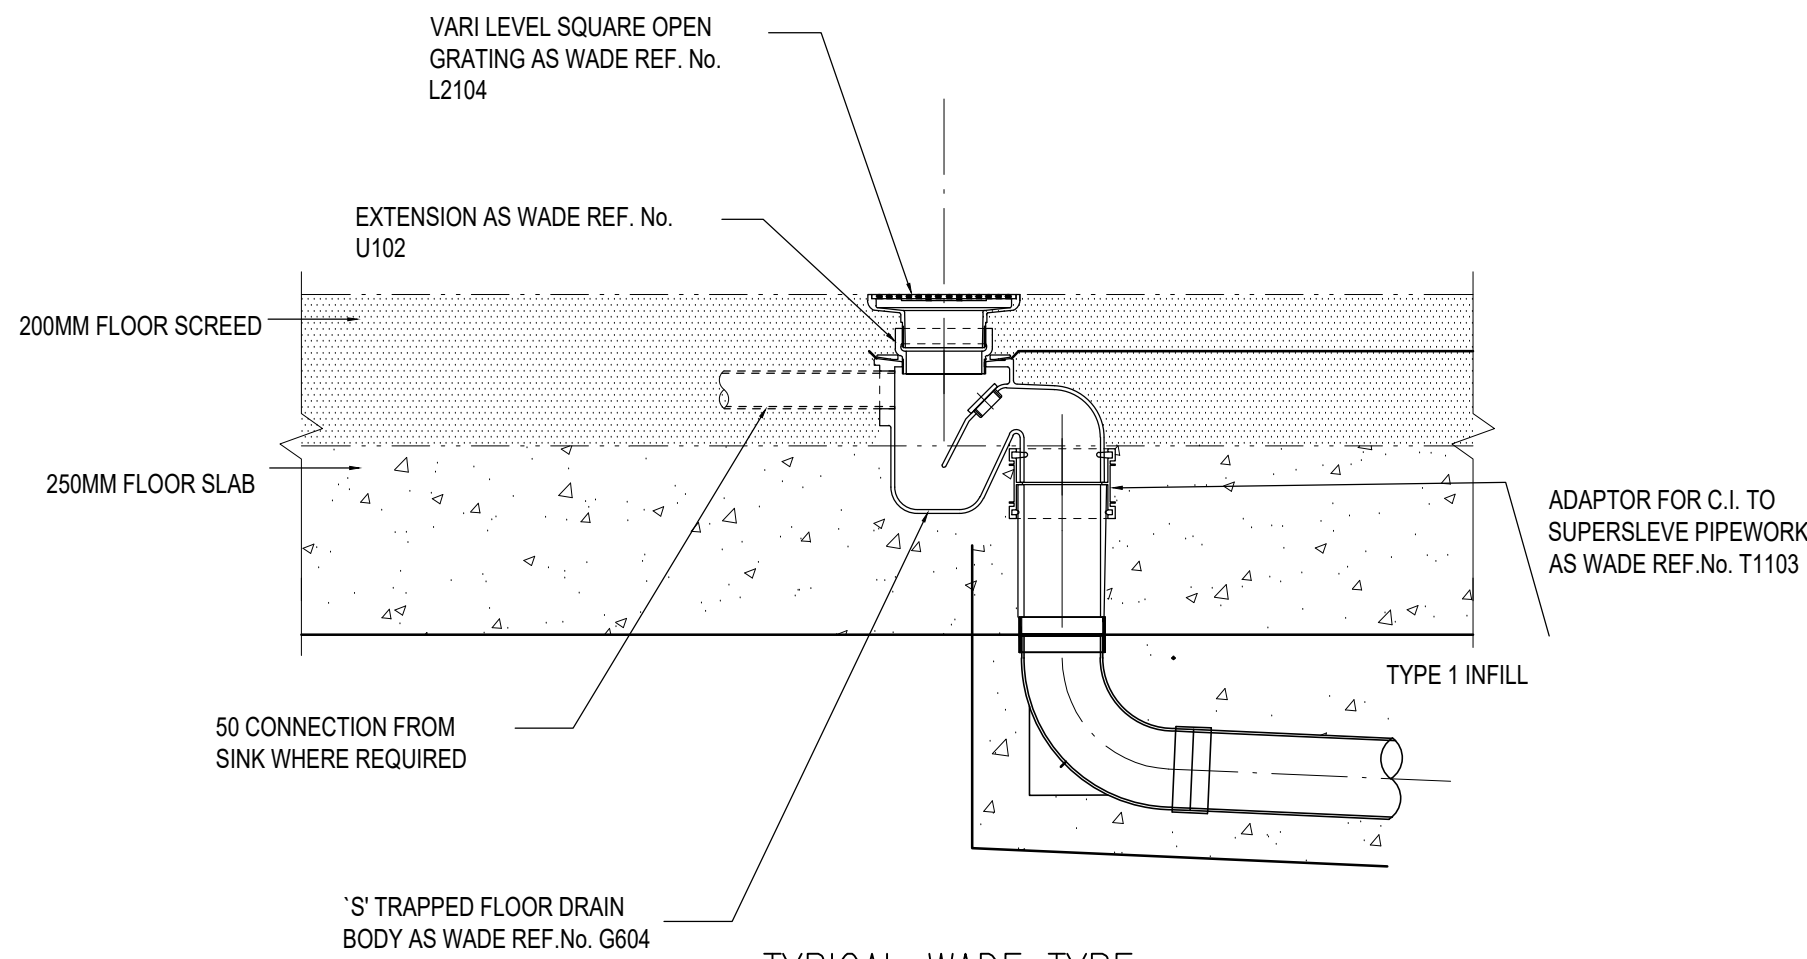


TYPICAL WADE TYPE FLOOR GULLY

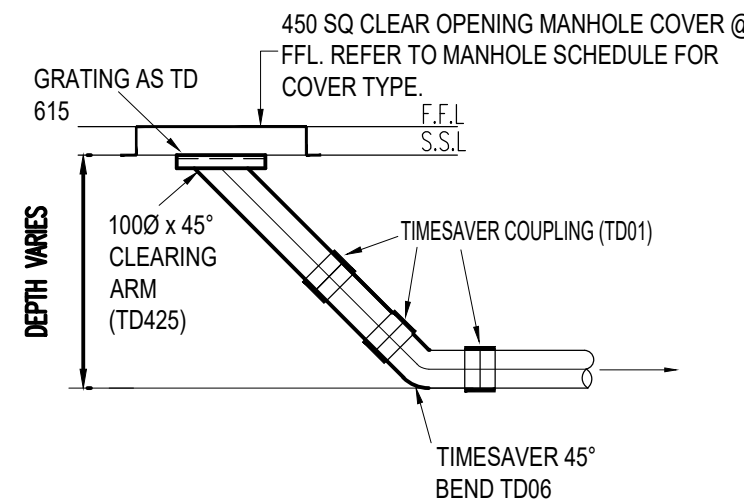


TYPICAL DETAIL OF CAST IRON RODDING EYE WITH ACCESS COVER LOCATED @ F.F.L


CLASS Y CONCRETE SURROUND WITHIN 300mm OF FLOOR SLAB

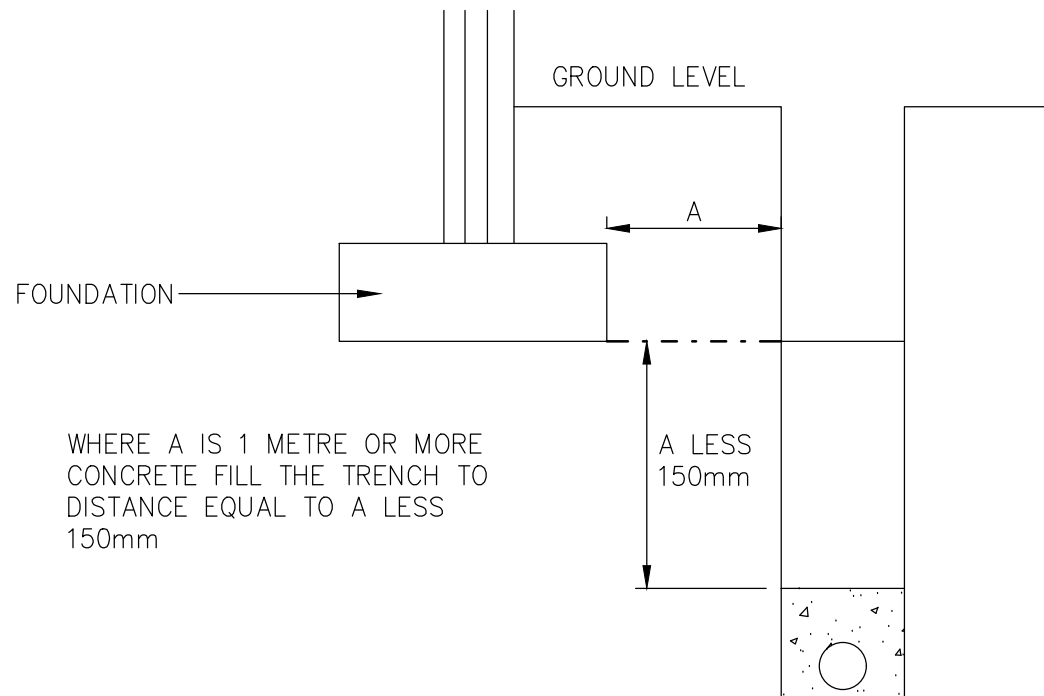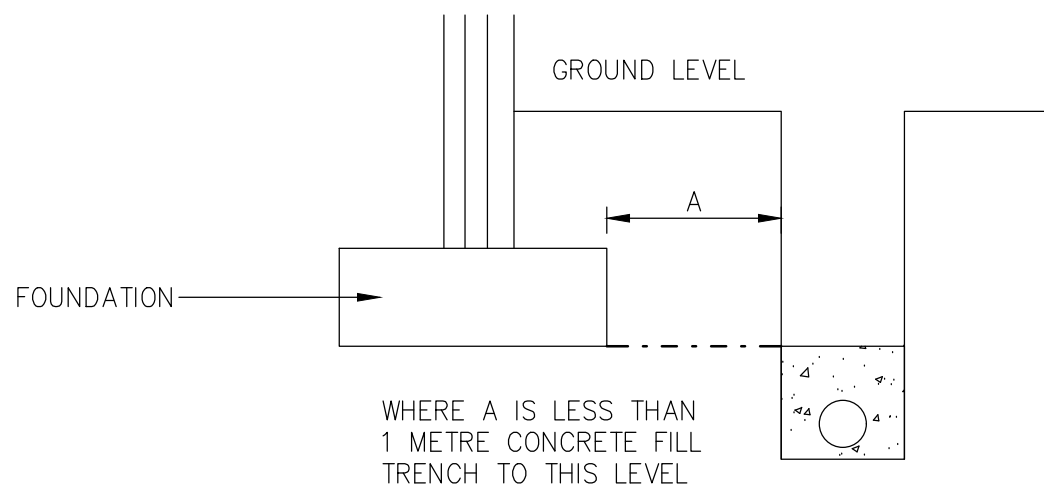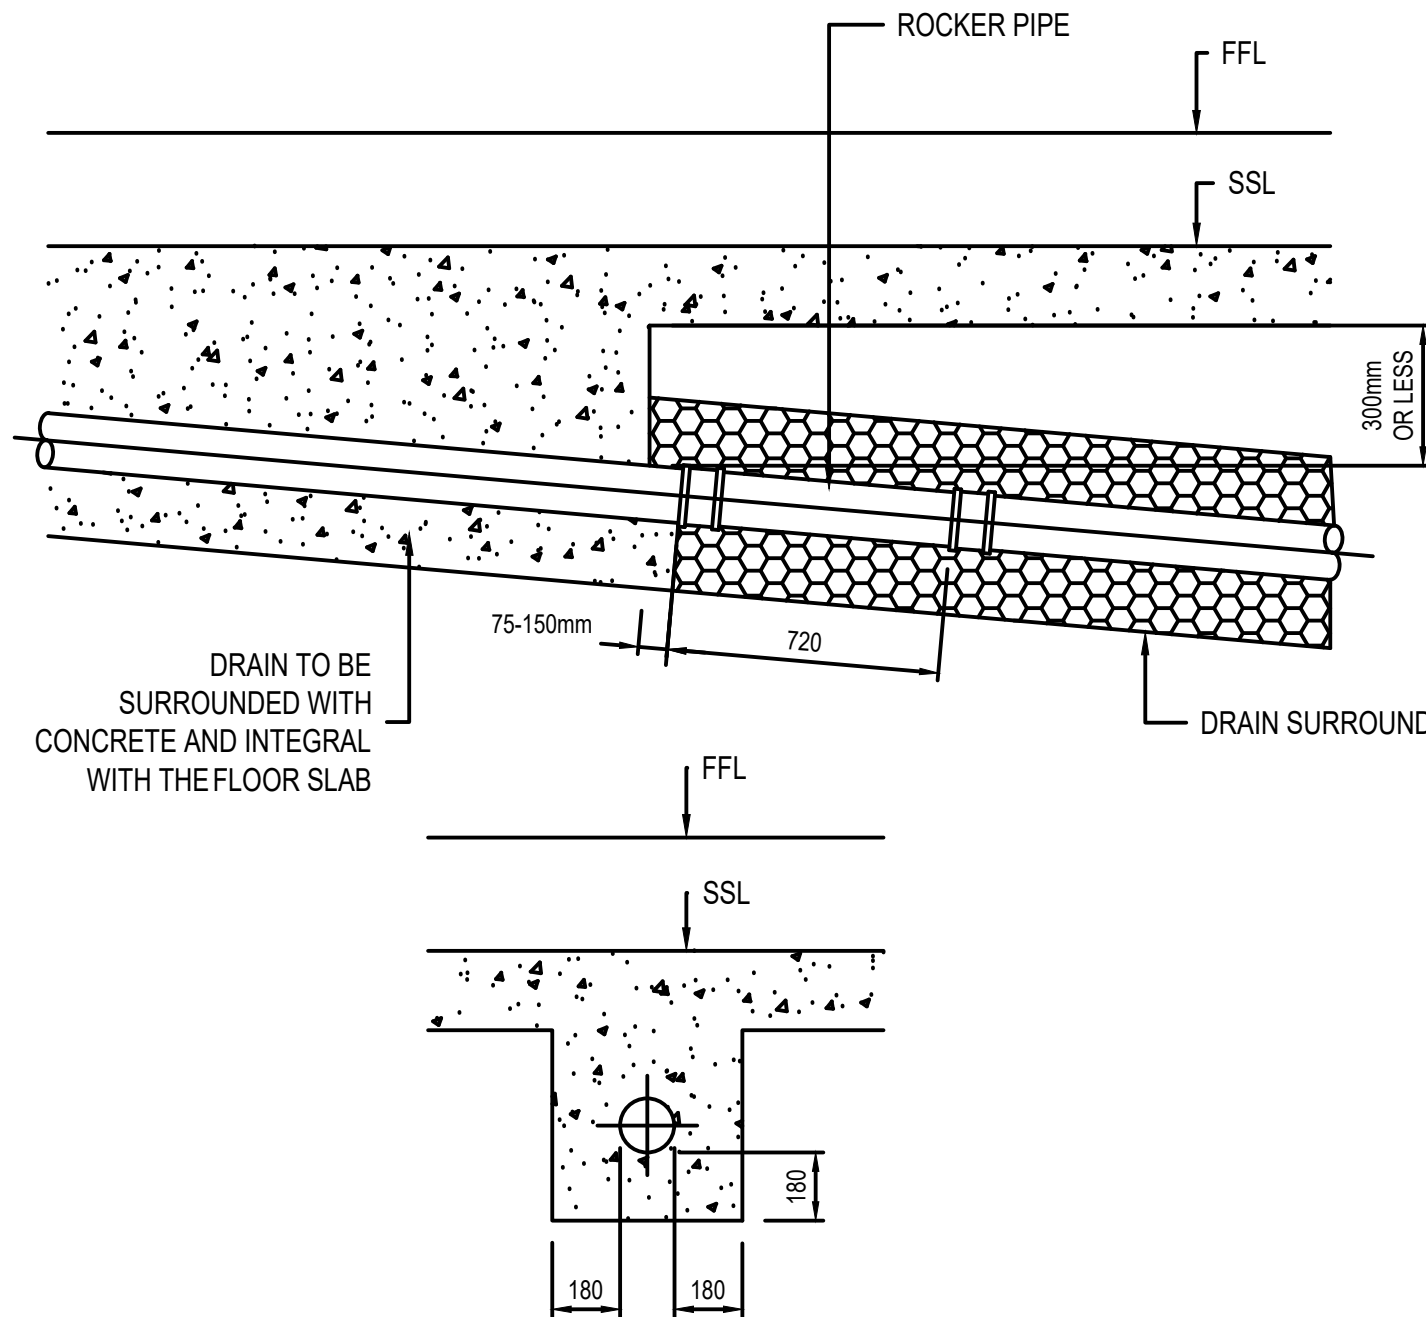


PIPE RUNS NEAR BUILDINGS FROM BUILDING REGULATIONS PART H N.T.S

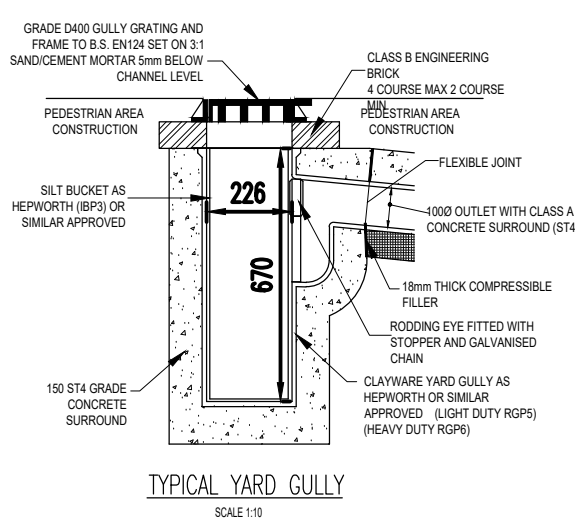


TYPICAL YARD GULLY
SCALE 1:10

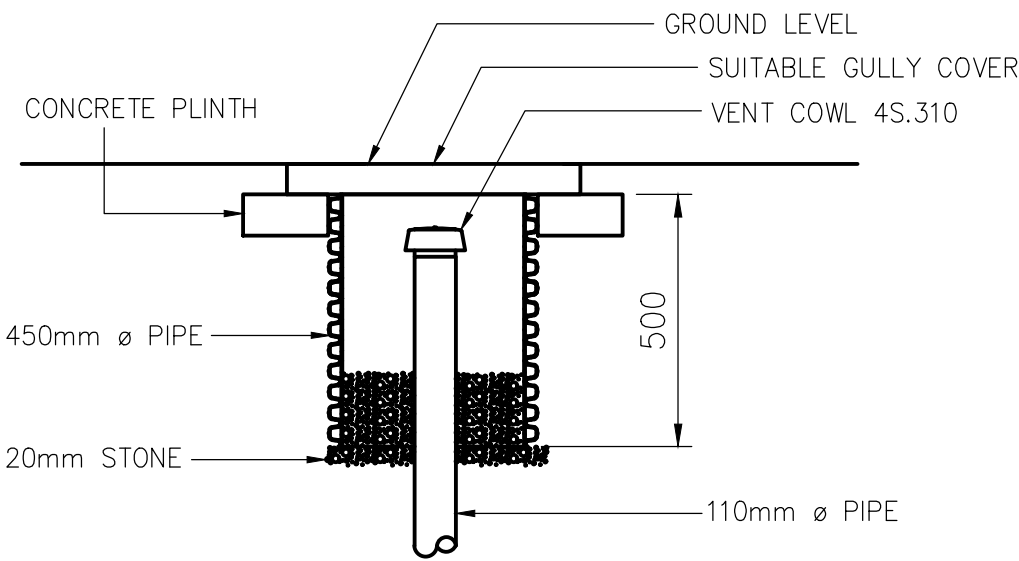

TYPICAL VENT DETAIL
Scale 1:20

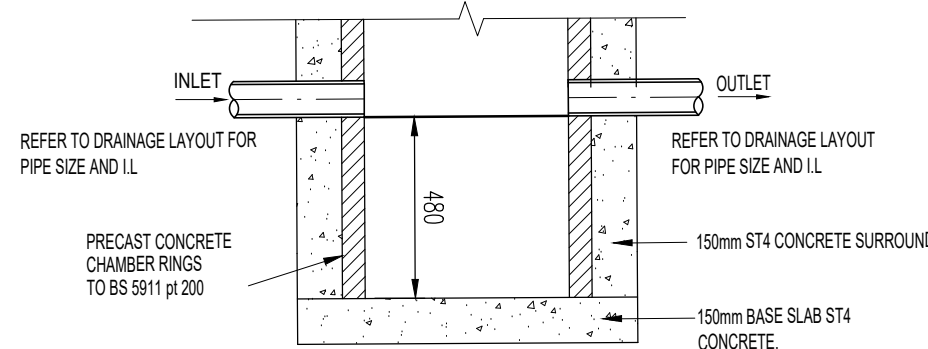

TYPICAL CATCHPIT DETAIL

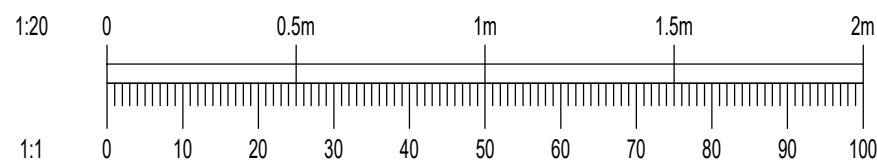

This drawing should not be scaled. Dimensions to be verified on site. Any discrepancies should be referred to the Engineer prior to work being put in hand. This drawing is the property of Waterman Infrastructure & Environment Limited, and the drawing is issued on the condition that it is not copied, reproduced, related or disclosed to any unauthorised person, either wholly or in part without the consent in writing of Waterman Infrastructure & Environment Limited. Pickfords Wharf, Clink Street, London SE1 1DG. 1 020 7928 7888 1 03333 444 501

GENERAL NOTES

- DO NOT SCALE THIS DRAWING.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECT'S, ENGINEER'S, SERVICES AND SPECIALIST DRAWINGS AND SPECIFICATIONS.
- ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
- ANY DISCREPANCIES IN DIMENSIONS OR DETAILS ON OR BETWEEN THESE DRAWINGS SHOULD BE DRAWN TO THE ATTENTION OF THE ARCHITECT AND/OR THE ENGINEER.
- ALL COVER AND INVERT LEVELS ARE SHOWN IN METRES AND PIPE DIAMETERS ARE IN MILLIMETRES.
- ALL BUILDING DRAINAGE TO BE INSTALLED AND TESTED IN COMPLIANCE WITH THE BUILDING REGULATIONS 2000 DRAINAGE AND WASTE DISPOSAL APPROVED DOCUMENT H 2002 EDITION
- ALL COMPONENTS AND MATERIALS ARE TO BE MANUFACTURED AND SUPPLIED IN ACCORDANCE WITH THE RELEVANT BRITISH STANDARDS, AND LAID AND BACKFILLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS AND THE RELEVANT BRITISH STANDARDS.
- THE CONTRACTOR SHALL, BEFORE COMMENCING THE WORKS, VERIFY ALL SITE AND SETTING OUT DIMENSIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE TRUE AND PROPER SETTING OUT OF THE WORKS AND FOR THE CORRECTNESS OF THE POSITION, LEVELS, DIMENSIONS AND ALIGNMENT OF ALL PARTS OF THE WORKS.
- ALL ABOVE GROUND DRAINAGE TO INCORPORATE RODDING ACCESS FACILITIES.
- INSITU CONCRETE FOR USE IN GENERAL DRAINAGE WORKS, GRADE TO BS 5328.
- ALL DRAINAGE PIPEWORK UNDER THE BUILDING FLOOR SLAB TO HAVE A MINIMUM GRADIENT OF 1:40 AND TO BE A MINIMUM 100mm DIAMETER PIPEWORK, UNLESS OTHERWISE SHOWN.
- MINIMUM GRADIENT FOR ALL EXTERNAL 100mm DIAMETER PIPEWORK TO BE 1:80 AND 150mm DIAMETER PIPEWORK TO BE 1:50.
- ALL BRANCH DISCHARGE PIPES SHOULD NOT DISCHARGE INTO STACK LOWER THAN 450mm ABOVE THE THE INVERT OF THE TAIL OF THE BEND AT THE FOOT OF THE STACK. THE BEND AT THE FOOT OF THE STACK SHOULD HAVE A LARGE A RADIUSUS POSSIBLE AND AT LEAST 200mm AT THE CENTRE LINE.
- ALL DRAINAGE GULLIES TO BE TRAPPED AND TO BE 150mmØ.
- FOR INTERNAL DRAINAGE POSITIONS REFER TO ARCHITECTS CURRENT WORKING DRAWINGS.
- ALL BELOW SLAB DRAINAGE TO BE CAST IRON TO BS EN 877. CONTRACTOR'S PREFERENCE OF USING CLAYWARE PIPE IS ACCEPTABLE AND INSTALLATION TO BE IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
- ALL EXTERNAL DRAINAGE TO BE CONCRETE TO BS 5911 OR CLAYWARE TO BS EN 295. PIPES WITHIN PERMEABLE PAVING AND RAINGARDEN TO BE POLYETHYLENE PIPES.
- ROOT BARRIER, TERRAM ROOT GUARD OR SIMILAR APPROVED, TO BE INSTALLED AROUND MANHOLES AND DRAINAGE PIPES WHERE THEY REMAIN IN CLOSE PROXIMITY TO PROPOSED TREES.
- INSTALLATION OF ALL PROPRIETARY PRODUCTS TO BE IN ACCORDANCE WITH MANUFACTURER'S DETAILS.

Rev	Date	Description	By	Chk
C03	16.12.24	DETAILS UPDATED	SM	RP
C02	23.08.24	LLFA COMMENTS ADDRESSED	RL	RP
C01	30.05.24	FIRST ISSUE	AS	SS

Amendments

Project **HINCKLEY CDC AND ENDOSCOPY**

Title

PROPOSED DRAINAGE DETAILS
SHEET 2 OF 4

Client **DARWIN GROUP**



5th Floor One Cornwall Street Birmingham B3 2DX
1 0121 212 7700
mail@watermangroup.com www.watermangroup.com

Work Stage **STAGE 4** RIBA
Technical Design

Suitability **STAGE COMPLETE** A1

Designed By **RL** Director **PE** Waterman Ref **WIE20008**
Drawn By **RL** Date **MAY 2024** Scales @ A1 **1:20**

Project | Originator | Functional | Spatial | Form | Discipline | Number | Revision

19849-WIE-ZZ-XX-DR-D-92-007 **C03**