
From: Jacqueline Webb (National Gas) <jackie.webb1@nationalgas.com>
Sent: 25 August 2023 13:29
To: Planning Folder New
Subject: FW: [EXTERNAL] National Gas Transmission Enquiry Response - Job No. GW3_30532381
Attachments: National Gas Transmission 30532381.pdf; Objection - National Gas Transmission 30532381.pdf

Planning Team,

Please find attached a Holding Objection.

Jackie Webb
Asset Protection, National Gas Transmission

+44 (0)800 970 7000
+44 (0)7811 021561
Jackie.webb1@nationalgas.com



National Gas Transmission, Warwick Technology Park, Gallows Hill, Warwick, CV34 6DA
nationalgas.com | [Twitter](#) | [LinkedIn](#)

Please consider the environment before printing this email.

From: AssetProtection-NGT@safedigs.co.uk <AssetProtection-NGT@safedigs.co.uk>
Sent: 16 August 2023 12:58
To: Jacqueline Webb (National Gas) <jackie.webb1@nationalgas.com>
Cc: .Box.Assetprotection (National Gas) <box.assetprotection@nationalgas.com>
Subject: [EXTERNAL] National Gas Transmission Enquiry Response - Job No. GW3_30532381

CAUTION: This email originated from outside of the organisation. Do not click links or open attachments unless you recognise the sender and know the content is safe. If you suspect this email is malicious, please use the 'Report Phish' button.

16/08/2023

PLEASE DO NOT REPLY TO THIS EMAIL. Please contact Box.AssetProtection@NationalGas.com with any details of the work or any queries that you may have.

Please do not commence with any works until you have received authorisation and guidance from National Gas Transmission.

LSBUD ref: 30532381
Start Date : 04/09/2023

Your ref: 23/00767/FUL FOR NGT ONLY

Dear Sir/Madam,

Thank you for your enquiry which was received on 16/08/2023 11:57.

Please refer to the attached High Risk response documentation for National Gas Transmission's response.

Gas Asset:
GAS_PIPE_FEEDER(000000983059)

If you need to contact the National Gas Transmission Asset Protection Team regarding your enquiry, please use the following details:

Email : Box.AssetProtection@NationalGas.com
Address : National Grid House
Warwick Technology Park
Gallows Hill
Warwick
CV34 6DA
Telephone : 0800 970 7000 (available 8am - 4pm Mon - Fri)

National Gas Transmission Emergency Number:
0800 111 999*


* Available 24 hours, 7 days/week. Calls may be recorded and monitored.

LSBUD:
If you have an enquiry relating to the use of the LSBUD website please contact:

Telephone: 0345 437 7365
Email: enquiries@LSBUD.co.uk
Website: www.LSBUD.co.uk

Regards,

National Gas Transmission Asset Protection Team

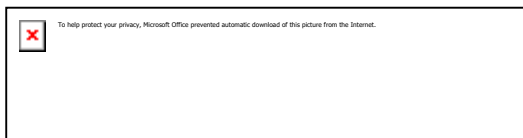

This e-mail, and any attachments are strictly confidential and intended for the addressee(s) only. The content may also contain legal, professional or other privileged information. If you are not the intended recipient, please notify the sender immediately and then delete the e-mail and any attachments. You should not disclose, copy or take any action in reliance on this transmission.

You may report the matter by contacting us via our [National Gas Transmission Contacts Page](#).

Please ensure you have adequate virus protection before you open or detach any documents from this transmission. National Gas Transmission and its affiliates do not accept any liability for viruses. An e-mail reply to this address may be subject to monitoring for operational reasons or lawful business practices.

For the registered information on National Gas Transmission please use the attached link:
<https://nationalgas.com/about-us/corporate-registrations>.

Our Ref: 30532381 23/00767/FUL FOR NGT ONLY

Wednesday, 16 August 2023

Jackie Webb
National Grid House Gallows Hill, Warwick Technology Park, Warwick
Warwick
Warwickshire
cv246da

National Gas Emergency Number:
0800 111 999*

*Available 24 hours, 7 days/week.
Calls may be recorded and monitored.
www.nationalgas.com

Asset Protection
National Gas Transmission
National Grid House
Warwick
CV34 6DA
Email: box.assetprotection@nationalgas.com
Tel: 0800 970 7000

National Gas Transmission – High Risk Response Letter

Dear Sir/ Madam,

An assessment has been carried out with respect to National Gas Transmission plc's apparatus and the proposed work location. Based on the location entered into the system for assessment the area has been found to be within the High Risk zone from National Gas Transmission plc's apparatus and you **MUST NOT PROCEED** without further assessment from Asset Protection.

Before you go ahead with these works, you are required to send your plans and a description for to us to review them at box.assetprotection@nationalgas.com. We will contact you within 28 days of receipt.

It is **YOUR** responsibility to take into account whether you are required to or would benefit from referring to the HSE Land Use Planning App (LUP), available from HSE's website. (Please note for some works this is a requirement for them to take place) More information on the LUP is available at <https://www.hse.gov.uk/landuseplanning/>

Please note this response and any attached map(s) are valid for 28 days.

Yours sincerely

Asset Protection Team

Your Responsibilities and Obligations

The "Assessment" Section below outlines the detailed requirements that must be followed when planning or undertaking your activities at this location.

It is your responsibility to ensure that the information you have submitted is accurate and that all relevant documents including links are provided to all persons (either direct labour or contractors) working for you near National Gas Transmission plc's apparatus, e.g. as contained within the Construction (Design and Management) Regulations.

This assessment solely relates to National Gas Transmission plc (NGT)

This assessment does **NOT** include:

- National Gas Transmission's legal interest (easements or wayleaves) in the land which restricts activity in proximity to National Gas Transmission's assets in private land. You must obtain details of any such restrictions from the landowner in the first instance and if in doubt contact Asset Protection.
- Recently installed apparatus.
- Apparatus owned by other organisations, e.g. Cadent, National Grid Electricity Transmission plc, other gas distribution operators, local electricity companies, other utilities, etc.

It is **YOUR** responsibility to take into account whether the items listed above may be present and if they could be affected by your proposed activities.

This communication does not constitute any formal agreement or consent for any proposed development work; either generally or with regard to National Gas Transmission plc easements or wayleaves nor any planning or building regulations applications.

National Gas Transmission plc or their agents, servants or contractors do not accept any liability for any losses arising under or in connection with this information. This limit on liability applies to all and any claims in contract, tort (including negligence), misrepresentation (excluding fraudulent misrepresentation), breach of statutory duty or otherwise. This limit on liability does not exclude or restrict liability where prohibited by the law nor does it supersede the express terms of any related agreements.

If you require further assistance please contact the Asset Protection team via e-mail (box.assetprotection@nationalgas.com) or via the contact details at the top of this response.

Are My Works Affected?

Is your proposal an Information Only or Planned Works Application?

Information Only

As your works are at an "Information Only" stage, any maps and guidance provided are for information purposes only. This is not approval to commence work. You must submit a "Planned Works" enquiry at the earliest opportunity and failure to do this may lead to disruption to your plans and works. Asset Protection will endeavour to provide an initial assessment within 28 days of receipt of a Planned Works enquiry and, dependent on the outcome of this, further consultation may be required. In any event, for safety and legal reasons, works must not be carried out until a Planned Works enquiry has been completed and final response received.

Planned Works

Your proposal is in proximity of National Gas Transmission plc's apparatus, as shown on the attached map, which may impact, and possibly prevent, your proposed activities for safety and/or legal reasons.

You must not commence any work until you have sent details to us at box.assetprotection@nationalgas.com and have received a response back confirming that we have no objections to the work taking place. You must read and follow all the guidance provided when planning or undertaking any activities at this location.

We will contact you within 28 working days of you providing us with the details of your work at the email address above. Please email, or call us at 0800 970 7000, if you have not had a response within this time frame.

Assessment

Affected Apparatus

The apparatus that has been identified as being in the vicinity of your proposed works is:

- National Gas Transmission Pipelines and associated equipment

Requirements

National High Pressure Gas Pipelines

BEFORE carrying out any work you must:

- Ensure that no works are undertaken in the vicinity of our gas pipelines and that no heavy plant, machinery or vehicles cross the route of the pipeline until detailed consultation has taken place.
- Carefully read these requirements including the attached guidance documents and maps showing the location of apparatus.
- Contact the landowner and ensure any proposed works in private land do not infringe National Gas Transmission's legal rights (i.e. easements or wayleaves). If the works are in the road or footpath the relevant local authority should be contacted.
- Ensure that all persons, including direct labour and contractors, working for you on or near National Gas Transmission's apparatus follow the requirements of the HSE Guidance Notes HSG47 - 'Avoiding Danger from Underground Services' This guidance can be downloaded free of charge at <http://www.hse.gov.uk>
- In line with the above guidance, verify and establish the actual position of mains, pipes, cables, services and other apparatus on site before any activities are undertaken.

DURING any work you must:

- Ensure that the National Gas Transmission requirements are followed for work in the vicinity of High pressure pipelines including the supervision of the digging of trial holes.
- Comply with all guidance relating to general activities and any specific guidance for each asset type as specified in the Guidance Section below.
- Ensure that access to National Gas Transmission apparatus is maintained at all times.
- Prevent the placing of heavy construction plant, equipment, materials or the passage of heavy vehicles over National Gas Transmission apparatus unless specifically agreed with National Gas Transmission in advance.
- Exercise extreme caution if slab (mass) concrete is encountered during excavation works as this may be protecting or supporting National Gas Transmission apparatus.
- Maintain appropriate clearances between gas apparatus and the position of other buried plant.

GUIDANCE

National Gas Transmission Network data

The Network map for National Gas Transmission assets can be downloaded at the following link in GIS format.

www.nationalgas.com/land-and-assets/network-route-maps

High Pressure Gas Pipelines Guidance:

If working in the vicinity of a high pressure gas pipeline the following document must be followed: 'Specification for Safe Working in the Vicinity of National Gas Transmission High Pressure Gas Pipelines and Associated Installation – Requirements for Third Parties' (SSW22). This can be obtained from: <Link to SSW22 once it has been updated and signed off>

Essential Guidance document:

<https://www.nationalgas.com/sites/gas/files/documents/8589934982-Essential%20Guidance.pdf>


You should be aware of the following information regarding National Gas Transmission's high pressure underground pipelines and associated apparatus:

- Our underground pipelines are protected by permanent agreements with landowners or have been laid in the public highway under our licence. These grant us legal rights that enable us to achieve efficient and reliable operation, maintenance, repair and refurbishment of our gas transmission network. Hence we require that no permanent structures are built over or under pipelines or within the zone specified in the agreement, materials or soil are not stacked or stored on top of the pipeline route and that unrestricted and safe access to any of our pipeline(s) must be maintained at all times.
- The information supplied is given in good faith and only as a guide to the location of our underground pipelines. The accuracy of this information cannot be guaranteed. The physical presence of such pipelines may also be evident from pipeline marker posts. The person(s) responsible for planning, supervising and carrying out work in proximity to our pipeline(s) shall be liable to us, as pipeline(s) owner, as well as to any third party who may be affected in any way by any loss or damage resulting from their failure to locate and avoid any damage to such a pipeline(s).
- The relevant guidance in relation to working safely near to existing underground pipelines is contained within the Health and Safety Executive's (www.hse.gov.uk) Guidance HS(G)47 "Avoiding Danger From Underground Services" and all relevant site staff should make sure that they are both aware of and understand this guidance.
- Our pipelines are normally buried to a depth of 1.2 metres or more below ground and further information may be found on the plans provided. Ground cover above our pipelines should not be reduced or increased.
- Any proposed cable crossings are subject to approval from National Gas Transmission, completion of a Deed of Consent and must remain a minimum of 600mm above or below the pipeline. All works associated with cable installation must be supervised by National Gas Transmission. Cables cannot be pulled through until a Deed of Consent is in place.
- If it is planned to use mechanical excavators and any other powered mechanical plant, it shall not be sited or moved above the pipeline.
- If it is planned to carry out excavation to a depth greater than 0.3 metres, embankment or dredging works, the actual position and depth of the pipeline must be established on site with our representative

and a safe working method agreed prior to any work taking place in order to minimise the risk of damage and ensure the final depth of cover does not affect the integrity of the pipeline.

- The digging of trial holes to locate the pipeline must be carried out under the supervision of our on-site representative following approval of RAMS. Excavation works may take place unsupervised no closer than 3 metres from the pipeline once its actual location has been confirmed. Similarly, excavation with handheld power tools may take place no closer than 1.5 metres away.
- For operational and safety reasons National Gas Transmission requires unrestricted access to our Above Ground Installations and Compressor Stations. We would request that any proposed changes to roads/layouts in the vicinity of our site have regard to the need to maintain access.
- Any construction traffic should either cross the pipeline using existing roads or at agreed crossing locations using agreed protective measures.
- Ground anchors for scaffolding stay wires should only be sited in the vicinity of the pipeline after the pipeline position has been confirmed on site with our representative and the ground anchor position agreed.
- If your proposals include the installation of wind turbines then the minimum separation between the pipeline and the nearest turbine should be 1.5 times the mast height.
- If your proposals include the installation of a Solar Farm, all assets must remain outside of the National Gas Transmission easement, all cable crossings must be agreed during the design stage, a Deed of Consent undertaken and an Earthing report must be provided for review. National Gas Transmission must retain access to its assets at all times once works have been completed.

The relocation of existing underground pipelines is not normally feasible on grounds of cost, operation and maintenance and environmental impact. Further details can be found in our specification for: safe working in the vicinity of National Gas Transmission high pressure gas pipelines and associated installations – requirements for third parties: T/SP/SSW/22 (see link above or copy enclosed)

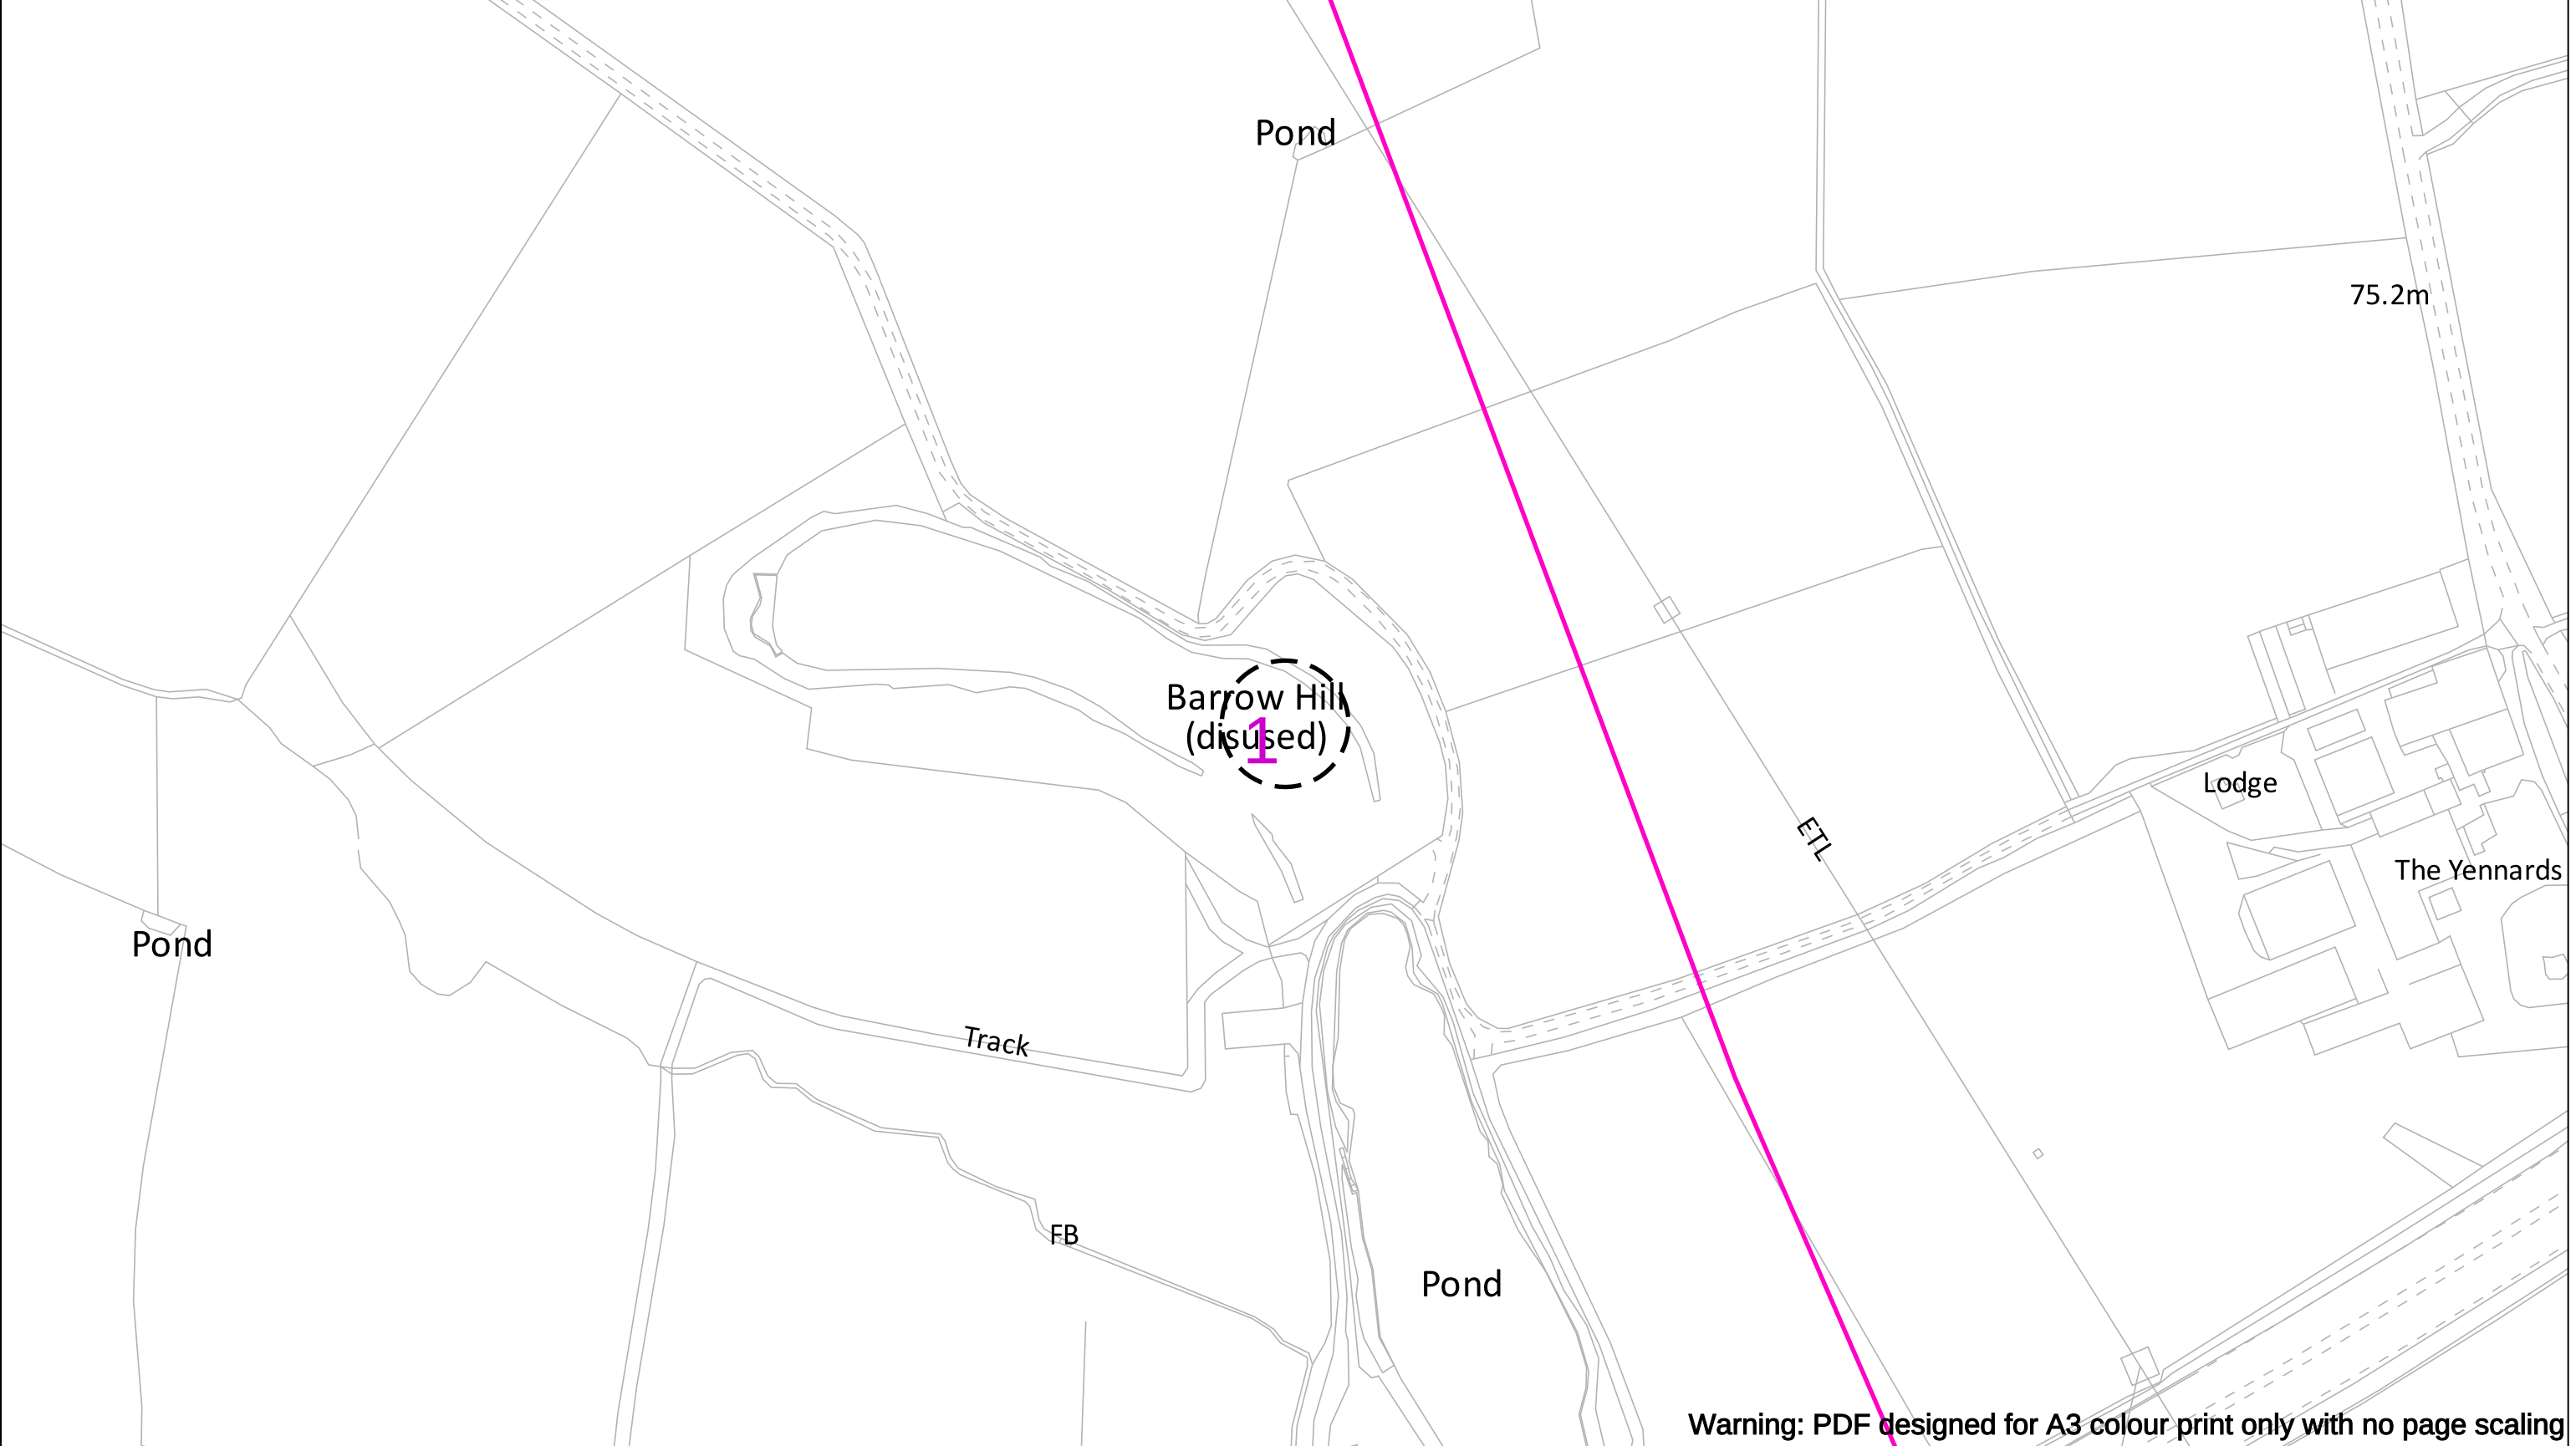

Date Requested: 16/08/2023 Job Reference: 30532381 Site Location: 448855 297136 Requested by: Miss Jackie Webb Your Scheme/Reference: 23/00767/FUL FOR NGT ONLY Scale: 1:2500 (When plotted at A3)	IMPORTANT NOTICES This plan shows those pipes owned by National Gas Transmission PLC in its role as a licensed Gas Transporter (GT). Gas pipes owned by other GTs, or otherwise privately owned, may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections, etc., are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by National Gas Transmission PLC or their agents, servants or contractors for any error or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.	National Gas Transmission Emergency Number: 0800 111 999 Available 24 hours, 7 days/week. Calls may be recorded and monitored	Warning: PDF designed for colour print only with no page scaling	National Gas Transmission National Grid House Warwick Technology Park Gallows Hill Warwick CV34 6DA box.assetprotection@nationalgas.com
		100m Dig Sites Area: [dashed box] Line: [dashed line] [pink line] NHP Mains		
Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2023. All rights reserved. Ordnance Survey Licence number 100024886				

ENQUIRY SUMMARY

Received Date

16/08/2023 11:57

Work Start Date

04/09/2023

Your Reference

23/00767/FUL FOR NGT ONLY

Location

Centre Point: 448855 297136

X Extent:

Y Extent:

Postcode: LE9 7TR

Map Options

Paper Size: A3

Orientation: LANDSCAPE

Scale: 1:2500

Real World Extents: 50m x 50m

Enquirer Details

Organisation Name: National Grid

Contact Name: Jackie Webb

Email Address: Jackie.webb1@nationalgas.com

Telephone: 07811 021561/07811 021561

Address: National Grid House Gallows Hill, Warwick Technology Park, Warwick, Warwick, Warwickshire, cv246da

Enquiry Type

Planned Works

Activity Type

Planning Applications

Work Types

Multiple properties

Notes/Works Description (if supplied)

Construction of 36 residential holiday lodges and a management building with associated vehicular access, parking, surface water balancing and landscaping (revised scheme of application reference planning@hinckley-bosworth.gov.uk)

Site Contact Name (if supplied)

Jackie Webb

Site Contact Number (if supplied)

07811021561

Hinckley & Bosworth Council

Asset Protection
National Gas Transmission
National Grid
Warwick
Direct Tel: 07811 021561
Email: jackie.webb1@nationalgas.com

Planning Work?
Please enquire with us at
www.lsbud.co.uk

National Gas Emergency Number:
0800 111 999*

*Available 24 hours, 7 days/week.
Calls may be recorded and monitored.
www.nationalgas.com

Date : 8/25/2023
Our Reference: GW3_30532381
Your Reference: 23/00767/FUL FOR NGT ONLY

Dear Planning Team,

Ref: Site Address Not Provided

National Gas Transmission exercises its right to place a Holding Objection to the above proposal which will cross our High-Pressure Gas Pipeline – Feeder 4.

Holding Objection:

National Gas Transmission operates a high-pressure gas pipeline - FEEDER 4 - Cosby to Kirkby Mallory in close proximity to the proposed development.

The pipeline has a 24.4m wide easement in operation (12.2m either side of pipeline). No development, construction or landscaping is permitted within the easement without formal written approval from National Grid.

The proposed dwelling appears to fall outside the pipeline easement.

The pipeline has a 76m 'Building Proximity Distance' (BPD), which restricts development within this distance.

There is a possibility that the proposed development falls within the BPD.

Further guidance for consultation zones around a Major Hazard Pipeline can be found at: <https://www.hse.gov.uk/landuseplanning/methodology.pdf> It is the Local Authority & Developer's responsibility to ensure that the requirements of LUP are adhered to.

The holding objection will remain until the requirements of the 'Land Use Planning' have been satisfied and the HSE response offered to National Gas Transmission for review.

- We would draw your attention to the Planning (Hazardous Substances) Regulations 1992, the Land Use Planning rules and PADHI (Planning Advice for Developments near Hazardous Installations) guidance published by the HSE, which may affect this development.

- To visit the Land Use Planning site, please use the link below:
<https://www.hse.gov.uk/landuseplanning/methodology.htm>
- No buildings should encroach within the Easement strip of the pipeline
- No demolition shall be allowed within 150 metres of a pipeline without an assessment of the vibration levels at the pipeline. Expert advice may need to be sought which can be arranged through National Gas Transmission.
- National Gas Transmission has a Deed of Easement for each pipeline which prevents change to existing ground levels, storage of materials. It also prevents the erection of permanent / temporary buildings, or structures. If necessary National grid will take action to legally enforce the terms of the easement.
- You should be aware of the Health and Safety Executives guidance document HS(G) 47 "Avoiding Danger from Underground Services", and National Gas Transmission's specification for Safe Working in the Vicinity of National Gas Transmission High Pressure gas pipelines and associated installations - requirements for third parties T/SP/SSW22. You should already have received a link to download a copy of T/SP/SSW/22, from our Plant protection Team, which is also available to download from our website.
- To view the SSW22 Document, please use the link below:
<https://www.nationalgrid.com/uk/gas-transmission/document/113921/download>
- A National Gas Transmission representative will be monitoring the works to comply with SSW22.
- To download a copy of the HSE Guidance HS(G)47, please use the following link:
<http://www.hse.gov.uk/pubns/books/hsg47.htm>
- National Gas Transmission will also need to ensure that our pipelines access is maintained during and after construction.
- Our pipelines are normally buried to a depth cover of 1.1 metres however; actual depth and position must be confirmed on site by trial hole investigation under the supervision of a National Gas Transmission representative. Ground cover above our pipelines should not be reduced or increased.
- If any excavations are planned within 3 metres of National Gas Transmission High Pressure Pipeline or, within 10 metres of an AGI (Above Ground Installation), or if any embankment or dredging works are proposed then the actual position and depth of the pipeline must be established on site in the presence of a National Gas Transmission representative. A safe working method must be agreed prior to any work taking place in order to minimise the risk of damage and ensure the final depth of cover does not affect the integrity of the pipeline.
- Excavation works may take place unsupervised no closer than 3 metres from the pipeline once the actual depth and position has been confirmed on site under the supervision of a National Gas Transmission representative. Similarly, excavation with hand held power tools is not permitted within 1.5 metres from our apparatus and the work is undertaken with NGT supervision and guidance.

Pipeline Crossings

- Where existing roads cannot be used, construction traffic should ONLY cross the pipeline at locations agreed with a National Gas Transmission engineer.
- All crossing points will be fenced on both sides with a post and wire fence and with the fence returned along the easement for a distance of 6 metres.

- The pipeline shall be protected, at the crossing points, by temporary rafts constructed at ground level. No protective measures including the installation of concrete slab protection shall be installed over or near to the National Gas Transmission pipeline without the prior permission of National Gas Transmission. National Gas Transmission will need to agree the material, the dimensions and method of installation of the proposed protective measure. The method of installation shall be confirmed through the submission of a formal written method statement from the contractor to National Gas Transmission.
- Please be aware that written permission from National Gas Transmission is required before any works commence within the National Gas Transmission easement strip.
- A National Gas Transmission representative shall monitor any works within close proximity to the pipeline to comply with National Gas Transmission specification T/SP/SSW22.
- A Deed of Indemnity is required for any crossing of the easement including cables

Cables Crossing

- Cables may cross the pipeline at perpendicular angle to the pipeline i.e. 90 degrees.
- A National Gas Transmission representative shall supervise any cable crossing of a pipeline.
- An impact protection slab should be laid between the cable and pipeline if the cable crossing is above the pipeline.
- Where a new service is to cross over the pipeline a clearance distance of 0.6 metres between the crown of the pipeline and underside of the service should be maintained. If this cannot be achieved the service must cross below the pipeline with a clearance distance of 0.6 metres.

All work should be carried out in accordance with British Standards policy

- BS EN 13509:2003 - Cathodic protection measurement techniques
- BS EN 12954:2001 - Cathodic protection of buried or immersed metallic structures – General principles and application for pipelines
- BS 7361 Part 1 - Cathodic Protection Code of Practice for land and marine applications.

I have enclosed a location map to show the location of National Gas Transmission high-pressure gas pipeline(s) within the vicinity of your proposal.

Yours sincerely

Asset Protection Assistant