


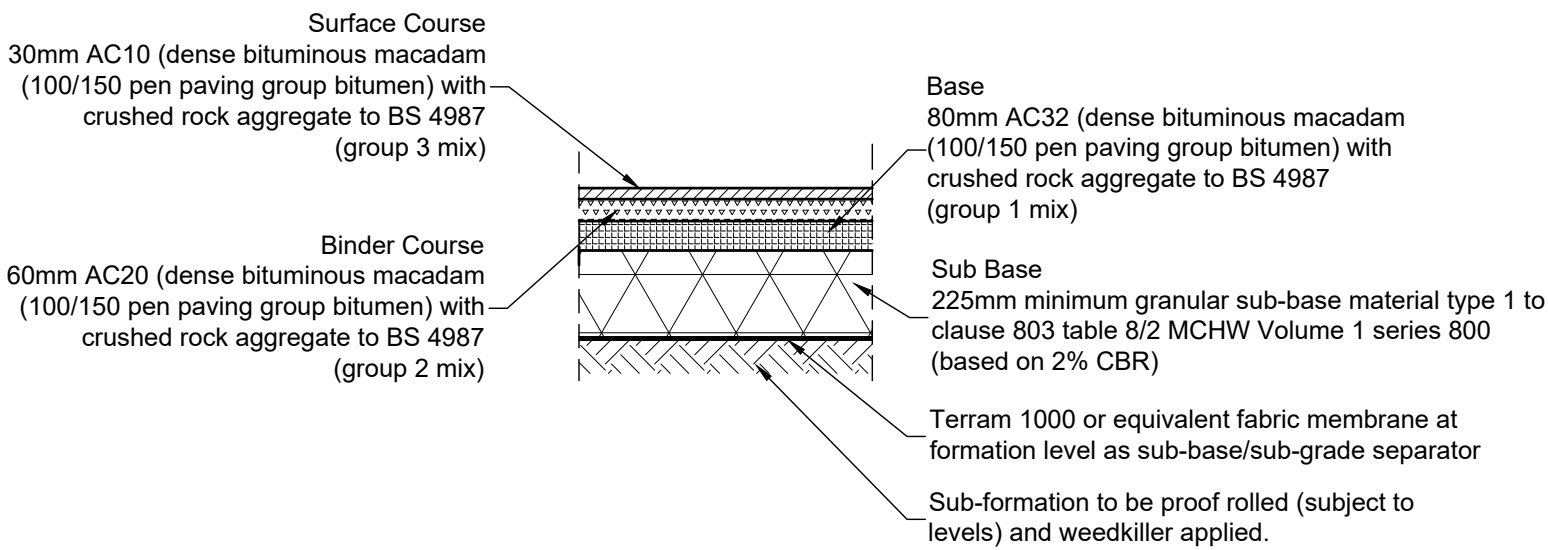


Bituminous Car Park


CBR	Without Geotextile Underneath	With Geotextile Underneath
Less than 2%	N/A	300
2-3%	325	225
3-5%	250	150
5-7%	150	N/A
7-20%	100	N/A

Minimum thickness (mm) of type 1 sub-base. (consolidated in accordance with MCHW Volume 1 Clause 801, table 8/1)

Type 1 Sub-Base for Paved Surfaces

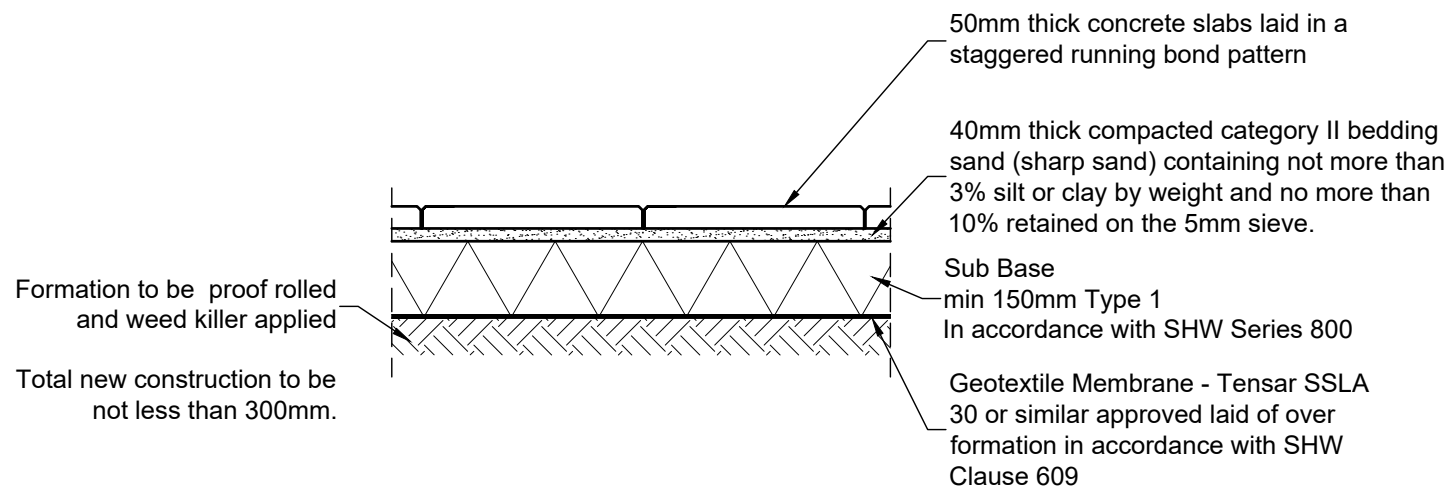


600 x 600mm Concrete Slab

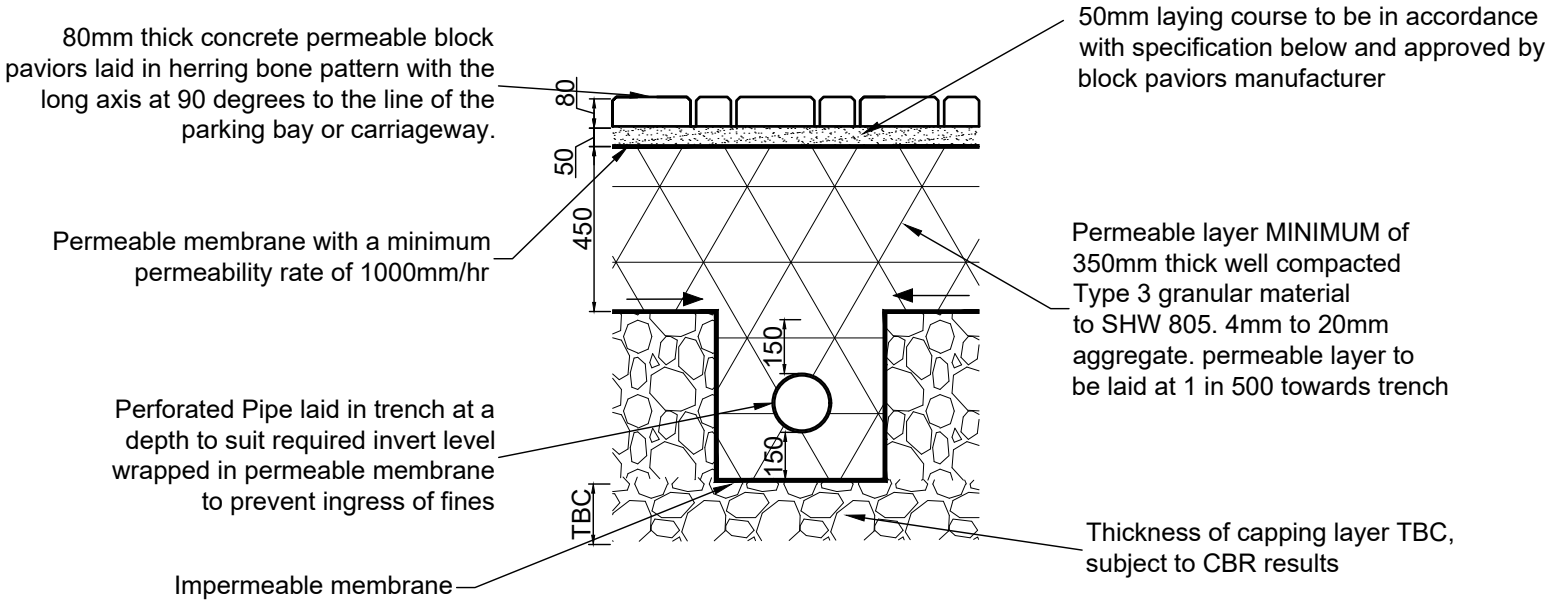


Type C Permeable Paving


BS Sieve Size	Percentage Passing
40mm	100
31.5mm	98-100
20mm	90-99
10mm	25-70
4mm	0-15
2mm	0-5

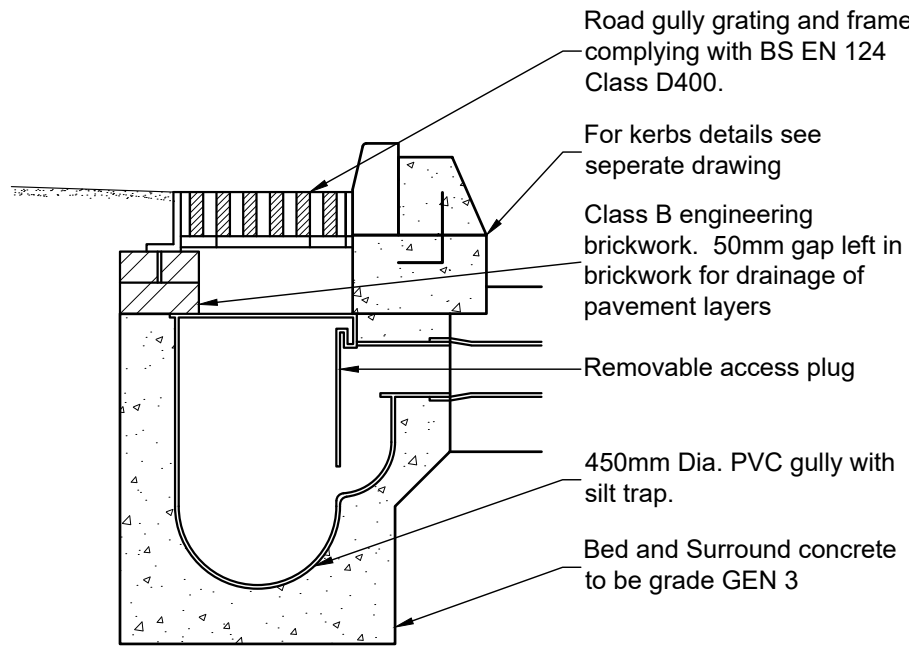


Typical PVC Gully Detail

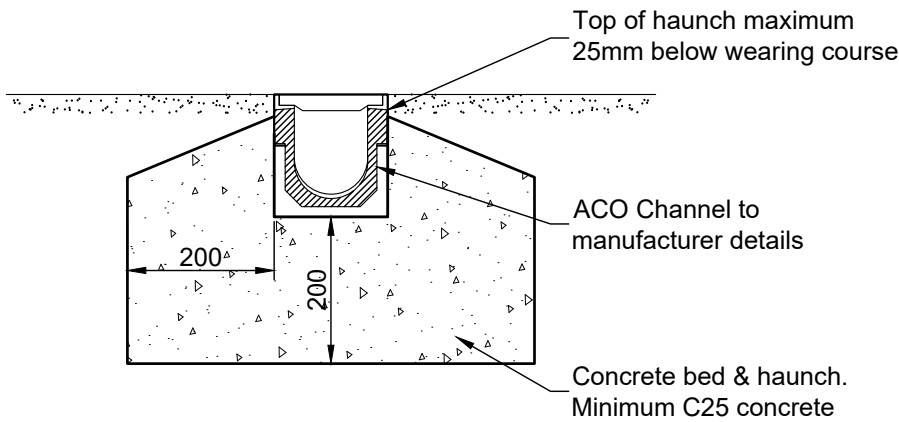


Typical Section Through ACO Drain

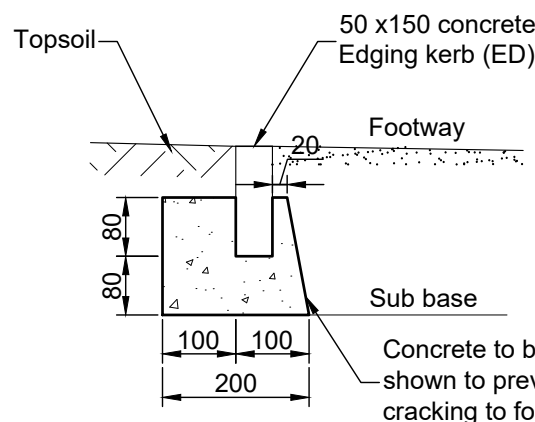

Footpath/Footway Edging Type: ED

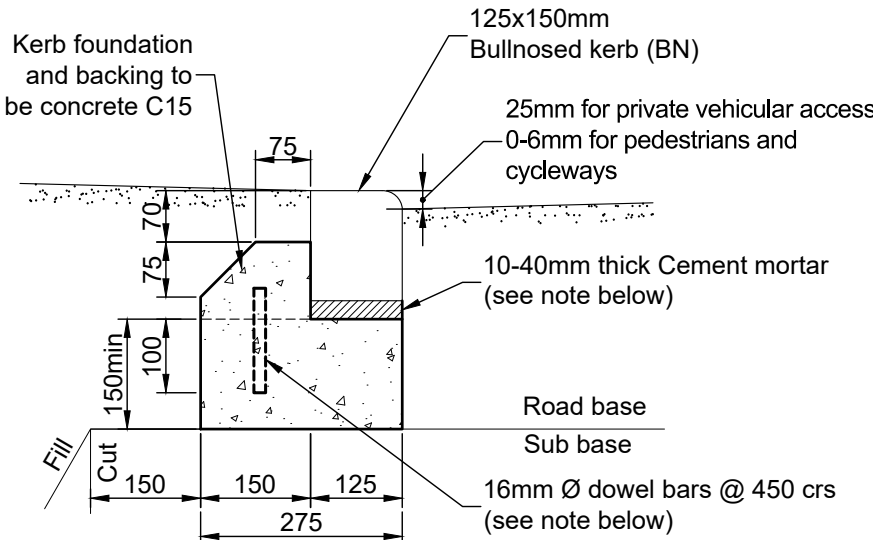

Concrete Kerb Type: BN

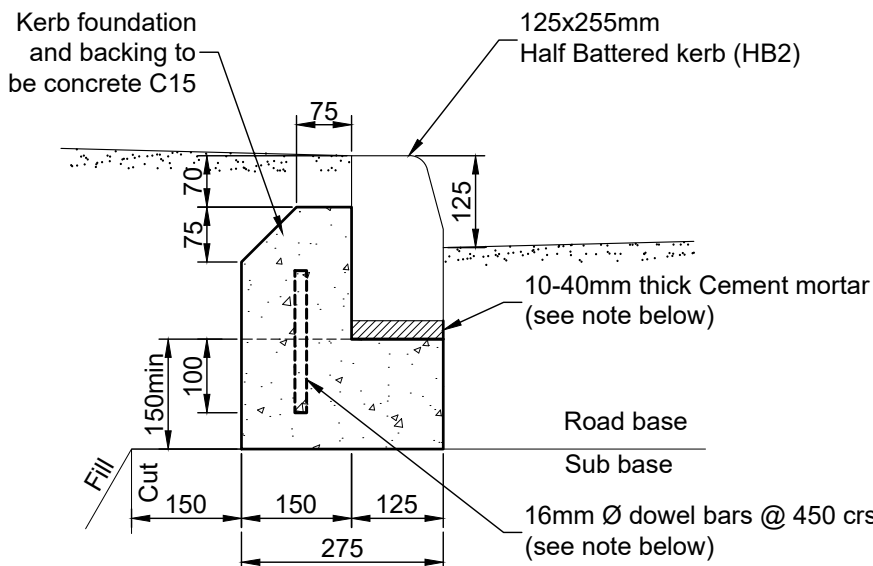

Concrete Kerb Type: HB

SAFETY, HEALTH & ENVIRONMENTAL HAZARD INFORMATION BOX.



The hazards noted below are in addition to the normal hazards and risks faced by a competent contractor when dealing with the types of works detailed on this drawing.

CONSTRUCTION RISKS:

- Deep Trenches
- Unforeseen Services
- Leptospirosis

DEMOLITION RISKS:

- Leptospirosis

Notes:

1. DO NOT SCALE FROM THIS DRAWING.
2. All dimensions are in millimetres Unless Noted Otherwise (u.n.o.)
3. Drawing is to be read in conjunction with all relevant architect's drawings. Any inconsistencies should be reported to PRP immediately.
4. All levels and dimensions are to be checked on site before any work commences.
5. The Health and Safety at Work act is to be complied with at all times. Attention is drawn to the wearing of hard hats, reflectorised clothing, and the use of any other required safety equipment.

External Works:

1. Prior to any works being carried out within or immediately adjacent to the public highway, a scheme for the safe control of traffic and pedestrians is to be agreed with the Highway Authority and implemented
2. Any utilities shown on this drawing are indicative only. It is the Contractor's responsibility to trace and indicate the precise location and nature of all services.
3. The Developer/Contractor shall be responsible for liaison with the Statutory Undertakers and other cable service companies for the provision of all required services, diversion.
4. The formation of all surfaces shall be trimmed, rolled and treated with a glyphosphate based weedkiller in accordance with the manufacturers instructions prior to laying the sub-base
5. All in situ concrete shall be Designated Concrete GEN3 produced in accordance with BS 8500-2006.
6. In all instances sulphate resisting cement is to be used.
7. Half Battered and Splayed kerbs face shall be 125mm above the channel level.
8. The minimum depth of concrete below all kerbs shall be 150mm. Kerbs shall be laid on a 10-40mm bed of Class 1 cement mortar unless laid with the foundation in one operation.
9. Adequate bond must be made between foundation and haunch if laid in more than one operation. Preferred method of bonding to be by means of steel U-bars reinforcement, any other method to be approved by PRP.
10. Mortar joints between kerbs not to be provided unless specified. Gaps between kerbs to be 1 to 2mm.
11. The sub-grade shall be prepared to falls to ensure that construction thickness' remain uniform, Following trimming of the sub-grade it shall be protected against the ingress of water, failure to do so will seriously weaken the sub-grade.
12. All soft spots shall be excavated and replaced with compacted sub-base material
13. The minimum total carriageway construction thickness shall not be less than 450mm.
14. All materials used in top 450mm of carriageway construction shall be non-frost susceptible.

P3	22/08/2023	Depth of DOT Type 3 subbase increased in and permeable paving	NN / MAS
P2	27/07/2023	Footpath surfacing specified	NN / DE
P1	18/04/2023	Issued for comments	NN / DE
Rev	Date	Description	By / Chk



PRP
consulting engineers & surveyors

Catherine House
Old Harborough Road
Brixworth, NN6 9BX

Telephone: 01604 889 870
northampton@prp.uk.com
www.prp.uk.com

Leicester
Northampton
London

engineering excellence | creating advantage

Client:

Statue Homes Ltd.

Architect:

Hickman & Smith Architects

Project:

Kyng's Golf & Country Club
Station Road, Nuneaton
CV13 0NP

Title:

External Works & Surfacing Plan
Construction Details

Status:

PRELIMINARY

Engineer:	NN	Date:	March 2023
Drawn:	NN	Scales @ A1:	
Checked:	DE	As Shown	
Project No:	82659	Drg No:	111
		Rev:	P3