
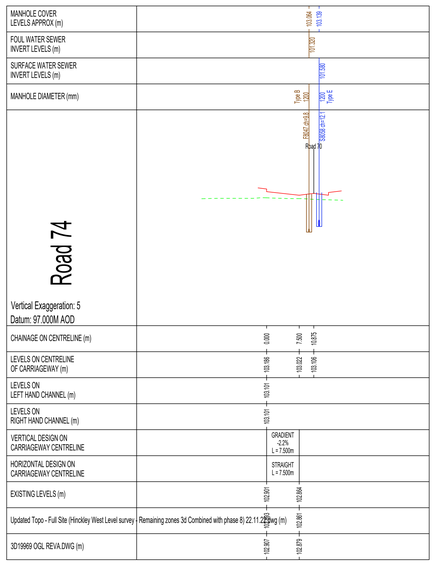


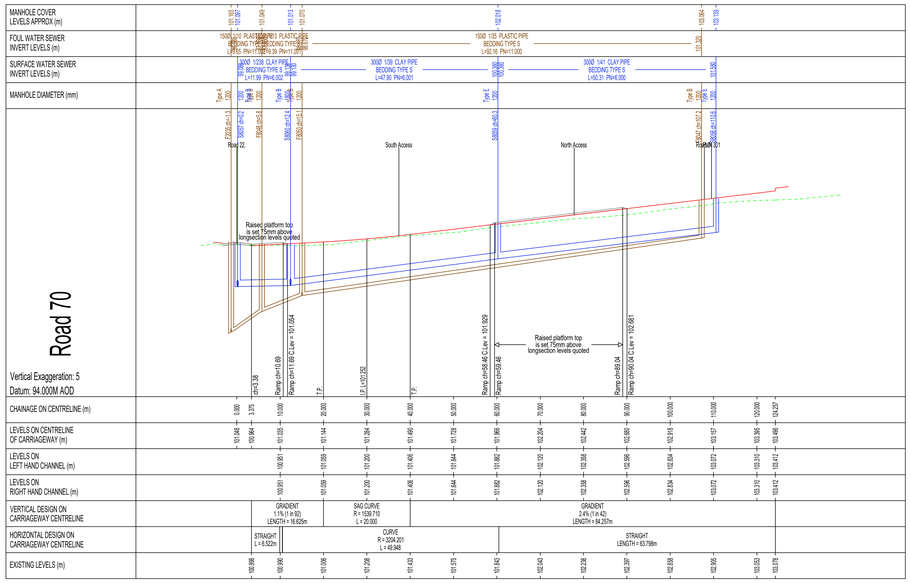

Notes.

1. Gravity sewers shall be constructed to the satisfaction of STW and in accordance with the W.S.A. publication "Sewers for Adoption", 6th Edition including STW Addendum.

2. At least one week prior to commencement of the drainage works, the contractor shall check the invert level of the existing sewers. if there are any discrepancies with the invert levels shown the engineer shall be contacted immediately.

3. All pipes shall be laid with soffits level, unless otherwise specified.

4. Tree / shrub planting adjacent to public (or prospective public) sewers shall conform to restrictions shown in Figure 2.3 of Sewers For Adoption 6th edition.

5. Redundant sewers to be dug out or grouted and manholes broken down and the void filled.

6. All pipes to be laid with class 'S' bed and surround unless stated otherwise.

7. All proposed manholes covers & frames at a minimum of 675mm x 675mm to maintain Clear opening and to comply with Severn Trent Water Ltd current Health and Safety standards.

8. No use of infill covers and frames in block paved areas..

9. Precast concrete manhole rings will not be cut under any circumstances. Other options, manhole built up with concrete or brickwork to the top of pipe.

NOTE:
Sewers are being constructed to Design and Construction Guidance or the 'Code'

Revision			
A	ROAD 71 REMOVED. RAISED TABLE ADDED ON 70	25.08.22	DS
B	Sections regenerated following new flitchett layout - already installed and no changes.	14.08.25	DS

Proposed Development at
Normandy Way
Hinckley

Road & sewer Profiles
PH7 (Sheet 5)

DATE: **25.10.21**
SCALE: **1:500 @ A0**
DRAWN: **DS**
CHECKED:

BLOOR HOMES

Drawing No. MI100-EN-706B