IF IN DOUBT ASK

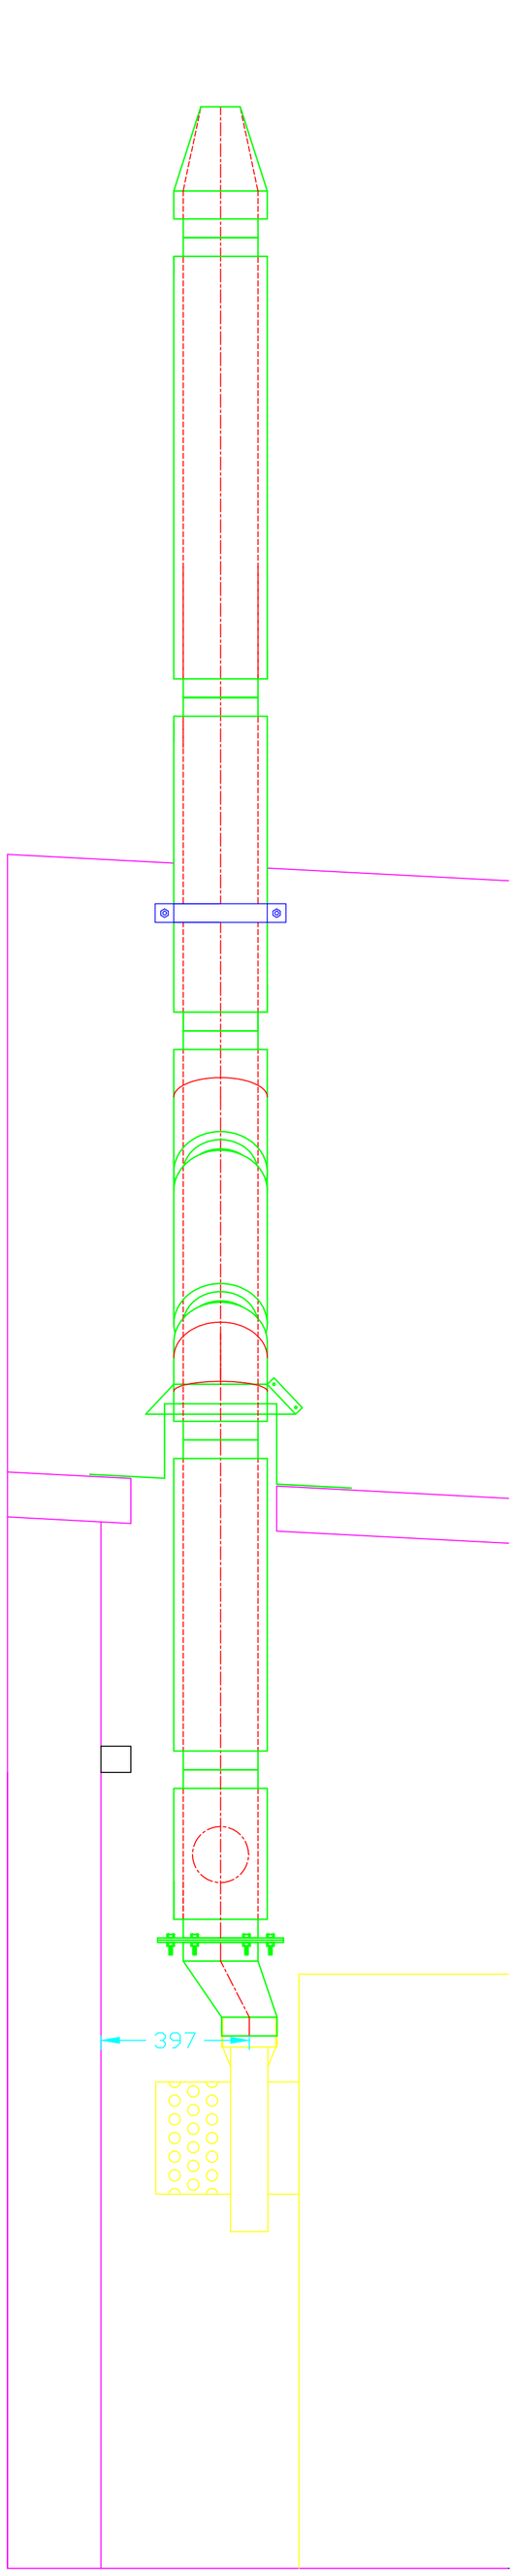

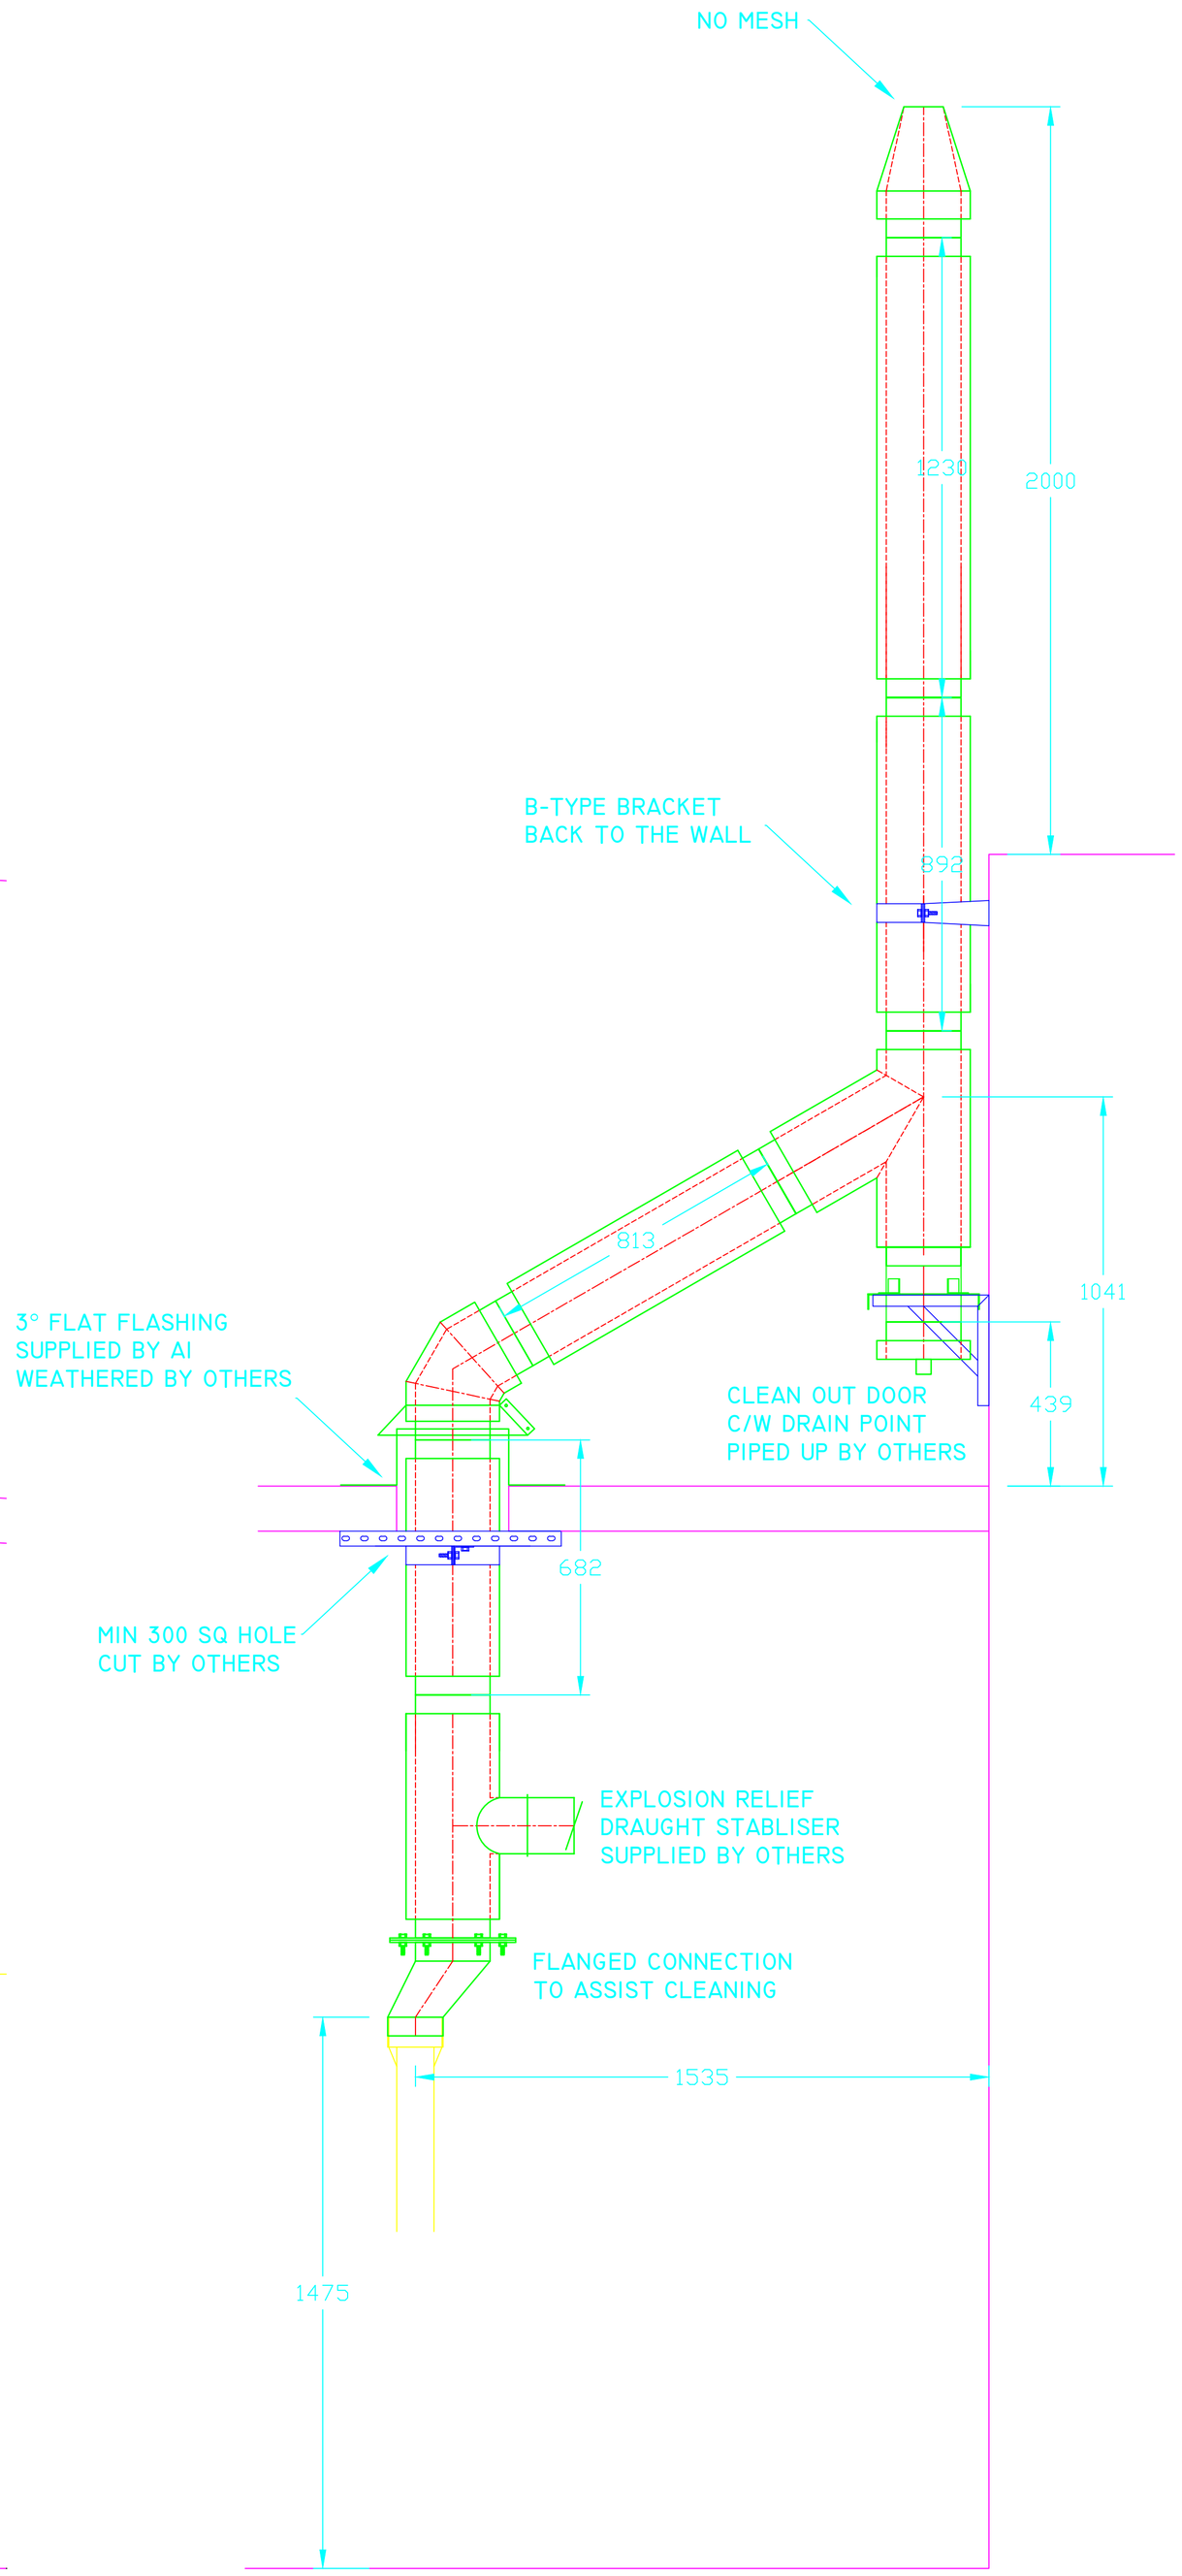

NOTES

The discharge height/position of all boiler flue systems (including fan dilution flue systems) and generator / C.H.P. exhaust systems must be approved by the relevant Local Authority Public Health Department as required under the current Clean Air Act and the associated Clean Air Act Memorandum. A1 Flue Systems are not responsible for obtaining this approval and have assumed that it has been obtained for this project. A1 Flue Systems, can if required, provide advice and assistance prior to your planning approval application.

Please advise us of any C.O.S.H.H. assessments including asbestos awareness particular to this contract.

Upon receipt of drawing approval, manufacture will proceed in accordance with the details & dimensions as set out on this drawing. It is the clients responsibility to ensure that the flue route zone is kept free from obstruction by other services and that installation access is available above. Please ensure that this drawing is issued to your services contractors.

Rev:	Date:	Details:
A	20.02.13	RE-ROUTE FLUE TO UTILISE EXISTING PENETRATION POINT.

CONTRACT EXCLUSIONS

All builders work - Internal/External

All scaffolding and/or access equipment over 3 metres in height to be supplied by the client at the time of installation.

All flashings to be supplied (where applicable) by A1 Flue Systems, roof openings and weathering by the clients roofing contractor at the time of installation. If storm collar is removed after our visit and found to leak at a later date, we shall not be held responsible.

A1 Flue Systems accept no responsibility for any services or fittings installed between our site survey and installations which obstruct the flue run, the supports or installation access.

A1 Flue Systems are not responsible for any electrical wiring to our installed equipment.

Any notes contained on this drawing concerning removal of pipes, cable trays etc. must be adhered to prior to our installation.

Pipework from drain points.

A1 FLUE SYSTEMS

Maun Way, Boughton Industrial Estate, Boughton
Newark, Nottingham NG22 9ZD.

Tel: +44(0)1623 860 578 Fax: +44(0)1623 835 548
e-mail: info@a1flues.co.uk

web: http:\\www.a1flues.co.uk

Client:
RURAL ENERGY.

Project:
PEAR TREE FARM
BUSINESS PARK
OFF DESFORD LANE
RATBY
LE6 0LE.

Title:
PROPOSED NEW FLUE SYSTEM

Material Specification:
D44i.

Drawn By: ALAN NICHOLS	Date: 20.02.13.
Scale: NTS	@ Horizontal A1 (Paper Size)
Drawing No: 72644.	Rev: A

This drawing remains the property of A1 Flue Systems. This drawing may NOT be reproduced, copied, lent, borrowed or sold without express permission of A1 Flue Systems.