


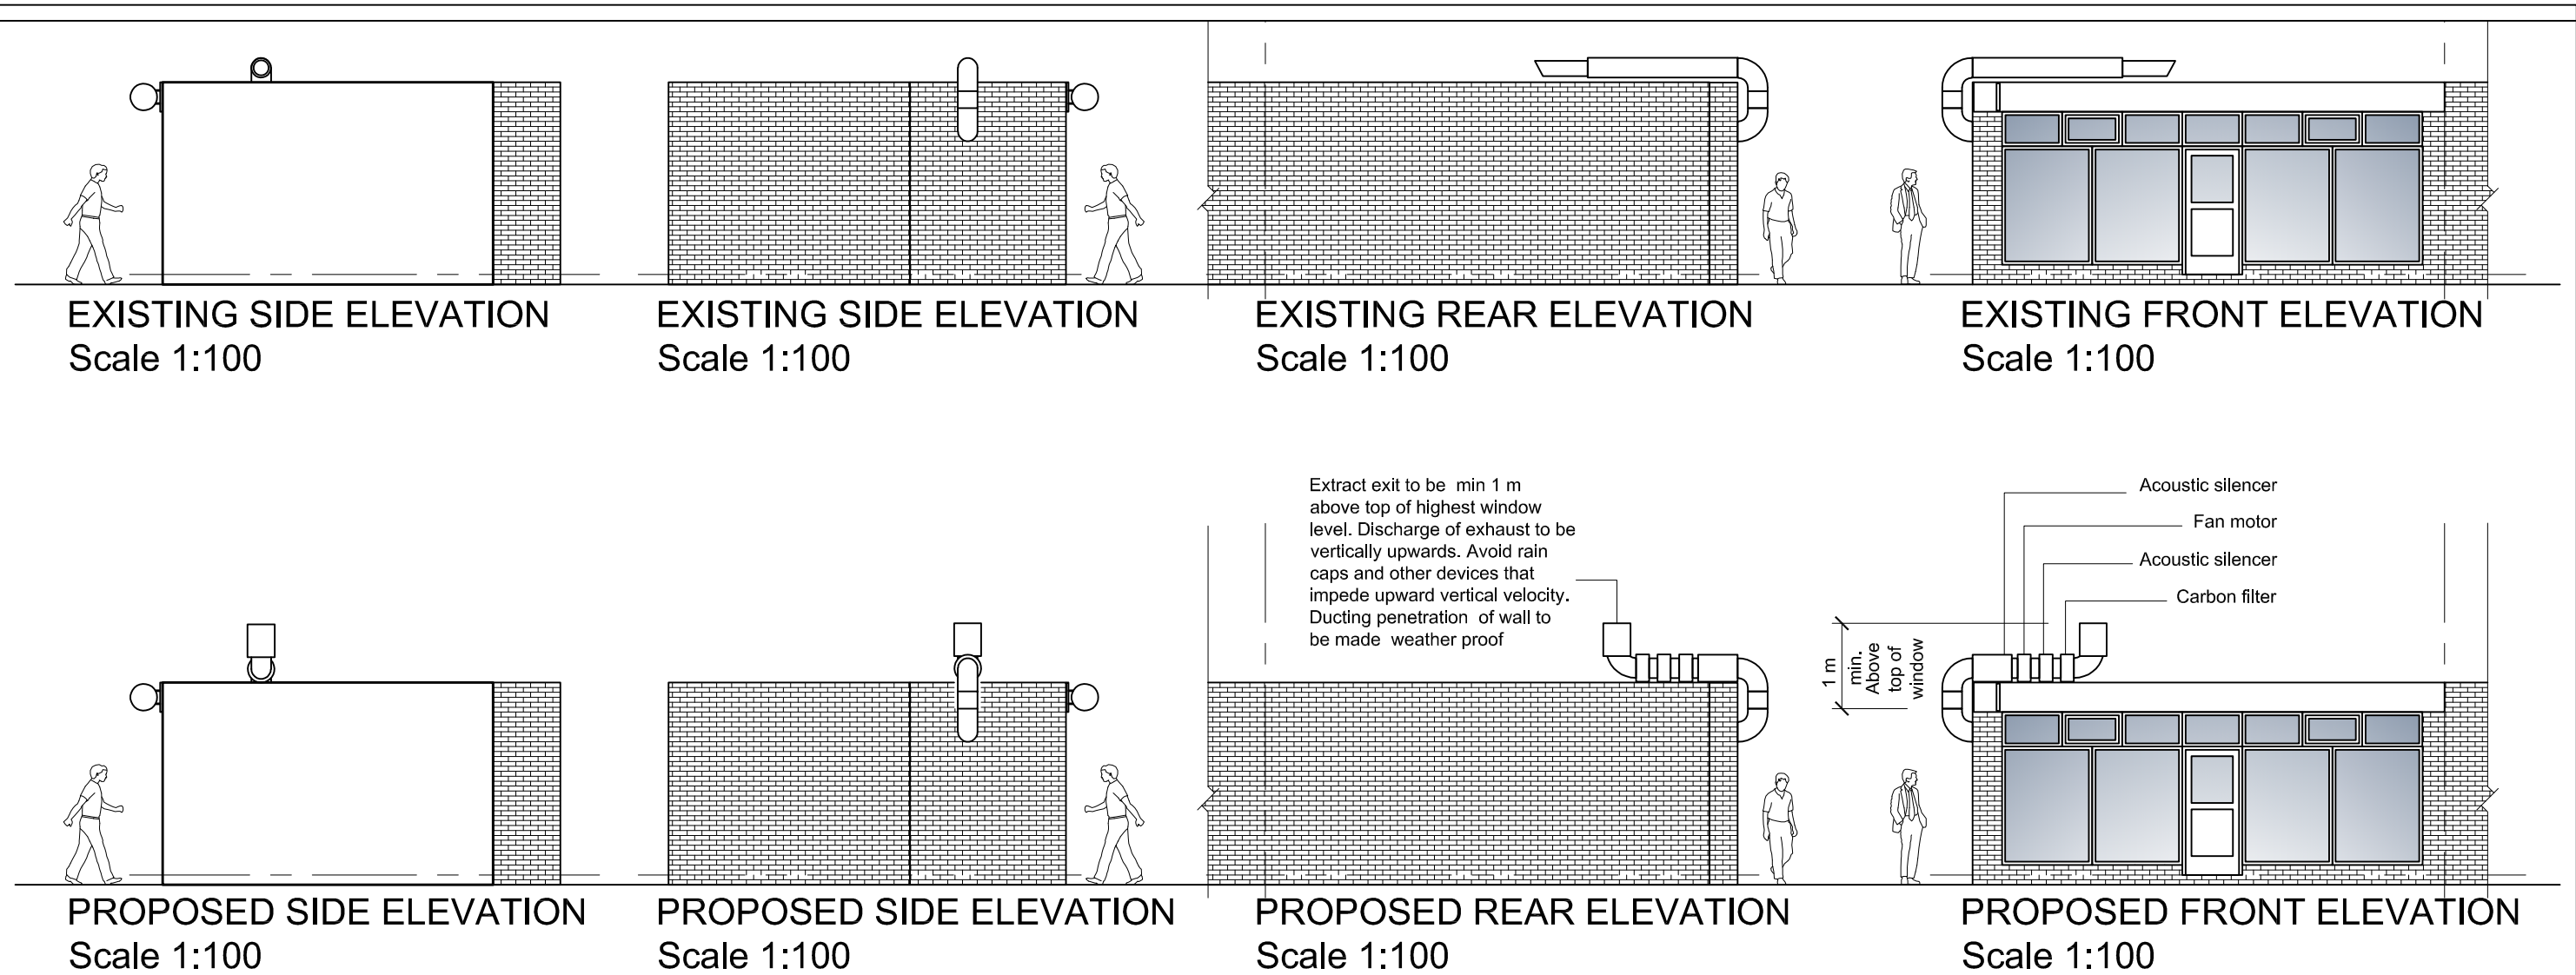

Extractor canopy manufactured from 430 grade stainless steel dull polished both sides, complete with 8 no. grease fileters. Canopy size 200 x 380 x 400 x 2400 L shaped.
Fan motor will be from Falkwoods size 560 mm long case.
2 no silencers size 560 mm x 600 long each
Fan will also be connected to
- Gas Interlock system
- Carbon filter to reduce smoke and fumes
- Anti- vibration system
The part of the exhaust ducting one the exterior of the premises will be constructed from galvanised , rust- proof steel
240 volt- 1420 rpm
Sound level 56 dba when monitored at 3 meters
The attnuator we use, before and after fan. This would reduce the dba level by 10 dba to the canopy side and 19 dba to extraction side, thus producing 33 dba when mounted at 3 m form the fan

- Maintenance of Ventilation System:**
- Good maintenance is required by the food hygiene regulations and will also minimise the risk of fire. The recommended cleaning period for extract ductwork is:
- Heavy Use 12-16 Hours Per Day: 3 Monthly
 - Moderate Use 6-12 Hours Per Day 6 Monthly
 - Light Use 2-6 Hours Per Day
- Annually Recommendations for maintenance of odour control system include: System employing fine filtration and carbon filtration.
- Change fine filters every two weeks.
 - Change carbon filters every 4 to 6 months.
 - Use a system employing ESP and other in line abatement. Clean every 2-6 months

Change of Use from Sandwich Shop (Class E) to Hot Food Takeaway
4 Arnold's Crescent, Newbold Verdon, Lecestershire LE9 9LD

PARTY WALL ACT 1996 (NOTE FOR CLIENT/ OWNER):
ALL BOUNDARY POSITIONS ARE ASSUMED AS PER CLIENT'S INSTRUCTIONS AND CONTRACTOR TO AGREE EXACT BOUNDARY POSITIONS WITH CLIENT/ OWNER, PRIOR TO COMMENCEMENT OF WORKS. THE ORKS MAY FALL WITHIN THE PARTY WALL ACT AND CLIENT IS REQUIRED TO WRITE THE NEIGHBOURS AFFECTED BY THESE WORKS AND SEEK WRITTEN CONSENT PRIOR TO COMMENCEMENT OF WORKS. IN CASE OF ANY OBJECTION FROM THE ADJOINING PROPERTY OWNERS, CLIENT IS ADVISED TO CONTACT SPECIALIST PARTY WALL SURVEYORS.
LOCAL AUTHORITY NOTES:
CONTRACTOR, WHERE APPLICABLE, TO ENSURE HE COMPLIES WITH ALL CONDITIONS OUTLINED THE PLANNING APPROVAL NOTICE. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO OBTAIN WRITTEN APPROVALS FOR ALL FACING MATERIALS FROM THE PLANNING DEPARTMENT.
ALL WORK TO COMPLY WITH BUILDING REGULATIONS AND ALL STATUTORY AUTHORITIES REQUIREMENTS.
THIS DRAWING IS NOT, ON ITS OWN, A GUARANTEE OF LOCAL AUTHORITY APPROVALS. IF CLIENT CHOOSES TO EXECUTE THIS DRAWING PRIOR TO LOCAL AUTHORITY APPROVALS BEING ISSUED, THIS IS DONE AT THE CLIENT'S RISK.

Drwg Number
2109.102

Elevations
Scale 1:100

SPECTRUM

SPECTRUM MANAGEMENT
& SERVICES LTD
84 PALACE ROAD
BIRMINGHAM B5 9ER
TEL: 0121 659 1510

