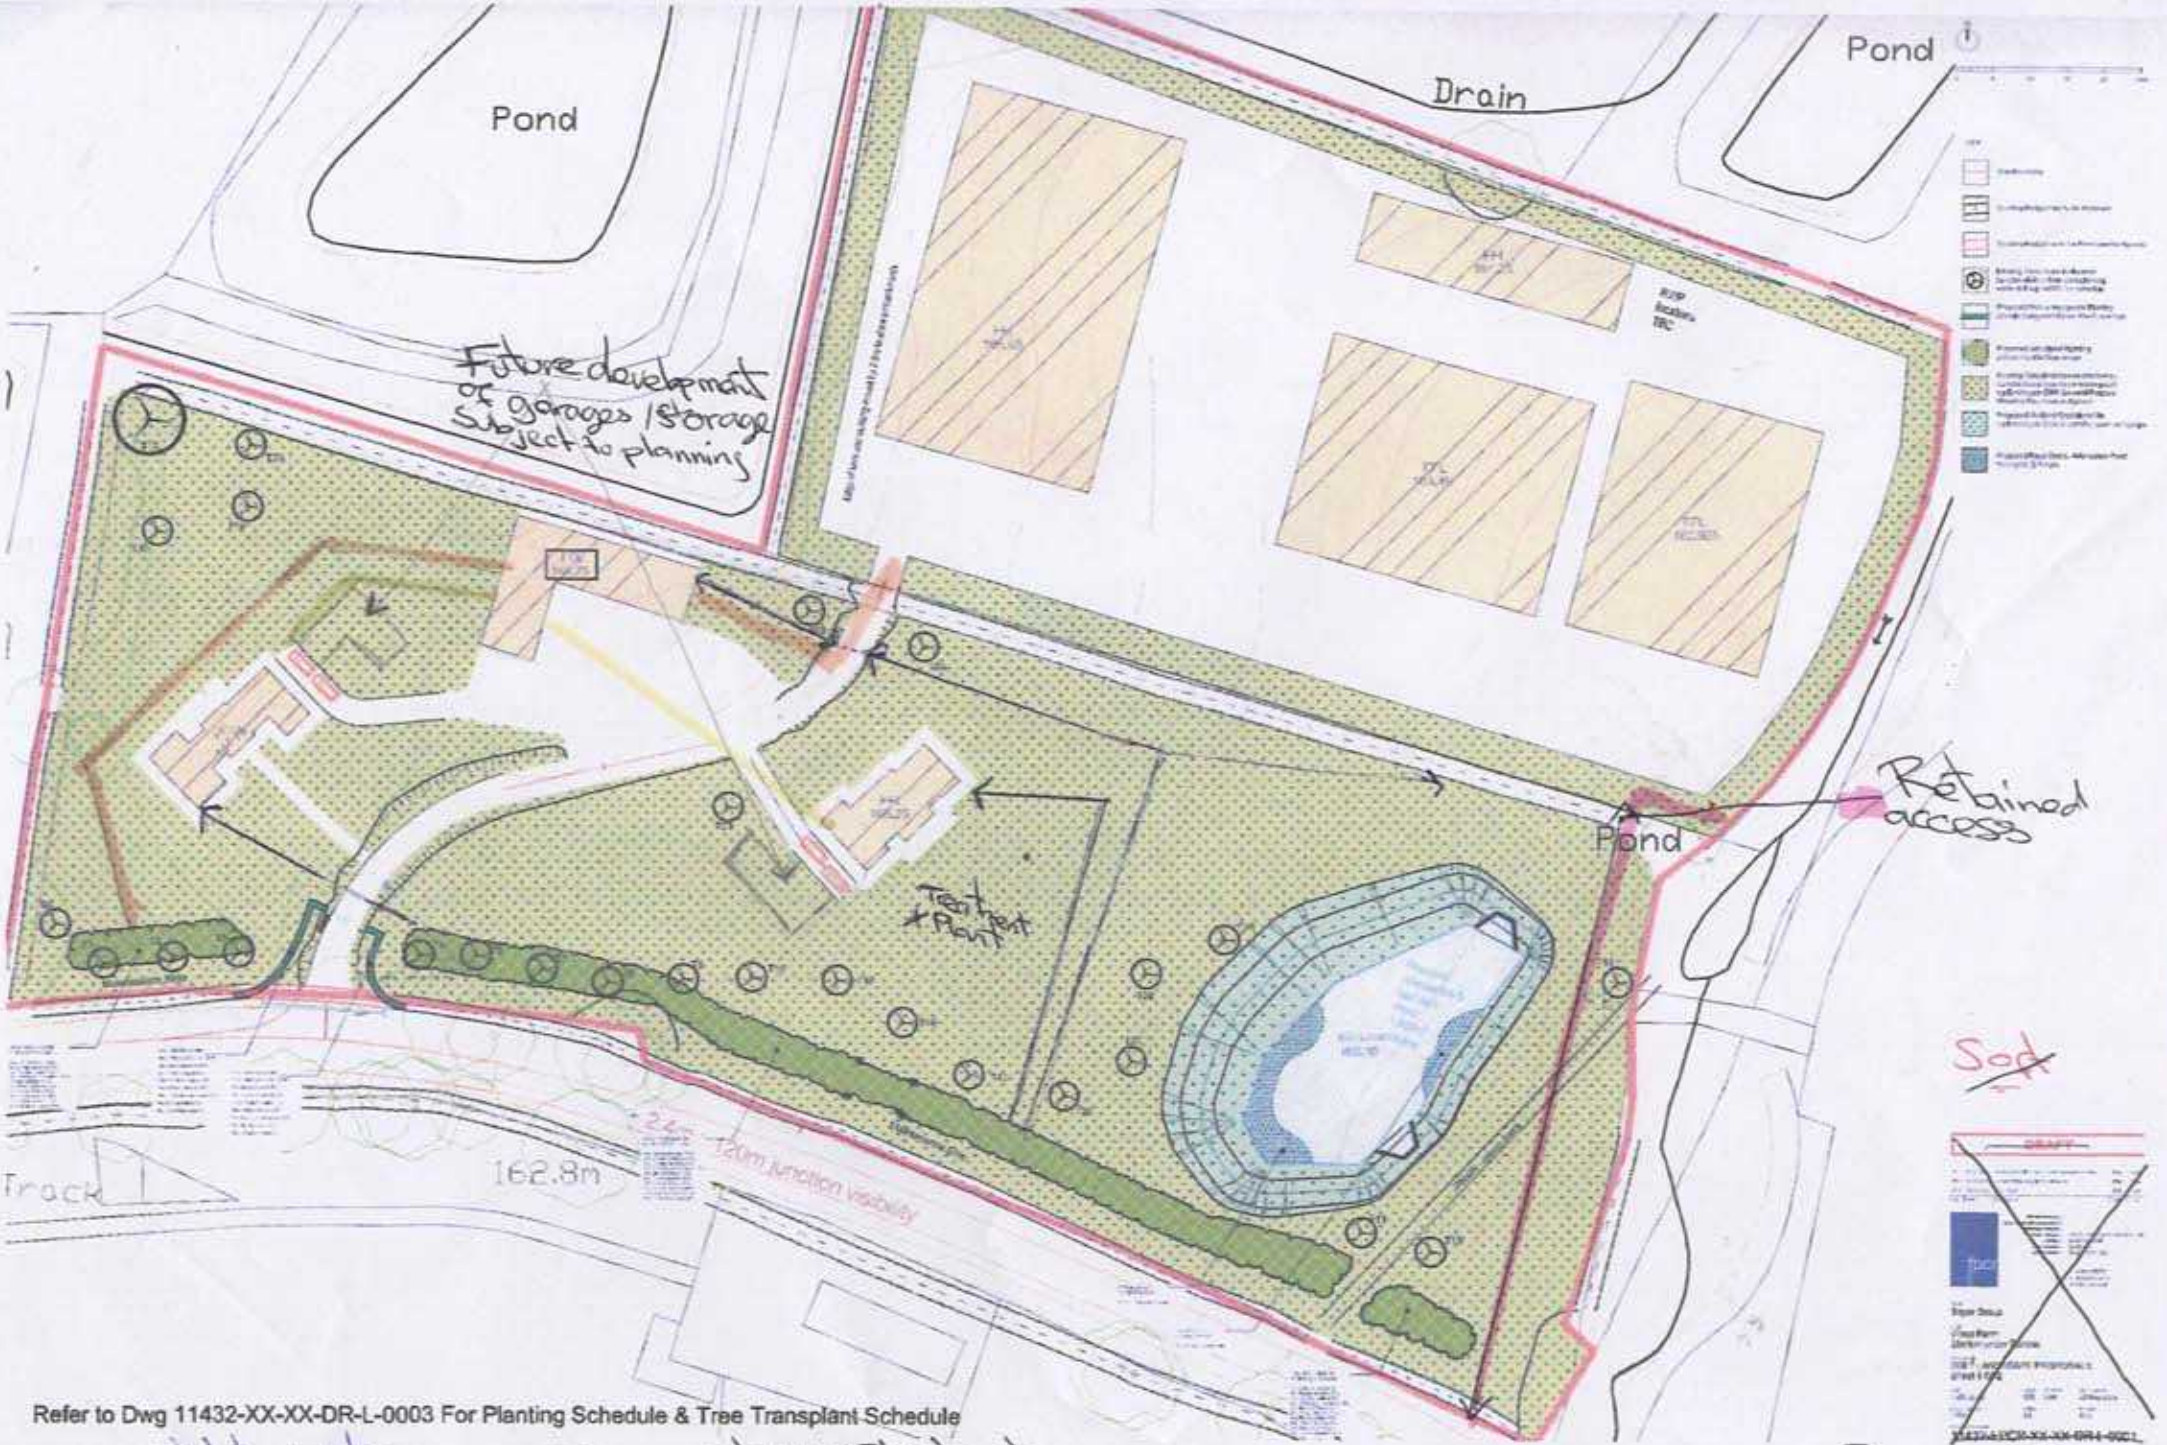

Pond
Drain
Pond
Future development of garages / storage subject to planning
Retained access
Pond
Treatment Plant
Track
162.8m
120m Junction visibility
Refer to Dwg 11432-XX-XX-DR-L-0003 For Planting Schedule & Tree Transplant Schedule
Utility water
Three - phase Electricity
Single - Phase Electricity
Telecommunication yet to be shown
Sod
Suggestive layout utilities