Low Operating Noise Levels

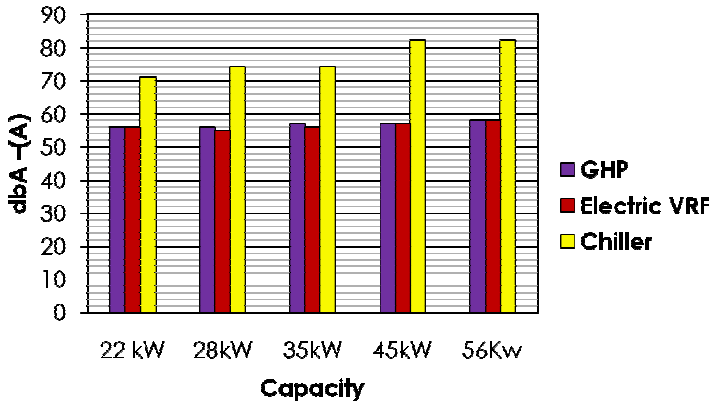

Sound data dB (A) at 1.5 m

NOX Emissions

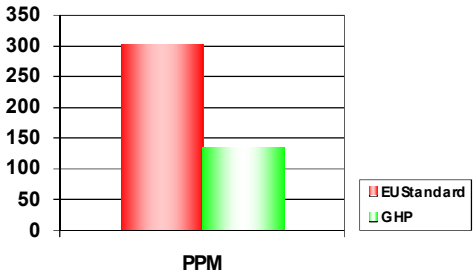



N0X emissions (66% below EU standard)

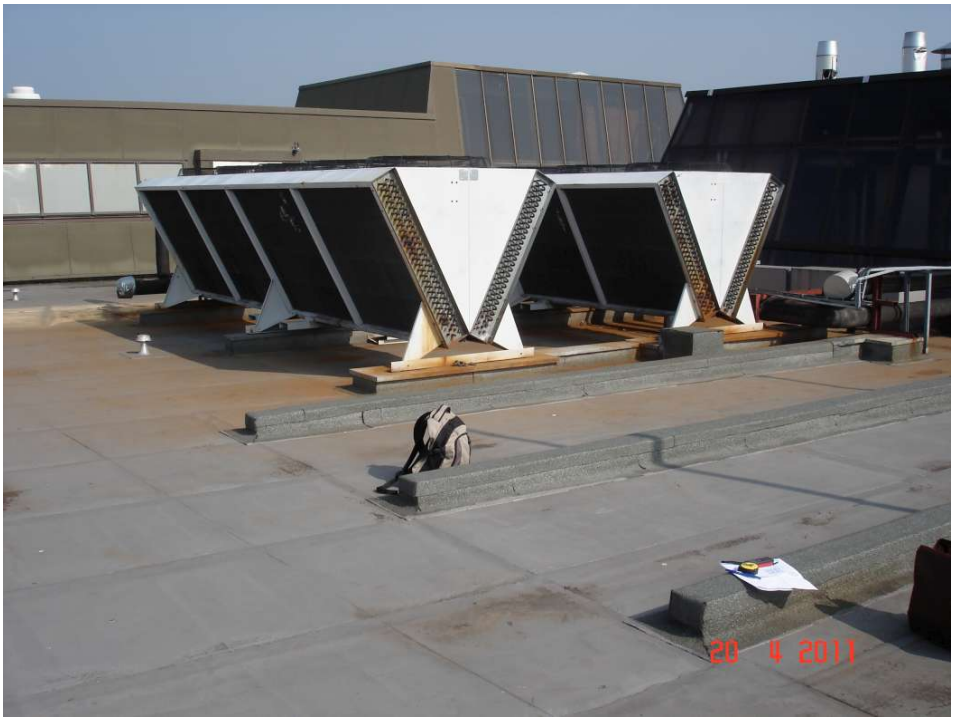

Leaking Dry Bed Coolers to be Removed



400 kW Electric Chiller to be Removed from Ground Floor Plant Room



New Roof Installation