



GEO-ENVIRONMENTAL CONSULTING

BEK Geo-Environmental Consulting

No.2 Landwick Court, Metcalf Drive, Altham Business Park,
Lancashire BB5 5TU

mbuckley@bekenviro.co.uk

bekenviro.co.uk

01254 377622

Project Quality Assurance Information Sheet

Site	Land south of Watling Street, Hinckley
Report Title	Site Investigation & Ground Assessment
Report Status	Final
Report No	BEK-23005-1 (Rev D)
Date	March 2024
Prepared For	CNG FUELS 16 Berkeley Street London W1J 8DZ
Prepared By	BEK ENVIRO LIMITED Suite One No 3 Mitton Road Business Park Mitton Road Whalley Lancashire BB7 9YE
Author(s)	James Mashiter BSc (Hons) MSc
Checked	David Emmott BSc (Hons) MSc MEnvSci CEnv
Authorised	Michael Buckley BSc (Hons) MSc MEnvSci CEnv
Contact	mbuckley@bekenviro.co.uk www.bekenviro.co.uk Office: 01254 377622 Mobile: 07906753583

LAND SOUTH OF WATLING STREET, HINCKLEY

Site Investigation & Ground Assessment

PROJECT NO: 23005

REPORT REF: BEK-23005-1 (Rev D)

DATE: March 2024

REVISION STATUS / HISTORY

Rev	Date	Issue / Comment	Prepared	Checked
A	24/02/2023	Minor Mods	D Emmott	J Mashiter
B	12/04/2023	Minor Amendments	MLM	MB
C	01/05/2023	Mods to site boundary/layout figures	A Hope	MB
D	07/03/2024	Minor proposed layout changes	JM	MB

GENERAL REPORT LIMITATIONS

BEK Enviro Limited (BEK) has prepared this report for the sole use of the client, showing reasonable skill and care, for the intended purposes as stated in the agreement under which this work was completed. The report may not be relied upon by any other party without the express agreement of the client and BEK. No other warranty, expressed or implied, is made as to the professional advice included in this report.

Where any data supplied by the client or from other sources have been used, it has been assumed that the information is correct. No responsibility can be accepted by BEK for inaccuracies in the data supplied by any other party. The conclusions and recommendations in this report are based on the assumption that all relevant information has been supplied by those bodies from whom it was requested.

No part of this report may be copied or duplicated without the express permission of BEK and the party for whom it was prepared. Where field investigations have been carried out, these have been restricted to a level of detail required to achieve the stated objectives of the work.

Unless explicitly agreed otherwise, in writing, this report has been prepared under BEK's limited standard Terms and Conditions as included within our proposal to the Client.

The report needs to be considered in the light of the BEK proposal and associated limitations of scope. The report needs to be read in full and isolated sections cannot be used without full reference to other elements of the report and any previous works referenced within the report.

TABLE OF CONTENTS

1.	INTRODUCTION
1.1	Appointment
1.2	Proposed Development
1.3	Objective & Scope of Work
1.4	Limitations
2.	BACKGROUND INFORMATION
2.1	Site Location & History
2.2	Environmental Setting
2.3	Potentially Significant Pollutant Linkages
3.	SITE INVESTIGATION
3.1	General
3.2	Window Sample Boreholes
3.3	Soakaway Testing
3.4	Exploratory Locations Rationale
3.5	Laboratory Testing
3.6	Ground Conditions
3.7	In-Situ Strength Testing
4.	QUANTITATIVE RISK ASSESSMENT
4.1	Potentially Significant Pollutant Linkages
4.2	Risk Assessment: Human Health Risks from Exposure to Contaminated Soil
4.3	Risk Assessment: Controlled Waters
4.4	Risk Assessment: Buildings
4.5	Risk Assessment: Conclusions
5.	GEOTECHNICAL ASSESSMENT
6.	RECOMMENDATIONS

APPENDICES	
Appendix A	Exploratory Logs
Appendix B	Chemical Test Results
Appendix C	Geotechnical Test Results
Appendix D	Drawings

DRAWINGS	
BEK Drawing No 23005-1	Site Location
BEK Drawing No 23005-2	Site Layout
BEK Drawing No 23005-3	Borehole Location Plan
CNG Fuels drawing 'Proposed CNG Station Site Layout Plan' (Ref: 042-01-CNG-104, Rev J, Dated:11/10/2022)	

1. INTRODUCTION

1.1 Appointment

1.1.1 BEK Enviro (BEK) has been commissioned by CNG Fuels to carry out a site investigation for land south of Watling Street, Hinckley (hereafter referred to as 'the site'). The investigation will inform a quantitative risk assessment with respect to contamination at the site to support the proposed commercial development, and provide recommendations for foundation design.

1.1.2 The site location and site layout are presented on BEK Drawing No 23005-1 and BEK Drawing No 23005-2, respectively. Copies of these drawings are presented in Appendix D.

1.2 Proposed Development

1.2.1 The report has been prepared to support a planning application for the construction of a biomethane gas vehicle fuelling facility comprising 12 fuelling islands. Infrastructure including gas storage banks, compressors and backup generator are proposed to be located on the eastern boundary. The site will be predominantly hard surfaced, however, landscaping will be added on raised islands between the site and the A5 and on the northern boundary.

1.2.2 A sketch of the proposed site plan is provided on CNG Fuels drawing 'Proposed CNG Station Site Layout Plan', a copy of which is presented in Appendix D. An extract from that drawing is presented in Figure 1:

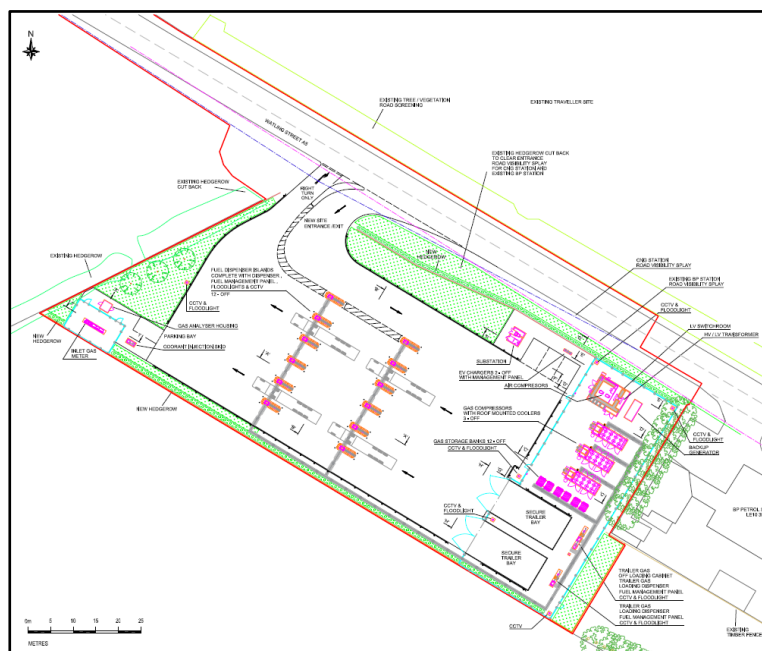


Figure 1: Site Layout Plan

1.3 Objective & Scope of Work

- 1.3.1 The site investigation was undertaken by BEK during January 2023 in accordance with the recommendations detailed in the Preliminary Risk Assessment (PRA) prepared by Thomas Consulting (Report Ref: TC/P9299/22/01, dated December 2022).
- 1.3.2 This report has been prepared to provide a summary of the site details and ground conditions encountered as well as a quantitative assessment of the potential pollutant linkages identified within the PRA. The PRA should be read in conjunction with this report.

1.4 Limitations

- 1.4.1 The conclusions and recommendations presented in this report are the result of our professional interpretation of the information currently available. BEK reserve the right to amend the conclusions and recommendations if further information becomes available.
- 1.4.2 However, it should be noted that much of the information has been derived from reports written by others and BEK takes no responsibility for the accuracy of that information. Notwithstanding the above, the reports reviewed have all been written by professional environmental consultants with a duty of care to provide relevant and accurate information.
- 1.4.3 The comments given in this report and the opinions expressed are based on review of reports provided to BEK, ground conditions encountered during site works and the results of tests made in the field and in the laboratory. However, there may be conditions pertaining to the site that have not been disclosed by the investigations and therefore could not be taken into account.
- 1.4.4 Issues associated with invasive plant species are outside the remit of this report.

2. BACKGROUND INFORMATION

2.0.1 This section provides an overview of the findings and recommendations presented in the PRA.

2.1 Site Location & History

2.1.1 The site is located on the A5 approximately 2.6 km south-west of Hinckley and 760 m south-west of the A5/A47 junction. The grid reference is 440080 292977. Surrounding the site is predominantly agricultural fields to the south and industrial/warehouses to the north. Immediately to the east is a petrol filling station, served by separate access from the A5. An industrial estate containing an electrical substation and infrastructure for the National Grid is located further east of the petrol station.

2.1.2 The site currently forms part of a wider greenfield plot currently comprising flat grassland that is understood to be used for grazing.

2.1.3 The site is shown within Figure 2 below.

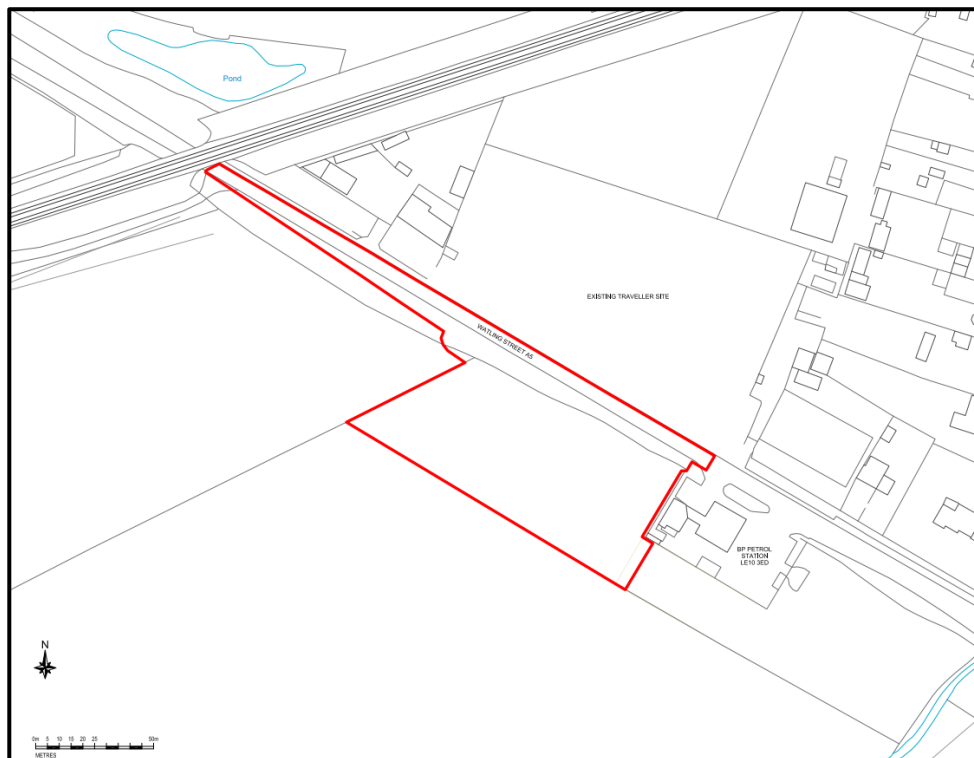


Figure 2: Site Boundary (Red) and Surrounding Area

Site History

2.1.4 Based on the available historical maps the site has been vacant from 1886 to present day with the garage located east of the site visible from circa 1958.

2.2 Environmental Setting

Geology

- 2.2.1 According to the Enviro+GeoInsight Report, there are no made ground deposits on site.
- 2.2.2 The Enviro+GeoInsight Report indicates that states that the site is overlain with alluvium comprised of sand with clay and gravel. The bedrock geology underlying the site is comprised of Mercia Mudstone – sandstones, mudstones and evaporites.
- 2.2.3 There are no faults or linear features located on site or within 250 m of the site.

Mining and Ground Stability

- 2.2.4 Information in the Enviro+GeoInsight Report states that the site is not located within a coal mining area.
- 2.2.5 The Enviro+GeoInsight Report provides hazard ratings associated with ground subsidence at the site, as summarised below:
- | | |
|--------------------------------------|------------|
| Shrink-Swell Clay: | Very Low |
| Landslides: | Very Low |
| Ground Dissolution of Soluble Rocks: | Negligible |
| Compressible Deposits: | Moderate |
| Collapsible Deposits: | Negligible |
| Running Sands: | Low |
- 2.2.6 It can be seen from the above that the site is unlikely to be affected by natural ground instability with the exception of compressibility and uneven settlement hazards present in the across the site.

Hydrogeology

- 2.2.7 The superficial strata is classified as a 'Secondary A' aquifer with the bedrock strata is classified as a 'Secondary B' aquifer.

Hydrology

- 2.2.8 The nearest surface water feature to the site is Sketchley Brook which is located some 160 m east and south of the proposed development and flows in a south-westerly direction.
- 2.2.9 There are no surface water abstractions located within 250 m of the site.

- 2.2.10 Three historic discharges are identified into Sketchley Brook, upstream of the proposed development. These consist of trade and sewage discharges. No existing consents are recorded.

Contaminated Land and Landfill Activities

- 2.2.11 There are no historic or recent landfills located within 250 m of the site.
- 2.2.12 Five historical waste sites within 250 m of the proposed development are identified using LPA records by the Enviro+GeoInsight Report consisting of scrap yards and waste transfer stations.
- 2.2.13 Two historical pollution incidents have been recorded within 250 m of the site located some 145 m south-east and 209 m north-west of the site dating from 2002 and 2003 respectively. Both were classified as Category 3 impact on water (Minor) and Category 4 (No impact) on land and air.
- 2.2.14 There have been no List 1 & 2 dangerous substance releases and no radioactive incidents occurring within 250 m of the site.
- 2.2.15 No records of Part A(1) installations are recorded within 250 m of the site. The petrol station immediately east of the proposed CNG site is recorded under Part B of the Environmental Permitting Regulations.

Sensitive Land Use

- 2.2.16 The site is a nitrate vulnerable zone designated across the site and borders the Birmingham Green Belt area. The proposed development is located within an SSSI Impact Risk Zone. However, it does not fall under the types of developments requiring consultation with respect to the associated SSSI.

Radon

- 2.2.17 It is estimated that less than 1% of dwellings in close proximity of the site are exceeding the Radon Action Level. As such no radon protection measures are required.

2.3 Potentially Significant Pollutant Linkages

- 2.3.1 A number of possible 'significant pollutant linkages' have been identified associated with the site:

Link 1 – Surface runoff of contaminants from HGV's from impermeable area, towards agricultural land. A potential source of contamination is identified for spillage of fuels and oils from HGV's. Surface runoff shall be contained by the drainage network during normal operation of the site. This is more likely to occur

during construction works, before the drainage is in place. Any exceedance off the site shall flow towards Grade 3 agricultural land southwest of the site.

This receptor has a low sensitivity and the impact of any linkage is likely to be low. Therefore, this linkage is considered insignificant and requires no further investigation.

Link 2 – Surface waters exceeding the impermeable site and infiltration to groundwater. A potential source of contamination is identified for spillage of fuels and oils from HGV's. Any exceedance from the site could enter the groundwater. This is more likely to occur during construction works, before the drainage is in place.

As stated in the section above, pollutant linkages transporting contamination offsite are not significant. The superficial strata is estimated to have very low to high permeability, so further investigation should be completed to assess this. Superficial strata and bedrock aquifers are deemed to have a low sensitivity. Very limited quantities of pollutant are expected to reach the aquifer and will have a low impact. Therefore, this potential linkage is considered insignificant and no further investigation is necessary.

Link 3 – Inhalation / Ingestion of contaminated soils and dusts by construction workers. The site currently consists of open pasture land, where potential pollution from past fertiliser is identified. Soils and dusts will be mobilised during construction works by excavations and vehicle movements. Contractors working on the site may inhale smaller particles or ingest larger particles after hand to mouth contact.

The quantity of contamination present in the ground, however minimal quantities are likely to reach the receptor. As a result, the sensitivity and impact on the receptor to any exposure is considered low, this linkage is also considered insignificant.

- 2.3.2 Notwithstanding the above, Thomas Consulting recommend that site investigation works are carried out to confirm shallow ground conditions are as expected and to recovery additional information to support a full geo-environmental assessment including soakaway testing to inform surface water drainage options.

3. SITE INVESTIGATION

3.1 General

3.1.1 This section provides a summary of the site investigation works undertaken by BEK during January 2023.

3.1.2 The site investigation has been designed to provide indicative information for the ground conditions across the site and to provide a quantitative assessment of potential risks associated with contamination and to provide recommendations with respect to foundation design.

3.1.3 All exploration locations were set out by the site engineer and the exploratory locations are illustrated on BEK Drawing No 23005-3 presented in Appendix D.

3.2 Window Sample Boreholes

3.2.1 Seven window sample boreholes were drilled using a window sample borehole rig to a maximum depth of 5.45 m. Borehole locations were set out by the site engineer in order to establish representative conditions at the site. In-situ testing (SPTs) were carried out in each of the boreholes.

3.2.2 Representative samples were recovered for chemical testing in accordance with the potential contaminants of concern highlighted within the PRA.

3.2.3 The ground conditions were recorded by an engineer from BEK and copies of the borehole records are presented in Appendix A.

3.3 Soakaway Testing

3.3.1 Soakaway testing (to BRE365) was carried out at 2 locations to determine percolation rate and the possible use of soakaways for surface water drainage.

3.3.2 BEK can confirm that the percolation rate of the shallow strata does not support the use of soakaways at this site. A separate Soakaway Letter report will be prepared detailing this work and the conclusions.

3.4 Exploratory Locations Rationale

3.4.1 The site investigation was designed by BEK to confirm general ground conditions across the site.

3.5 Laboratory Testing

Soil Chemical Testing

3.5.1 Chemical laboratory testing was undertaken by the UKAS accredited laboratory of Envirolab. All testing was undertaken to MCERTS standard (where available). The following samples were submitted for chemical analysis:

- Eight samples were tested for the standard BEK soil suite which includes: Arsenic (Total), Cadmium (Total), Copper (Total), Lead (Total), Nickel (Total), Zinc (Total), Chromium (Total), Selenium (Total), Mercury (Total), Boron (Soluble), Hexavalent Chromium, Cyanide (Total), pH, 16 EPA Poly-Aromatic Hydrocarbons (PAH), Total Phenols, Sulphate (acid soluble), Sulphate 2:1 extract and Soil Organic Matter
- Eight samples were tested for Speciated Total Petroleum Hydrocarbons (TPH-CWG)
- Three samples were subjected to BRE Sulphate Suite
- Three samples were subjected to WAC testing
- Eight samples were subjected to Asbestos ID testing.

3.5.2 Copies of the chemical test results are presented in Appendix B.

Geotechnical Testing

3.5.3 Following a review of ground conditions, three natural clay bulk samples were submitted to the UKAS accredited laboratory of Murray Rix and were tested for Plasticity Index and Moisture Content.

- Three samples were subjected to Plasticity index Moisture content.

3.5.4 Copies of the geotechnical test results are presented in Appendix C.

3.6 Ground Conditions

3.6.1 Topsoil was identified in every exploratory location at the site ranging in depth from 0.3 m (Window Sample Borehole WS6) to 0.4 m (Window Sample Borehole WS1, WS2, WS3, WS4, WS5 and WS7). The topsoil was generally homogenous across the site and could be identified as the following:

‘Soft dark brown very sandy silty organic clay with frequent rootlets and rare flint (Topsoil)’

- 3.6.2 Natural strata underlying the topsoil was generally comprised of 'Stiff becoming very stiff fine brown slightly silty clay.
- 3.6.3 The bedrock was not encountered during the site investigation.
- 3.6.4 Groundwater was not encountered during the site investigation works with the exception of Borehole Window Samples WS3 however it is noted that Window Sample Borehole WS7 was wet at ground level. The groundwater encountered at Window Sample Borehole WS3 was described as slight water strike at a depth of 2 m below ground level.
- 3.6.5 There was no visual/olfactory evidence for the presence of contamination identified during the intrusive site investigation.

3.7 In-situ Strength Testing

- 3.7.1 SPTs were carried out in all boreholes progressively as drilling was undertaken. The SPT results are presented on the drilling records (Appendix A) and are summarised below:

	SPT Readings (N)				
	1.0 – 1.45 m	2.0 – 2.45 m	3.0 – 3.45 m	4.0 – 4.45 m	5.0 – 5.45 m
WS1	13	15	20	22	-
WS2	14	19	21	20	-
WS3	14	16	19	21	-
WS4	14	16	19	21	22
WS5	13	18	18	20	22
WS6	8	12	15	20	23
WS7	9	14	16	16	20

Table 2: Summary of SPT Results for Window Sample Boreholes

4. QUANTITATIVE RISK ASSESSMENT

4.1 Potentially Significant Pollutant Linkages

4.1.1 Potentially significant pollutant linkages identified within the preliminary conceptual model include:

- (i) Human Health – risks associated with contamination in the made ground and/or natural strata: via direct contact, ingestion of contaminated soils or via inhalation (asbestos and/or vapours)
- (ii) Controlled Waters - risks associated with contamination in the made ground and/or natural strata affecting the quality of perched water. Risks are associated with dissolution of contamination into perched water and vertical/lateral migration to water receptors including the superficial and bedrock Aquifers.
- (iii) Property (including services, flora and concrete) – risks associated with contamination affecting agricultural land.

4.2 Risk Assessment: Human Health Risks from Exposure to Contaminated Soil

4.2.1 The risks to human health have been assessed by inspection of shallow soils for the presence of elevated contaminants based on the expected contaminant findings detailed in the conceptual model and completion of a quantitative risk assessment.

4.2.2 The soil contamination concentrations have initially been compared to a range of generic assessment criteria. These include the use of the Land Quality Management and Chartered Institute of Environmental Health assessment criteria (S4ULs), Category 4 Screening Levels (C4SLs) and the Contaminated Land: Applications in Real Environments assessment criteria (CL:AIRE).

4.2.3 These assessment criteria have been derived using the CLEA model and fully justified input parameters to be protective of risks to human health considering a commercial end use. The initial assessment assumes a soil organic matter (SOM) of 1 % as a conservative approach.

4.2.4 The following table summarises the chemical test results for the samples tested and lists the relevant assessment criteria and the samples with a concentration in excess of the assessment criteria. Note that only determinands with a concentration above the laboratory limit of detection are presented in the table below:

Determinand	Range of Concentrations (mg/kg)	Assessment Criteria (mg/kg)	Samples Fail
Arsenic	3 – 9	640 ¹	---
Boron	<1.0 – 2.7	240000 ¹	---
Cadmium	1.2 – 1.6	190 ¹	---
Chromium	45 – 105	68000 ¹	---
Copper	20 – 35	8600 ¹	---
Lead	15 – 57	6000 ²	---
Nickel	21 – 36	1100 ¹	---
Zinc	62 – 124	730000 ¹	---
Mercury	<0.17 – 1.46	1100 ¹	---
Nickel	21 – 36	980 ¹	---
Zinc	62 – 124	730000 ¹	---
Aliphatic Hydrocarbons >C21-C35	<1 – 18	1600000 ¹	---
Aromatic Hydrocarbons >C16-C21	<1 – 3	28000 ¹	---
Aromatic Hydrocarbons >C21-C35	<1 – 4	28000 ¹	---
Asbestos ID	0 of 8 samples	NAD	---

Table 3: Summary of Contamination Assessment

Notes from Table

1 CIEH/LQM Derived Assessment Criteria (S4ULs based on 1% SOM)

2 Category 4 Screening Level

NAD - No Asbestos Detected

4.2.5 It can be seen from the above table that there are no elevated contaminants of concern above the commercial assessment criteria within any of the samples tested.

4.2.6 Moreover, none of the samples tested proved positive with respect to the presence of asbestos.

4.3 Risk Assessment: Controlled Waters

4.3.1 Potential risks to the quality of surface water and groundwater have been identified in the ground conceptual model.

4.3.2 Risks are associated with contamination in the made ground and/or natural strata affecting the quality of perched water and surface waters in the vicinity of the site. Risks are also associated with the dissolution of contamination into perched water/lichgate and vertical migration to water receptors including the superficial and bedrock aquifer.

4.3.3 However, the site investigation encountered relatively impermeable superficial clay deposits across the site which will likely inhibit vertical migration of contamination to the underlying superficial and bedrock aquifers.

4.3.4 Furthermore, the soil contamination levels within all of the samples tested were generally below the limit of detection and below commercial development thresholds and often at natural background concentrations.

- 4.3.5 Given that very low to negligible levels of contamination were encountered within the soil overlying the site and considering the vast majority of the site will be covered with laterally continuous hardstanding post development (hardstanding reducing water infiltration and the potential for any leachate production), the potential risks to controlled waters are considered to be negligible and are not considered further.

4.4 Risk Assessment: Buildings

- 4.4.1 Risks to buildings include the assessment of the aggressive nature of the shallow ground with respect to concrete, the risks to the degradation of water pipes and flora due to contamination.

Risk to Concrete

- 4.4.2 To assess the potential risks to concrete, BEK has compared the site investigation data to assessment criteria presented in the BRE Special Digest 1: Concrete in Aggressive Ground.
- 4.4.3 Eight water soluble sulphate tests and pH tests were carried out on soil samples. The water soluble sulphate content ranged between <10 and 310 mg/l and the pH ranges from 6.96 to 8.56.
- 4.4.4 Three total sulphur tests and sulphate (acid soluble) tests were also completed on the soil samples. Oxidisable sulphate calculations confirmed that pyrite was likely present at the site.
- 4.4.5 A characteristic value for potential sulphate was calculated and determined to be 0.2%. Together, the results were utilised to determine a concrete classification of sulphate class DS-1 and an Aggressive Chemical Environment for Concrete (ACEC) class of AC-1.
- 4.4.6 The classifications are made on the basis that the site is classified as a 'Natural Ground Location' and that mobile groundwater conditions may be present.

Risks to Services

- 4.4.7 Potable water supply pipes can be at risk from degradation if the shallow ground consists of specific organic contamination.
- 4.4.8 Guidance published by UKWIR includes a methodology for the site investigation and risk assessment to determine pipe specification.
- 4.4.9 Site investigation may be required along the intended route of the water pipeline and samples recovered from specific depths and tested for specific contaminants of concern.

4.4.10 On the basis of the ground conditions encountered, risks to water supply pipelines are considered to be very low, however it is recommended that consultation is undertaken with the water service supplier to confirm this.

4.5 Risk Assessment: Conclusions

4.5.1 Topsoil was identified in every exploratory location at the site ranging in depth from 0.3 m (Window Sample Borehole WS6) to 0.7 m (Window Sample Borehole WS1, WS2, WS3, WS4, WS5 and WS7).

4.5.2 Natural Strata underlying the made ground generally comprised of silty clay.

4.5.3 The samples recovered from site investigation have been tested for a wide range of contaminants in accordance with the recommendations outlined within the PRA and based on the observations made during the site investigation. The chemical test results have been compared to relevant generic assessment criteria to identify potential contaminants of concern.

4.5.4 Based on the contamination assessment herein and with respect to the redevelopment of the site for commercial use there are no contaminants of concern identified at the site.

4.5.5 Risks to controlled water are considered to be very low to negligible.

4.5.6 Risks to concrete are considered to be low and concrete classification of DS-1 AC-1 is likely to be suitable.

4.5.7 Potential risks to the service pipes are considered to be low, but advice should be sought from the water supply provider if new water pipes are to be installed.

5. GEOTECHNICAL ASSESSMENT

- 5.1 The proposed development is for the construction of a natural gas filling station. Should the development use change from this profile, re-assessment may be required to consider the likely geotechnical considerations imposed by the alternative development.
- 5.2 Site investigation has proven the presence of topsoil overlying the site, varying in thickness from 0.3m to 0.4m. The topsoil is formed from organic sandy silty clays with occasional rare flint. Underlying the topsoil is a band of firm to stiff sandy clay which extends to depths between 0.6 m and 2.5 m below the surface. Underlying the sandy clay is stiff to very stiff clay.
- 5.3 Groundwater was encountered at a depth of 2.0 m in the staff clay within Window Sample Borehole WS1. The remaining boreholes remained dry during the investigation works. Bedrock was not encountered within any of the boreholes.
- 5.4 Standard Penetration Tests (SPT) were conducted in the boreholes, starting at a depth of 1 m and repeated at 1 m levels from 2 m onwards. The SPT results are summarised in the table below.

	SPT Readings (N)				
	1.0 – 1.45 m	2.0 – 2.45 m	3.0 – 3.45 m	4.0 – 4.45 m	5.0 – 5.45 m
WS1	13	15	20	22	-
WS2	14	19	21	20	-
WS3	14	16	19	21	-
WS4	14	16	19	21	22
WS5	13	18	18	20	22
WS6	8	12	15	20	23
WS7	9	14	16	16	20

Table 4: Summary of SPT Results for Window Sample Boreholes

- 5.5 Clay samples were taken from borehole WS1, WS3 & WS7. Atterberg testing was undertaken in the laboratory conditions to determine the plasticity index of the clay. The result is presented in Appendix C. The modified plasticity index for the sample was calculated in accordance with NHBC guidance and summarised in Table 5 below.

Plastic Limit Test Results					
Location	Depth (m)	Plasticity Index (P.I.)	Retained 425 Sieve	Passing 425 Sieve	Modified P.I. (%)
WS1	1.5-2.0m	39	0%	100%	39
WS3	2.0-2.5m	41	0%	100%	41
WS7	1.0-1.5m	38	0%	100%	38
	Average	39.3		Average:	39.3

Table 5: Plasticity Results

- 5.6 The plasticity results indicate that the soil can be categorised to be of high volume change potential, requiring a minimum foundation formation depth of 1.05 m below existing or proposed ground level, whichever is the lower, in areas where clay soils are present. Adjustments to formation depths, to comply with LABC requirements and NHBC Ch.4.2 guidance, may be required where trees are within influence of new structures.

Assessment and Conclusions

- 5.7 The site is predominantly underlain with sandy clays, beneath the shallow topsoil materials. The SPT values in the upper clays indicate that minimum bearing capacities of 95 kN/m². The stiff clays beneath the sandy clays have bearing capacities in excess of at least 140 kN/m².
- 5.8 It is proposed to construct of a biomethane gas vehicle fuelling facility comprising 12 fuelling islands and infrastructure including gas storage banks, compressors and backup generator located on the eastern boundary. These structures are proposed to have raft type foundations. A review of the likely loading to the structures indicates that bearing pressures at formation will be of no greater than 45 kN/m². The underlying clays are therefore deemed suitable to sustain the loads associated with the proposed bases.
- 5.9 The hardstanding slabs should also be formed on the underlying clay layers. All topsoil must be removed, prior to the installation of the sub-base materials to the slabs.
- 5.10 All foundation designs must be reviewed and designed by a suitably qualified design engineer. The above advice is based upon the ground condition information obtained during the survey. The design engineer must satisfy themselves that the information meets with their design requirements.

6. RECOMMENDATIONS

- 6.1 This report provides an assessment of the ground conditions based on the assessment of available site investigation information and quantifies the potential risks associated with contamination and provides a geotechnical assessment with respect to foundation design.

Contamination Assessment

- 6.2 Based on the results of the contamination risk assessment undertaken at the site to the south of Watling Street, Hinckley and with consideration to the environmental setting and the proposed redevelopment of the site for commercial use no risks to human health have been identified.

- 6.3 Notwithstanding, BEK recommends the following:

- (i) All ground workers adopts suitable PPE when working on the site and consider the requirements of site specific risk assessments and working method statements.
- (ii) All groundworkers should remain vigilant during ground excavations for the presence (or suspected presence) of contamination. Should suspected contamination be identified then work should cease and specialist advice sought.
- (iii) Any material removed from the site should be disposed of in accordance with appropriate in accordance with appropriate legislation and regulations, including the Duty of Care Regulations.
- (vi) Consideration should be given to the requirements of the water supply provider. They are likely to require the UKWIR risk assessment to be completed to determine the specification for the water pipes. BEK recommends that the water supply provider is contacted and enquiries made.

Infiltration Rate

- 6.4 Infiltration testing to BRE365 indicates that the ground conditions appear to be relatively impermeable indicating infiltration is unlikely to be a viable means of disposing surface water at the proposed development site.

Geotechnical Assessment

- 6.5 The site is predominantly underlain with sandy clays, beneath the shallow topsoil materials. The SPT values in the upper clays indicate that minimum bearing capacities of 95 kN/m². The stiff clays beneath the sandy clays have bearing capacities in excess of at least 140 kN/m².
- 6.6 It is proposed to construct of a biomethane gas vehicle fuelling facility comprising 12 fuelling islands and infrastructure including gas storage banks, compressors and backup generator located on the eastern boundary. These structures are proposed to have raft type foundations. A review of the likely loading to the structures indicates that bearing pressures at formation will be of no greater than 45 kN/m². The underlying clays are therefore deemed suitable to sustain the loads associated with the proposed bases.
- 6.7 The hardstanding slabs should also be formed on the underlying clay layers. All topsoil must be removed, prior to the installation of the sub-base materials to the slabs.
- 6.8 All foundation designs must be reviewed and designed by a suitably qualified design engineer. The above advice is based upon the ground condition information obtained during the survey. The design engineer must satisfy themselves that the information meets with their design requirements.
- 6.9 A concrete classification of DS-1 AC-1 is likely to be suitable at the site.

Waste Soil Management

- 6.10 Careful management of soils during the excavation works will ensure optimum utilisation of soil resources. Excavated soils which require off-site disposal are anticipated to be classified in accordance with the following document: Guidance on the Disposal of "Contaminated Soils" Version 3 (April 2001); produced by the Environment Agency.
- 6.11 In all cases where excess soils require off-site disposal, the materials needs to be managed under the appropriate legislation and consideration given to any remedial techniques that could be used to improve the soil.
- 6.12 If waste soils are to be re-used on site then a suitable permit exemption should be put in place (if appropriate) or a Material Management Plan (MMP) should be prepared as part of compliance with the CL:AIRE Definition of Waste:Code of Practice.

APPENDIX A

Exploratory Logs



GEO-ENVIRONMENTAL CONSULTANTS

GEO-ENVIRONMENTAL CONSULTING ENGINEERS

PROJECT NUMBER 23005	DATE 16th January 2023
PROJECT NAME CNG Hinckley	DRILLING METHOD Window Sample Borehole
CLIENT Thomas Consulting	BOREHOLE NO WS1

COMPLETION	CASING uPVC	SCREEN uPVC Factory Slotted
COMMENTS Dry. 2 Liners. Next to trees.		

Depth (m)	Depth (m)	Samples/ Test	Field Records	Water	Graphic Log	Material Description	Additional Observations	Elevation (m)
0.2	0.10	D = 0.10 m				Soft dark brown very sandy silty organic clay with frequent rootlets and rare flint (TS)		0.2
0.4								0.4
0.6	0.6	D = 0.6 m				Stiff brown fine to medium sandy clay with occasional flint		0.6
0.8								0.8
1	1 - 1.45	SPT (C) N=13	2,2/3,3,3,4					1
1.2								1.2
1.4	1.40	D = 1.40 m				Stiff becoming very stiff fine brown slightly silty clay		1.4
1.6	1.50 - 2.0	B=1.5-2						1.6
1.8								1.8
2	2 - 2.45	SPT (C) N=15	3,3/3,4,4,4					2
2.2								2.2
2.4								2.4
2.6								2.6
2.8								2.8
3	3 - 3.45	SPT (C) N=19	3,4/4,5,5,6					3
3.2								3.2
3.4								3.4
3.6								3.6
3.8								3.8
4	4 - 4.45	SPT (C) N=22	4,4/5,5,6,6					4
4.2								4.2
4.4								4.4
4.6						Termination Depth at: 4.45 m		4.6
4.8								4.8



GEO-ENVIRONMENTAL CONSULTANTS

GEO-ENVIRONMENTAL CONSULTING ENGINEERS

PROJECT NUMBER 23005	DATE 16th January 2023
PROJECT NAME CNG Hinckley	DRILLING METHOD Window Sample Borehole
CLIENT Thomas Consulting	BOREHOLE NO WS2

COMPLETION	CASING uPVC	SCREEN uPVC Factory Slotted
COMMENTS Dry. 2 Liners.		

Depth (m)	Depth (m)	Samples/ Test	Field Records	Water	Graphic Log	Material Description	Additional Observations	Elevation (m)
0.2	0.15	D=0.15 m				Soft dark brown very sandy silty organic clay with frequent rootlets and rare flint (TS)		0.2
0.4								0.4
0.6								0.6
0.8								0.8
1	1.0	D=1.0 m						1
1.2	1 - 1.45	SPT (C) N=14	2,2/3,3,4,4					1.2
1.4								1.4
1.6								1.6
1.8								1.8
2	2 - 2.45	SPT (C) N=19	3,3/4,4,5,6					2
2.2								2.2
2.4								2.4
2.6	2.50	D=2.50 m						2.6
2.8								2.8
3	3 - 3.45	SPT (C) N=21	4,4/5,5,5,6					3
3.2								3.2
3.4								3.4
3.6								3.6
3.8								3.8
4	4 - 4.45	SPT (C) N=20	4,4/5,5,5,5					4
4.2								4.2
4.4								4.4
4.6						Termination Depth at: 4.45 m		4.6
4.8								4.8




GEO-ENVIRONMENTAL CONSULTANTS

GEO-ENVIRONMENTAL CONSULTING ENGINEERS

PROJECT NUMBER 23005	DATE 16th January 2023
PROJECT NAME CNG Hinckley	DRILLING METHOD Window Sample Borehole
CLIENT Thomas Consulting	BOREHOLE NO WS3

COMPLETION	CASING uPVC	SCREEN uPVC Factory Slotted
COMMENTS Slight water strike at 2m. 3 Liners. Next to trees.		

Depth (m)	Depth (m)	Samples/ Test	Field Records	Water	Graphic Log	Material Description	Additional Observations	Elevation (m)
0.2	/0.10	/D =0.10 m		▽		Soft dark brown very sandy silty organic clay with frequent rootlets and rare flint (TS)		0.2
0.4						Stiff brown slightly silty clay		0.4
0.6								0.6
0.8								0.8
1	/1.0	/D =1.0 m						1
1.2	1 - 1.45	SPT (C) N=14	2,3/3,3,4,4					1.2
1.4								1.4
1.6	/1.50	/1.50						1.6
1.8								1.8
2	/2.0 - 2.50	/B= 2.0 - 2.50 m						2
2.2	2 - 2.45	SPT (C) N=16	3,3/3,4,4,5			Very stiff yellow / brown slightly laminated silty clay		2.2
2.4								2.4
2.6								2.6
2.8								2.8
3	3 - 3.45	SPT (C) N=19	4,4/4,5,5,5					3
3.2								3.2
3.4								3.4
3.6								3.6
3.8								3.8
4	4 - 4.45	SPT (C) N=21	4,4/4,5,6,6					4
4.2								4.2
4.4								4.4
4.6						Termination Depth at: 4.45 m		4.6
4.8								4.8



GEO-ENVIRONMENTAL CONSULTANTS

GEO-ENVIRONMENTAL CONSULTING ENGINEERS

PROJECT NUMBER 23005	DATE 16th January 2023
PROJECT NAME CNG Hinckley	DRILLING METHOD Window Sample Borehole
CLIENT Thomas Consulting	BOREHOLE NO WS4

COMPLETION	CASING uPVC	SCREEN uPVC Factory Slotted
COMMENTS Dry. 2 liners.		

Depth (m)	Depth (m)	Samples/ Test	Field Records	Water	Graphic Log	Material Description	Additional Observations	Elevation (m)
0.5	0.10	D=0.10 m				Soft dark brown very sandy silty organic clay with frequent rootlets and rare flint (TS)		0.5
1	1.0	D=1.0 m				Stiff brown silty clay with occasional fine to coarse sub-rounded gravel.		1
	1 - 1.45	SPT (C) N=14	2,3/3,3,4,4					
1.5						Very stiff yellow / brown silty clay		1.5
2	2.0	D=2.0 m						2
	2 - 2.45	SPT (C) N=16	3,3/3,4,4,5					
2.5								2.5
3								3
	3 - 3.45	SPT (C) N=19	4,4/4,5,5,5					
3.5	3.50	D=3.50 m				Very stiff grey / brown mottled fine to coarse sandy silty clay		3.5
4								4
	4 - 4.45	SPT (C) N=21	4,4/4,5,6,6					
4.5								4.5
5								5
	5.0 - 5.45	SPT (C) N=22	4,4/5,5,6,6					
5.5						Termination Depth at: 5.45 m		5.5



GEO-ENVIRONMENTAL CONSULTANTS

GEO-ENVIRONMENTAL CONSULTING ENGINEERS

PROJECT NUMBER 23005	DATE 16th January 2023
PROJECT NAME CNG Hinckley	DRILLING METHOD Window Sample Borehole
CLIENT Thomas Consulting	BOREHOLE NO WS5

COMPLETION	CASING uPVC	SCREEN uPVC Factory Slotted
COMMENTS Dry. 1 liners.		

Depth (m)	Depth (m)	Samples/ Test	Field Records	Water	Graphic Log	Material Description	Additional Observations	Elevation (m)
	0.20	D=0.20 m				Soft dark brown very sandy silty organic clay with frequent rootlets and rare flint (TS)		
0.5								0.5
1	1.0	D=1.0 m				Stiff becoming very stiff brown slightly sandy silty clay with occasional rootlets and rare medium flint		1
	1.0 - 1.45	SPT (C) N=13	3,3/3,3,3,4					
1.5								1.5
2	2 - 2.45	SPT (C) N=18	3,3/4,4,5,5					2
2.5								2.5
3	3	3				Very stiff grey / brown mottled very silty clay		3
	3 - 3.45	SPT (C) N=18	3,4/4,4,5,5					
3.5								3.5
4	4 - 4.45	SPT (C) N=20	3,4/4,5,5,6					4
4.5								4.5
5	5.0 - 5.45	SPT (C) N=22	4,4/5,5,6,6					5
5.5						Termination Depth at: 5.45 m		5.5



GEO-ENVIRONMENTAL CONSULTANTS

GEO-ENVIRONMENTAL CONSULTING ENGINEERS

PROJECT NUMBER 23005	DATE 16th January 2023
PROJECT NAME CNG Hinckley	DRILLING METHOD Window Sample Borehole
CLIENT Thomas Consulting	BOREHOLE NO WS6

COMPLETION	CASING uPVC	SCREEN uPVC Factory Slotted
COMMENTS Dry. 3 Liners.		

Depth (m)	Depth (m)	Samples/ Test	Field Records	Water	Graphic Log	Material Description	Additional Observations	Elevation (m)
	0.10	D = 0.10 m				Soft dark brown very sandy silty organic clay with frequent rootlets and rare flint (TS)		
0.5	0.60	D = 0.60 m				Firm brown sandy clay with rare fine flint		0.5
1	1.0 - 1.45	SPT (C) N=8	2,2/2,2,2,2					1
1.5						Stiff becoming very stiff grey / brown mottled silty clay		1.5
2	2.0	D = 2.0 m						2
	2 - 2.45	SPT (C) N=12	2,2/3,3,3,3					
2.5								2.5
3	3 - 3.45	SPT (C) N=15	3,3/3,4,4,4					3
3.5								3.5
4	4 - 4.45	SPT (C) N=20	4,4/5,5,5,5					4
4.5								4.5
5	5.0 - 5.45	SPT (C) N=23	4,5/5,6,6,6					5
5.5						Termination Depth at: 5.45 m		5.5



GEO-ENVIRONMENTAL CONSULTANTS

GEO-ENVIRONMENTAL CONSULTING ENGINEERS

PROJECT NUMBER 23005	DATE 16th January 2023
PROJECT NAME CNG Hinckley	DRILLING METHOD Window Sample Borehole
CLIENT Thomas Consulting	BOREHOLE NO WS7

COMPLETION	CASING uPVC	SCREEN uPVC Factory Slotted
COMMENTS Wet from ground level. 1 Liner. Next to trees.		

Depth (m)	Depth (m)	Samples/ Test	Field Records	Water	Graphic Log	Material Description	Additional Observations	Elevation (m)	
0.5	0.20	D =0.20 m	2,2/2,2,2,3			Soft dark brown very sandy silty organic clay with frequent rootlets and rare flint (TS)		0.5	
	0.60	D =0.60 m				Firm yellow / brown sandy clay with frequent fine to coarse sub-angular to sub-rounded flint			
1	1.0 - 1.50	1.0 - 1.50				Firm to stiff grey / brown mottled slightly silty clay		1	
	1.0 - 1.45	SPT (C) N=12							
1.5			1.5						
2	2 - 2.45	SPT (C) N=14	3,3/3,3,4,4					2	
2.5								2.5	
3	3 - 3.45	SPT (C) N=16	3,3/4,4,4,4					3	
3.5	3.50	D= 3.50 m				Stiff becoming very stiff grey / brown mottled silty clay		3.5	
4	4 - 4.45	SPT (C) N=16	4,4/4,4,4,4						4
4.5									4.5
5	5.0 - 5.45	SPT (C) N=20	4,5/5,5,5,5						5
5.5									

APPENDIX B

Chemical Test Results

FINAL ANALYTICAL TEST REPORT

Envirolab Job Number: 23/00393
Issue Number: 1

Date: 25 January, 2023

Client: BEK Enviro Ltd
Suite One
No 3 Mitton Road Business Park
Mitton Road
Whalley
Lancashire
BB7 9YE

Project Manager: Mick Buckley
Project Name: CNG Hinckley
Project Ref: Not specified
Order No: 7684-23005-J
Date Samples Received: 18/01/23
Date Instructions Received: 19/01/23
Date Analysis Completed: 25/01/23

Approved by:



Richard Wong
Client Manager

Envirolab Job Number: 23/00393

Client Project Name: CNG Hinckley

Client Project Ref: Not specified

Lab Sample ID	23/00393/1	23/00393/2	23/00393/3	23/00393/4	23/00393/5	23/00393/6	23/00393/7	Units	Limit of Detection	Method ref
Client Sample No										
Client Sample ID	WS4	WS1	WS7	WS1	WS2	WS5	WS6			
Depth to Top	0.15	1.40	1.00	0.10	0.15	0.20	0.10			
Depth To Bottom										
Date Sampled	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23			
Sample Type	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES			
Sample Matrix Code	4AE	3	3	4AE	4AE	4AE	4AE			
% Stones >10mm _A	<0.1	<0.1	<0.1	5.6	1.7	<0.1	<0.1	% w/w	0.1	A-T-044
pH _D ^{M#}	7.91	8.40	8.56	7.53	7.55	7.34	7.05	pH	0.01	A-T-031s
Sulphate (water sol 2:1) _D ^{M#}	0.03	0.24	0.31	0.03	0.04	<0.01	0.02	g/l	0.01	A-T-026s
Sulphate (acid soluble) _D ^{M#}	1400	830	880	1300	1300	1100	1300	mg/kg	200	A-T-028s
Sulphur (total) _D	882	365	456	-	-	-	-	mg/kg	50	A-T-024s
Cyanide (total) _A ^{M#}	<1	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-042sTCN
Phenols - Total by HPLC _A	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	mg/kg	0.2	A-T-050s
Organic Matter _D ^{M#}	9.0	0.9	1.2	7.9	8.9	6.5	9.5	% w/w	0.1	A-T-032s
Arsenic _D ^{M#}	9	3	5	6	8	9	8	mg/kg	1	A-T-024s
Boron (water soluble) _D ^{M#}	2.7	<1.0	1.5	2.3	2.5	2.2	2.5	mg/kg	1	A-T-027s
Cadmium _D ^{M#}	1.3	1.3	1.4	1.2	1.5	1.5	1.6	mg/kg	0.5	A-T-024s
Copper _D ^{M#}	27	20	22	30	31	32	32	mg/kg	1	A-T-024s
Chromium _D ^{M#}	49	51	51	49	45	52	69	mg/kg	1	A-T-024s
Chromium (hexavalent) _D	<1	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-040s
Lead _D ^{M#}	47	15	16	56	57	56	53	mg/kg	1	A-T-024s
Mercury _D	<0.17	0.89	1.46	0.18	<0.17	<0.17	<0.17	mg/kg	0.17	A-T-024s
Nickel _D ^{M#}	21	36	36	21	23	24	25	mg/kg	1	A-T-024s
Selenium _D ^{M#}	<1	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-024s
Zinc _D ^{M#}	96	62	64	91	99	99	117	mg/kg	5	A-T-024s

Envirolab Job Number: 23/00393

Client Project Name: CNG Hinckley

Client Project Ref: Not specified

Lab Sample ID	23/00393/1	23/00393/2	23/00393/3	23/00393/4	23/00393/5	23/00393/6	23/00393/7	Units	Limit of Detection	Method ref
Client Sample No										
Client Sample ID	WS4	WS1	WS7	WS1	WS2	WS5	WS6			
Depth to Top	0.15	1.40	1.00	0.10	0.15	0.20	0.10			
Depth To Bottom										
Date Sampled	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23			
Sample Type	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES			
Sample Matrix Code	4AE	3	3	4AE	4AE	4AE	4AE			
Asbestos in Soil (inc. matrix) [^] @										
Asbestos in soil [#]	NAD	NAD	NAD	NAD	NAD	NAD	NAD			A-T-045
Asbestos Matrix (visual) ₀	-	-	-	-	-	-	-			A-T-045
Asbestos Matrix (microscope) ₀	-	-	-	-	-	-	-			A-T-045
Asbestos ACM - Suitable for Water Absorption Test? ₀	N/A	N/A	N/A	N/A	N/A	N/A	N/A			A-T-045

Envirolab Job Number: 23/00393

Client Project Name: CNG Hinckley

Client Project Ref: Not specified

Lab Sample ID	23/00393/1	23/00393/2	23/00393/3	23/00393/4	23/00393/5	23/00393/6	23/00393/7	Units	Limit of Detection	Method ref
Client Sample No										
Client Sample ID	WS4	WS1	WS7	WS1	WS2	WS5	WS6			
Depth to Top	0.15	1.40	1.00	0.10	0.15	0.20	0.10			
Depth To Bottom										
Date Sampled	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23			
Sample Type	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES			
Sample Matrix Code	4AE	3	3	4AE	4AE	4AE	4AE			
PAH-16MS										
Acenaphthene _A ^{M#}	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-019s
Acenaphthylene _A ^{M#}	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-019s
Anthracene _A ^{M#}	<0.02	<0.02	<0.02	<0.02	<0.02	<0.02	<0.02	mg/kg	0.02	A-T-019s
Benzo(a)anthracene _A ^{M#}	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04	mg/kg	0.04	A-T-019s
Benzo(a)pyrene _A ^{M#}	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04	mg/kg	0.04	A-T-019s
Benzo(b)fluoranthene _A ^{M#}	<0.05	<0.05	<0.05	<0.05	<0.05	<0.05	<0.05	mg/kg	0.05	A-T-019s
Benzo(ghi)perylene _A ^{M#}	<0.05	<0.05	<0.05	<0.05	<0.05	<0.05	<0.05	mg/kg	0.05	A-T-019s
Benzo(k)fluoranthene _A ^{M#}	<0.07	<0.07	<0.07	<0.07	<0.07	<0.07	<0.07	mg/kg	0.07	A-T-019s
Chrysene _A ^{M#}	<0.06	<0.06	<0.06	<0.06	<0.06	<0.06	<0.06	mg/kg	0.06	A-T-019s
Dibenzo(ah)anthracene _A ^{M#}	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04	mg/kg	0.04	A-T-019s
Fluoranthene _A ^{M#}	<0.08	<0.08	<0.08	<0.08	<0.08	<0.08	<0.08	mg/kg	0.08	A-T-019s
Fluorene _A ^{M#}	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-019s
Indeno(123-cd)pyrene _A ^{M#}	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03	mg/kg	0.03	A-T-019s
Naphthalene _A ^{M#}	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03	mg/kg	0.03	A-T-019s
Phenanthrene _A ^{M#}	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03	mg/kg	0.03	A-T-019s
Pyrene _A ^{M#}	<0.07	<0.07	<0.07	<0.07	<0.07	<0.07	<0.07	mg/kg	0.07	A-T-019s
Total PAH-16MS _A ^{M#}	<0.08	<0.08	<0.08	<0.08	<0.08	<0.08	<0.08	mg/kg	0.01	A-T-019s

Envirolab Job Number: 23/00393

Client Project Name: CNG Hinckley

Client Project Ref: Not specified

Lab Sample ID	23/00393/1	23/00393/2	23/00393/3	23/00393/4	23/00393/5	23/00393/6	23/00393/7	Units	Limit of Detection	Method ref
Client Sample No										
Client Sample ID	WS4	WS1	WS7	WS1	WS2	WS5	WS6			
Depth to Top	0.15	1.40	1.00	0.10	0.15	0.20	0.10			
Depth To Bottom										
Date Sampled	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23	16-Jan-23			
Sample Type	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES			
Sample Matrix Code	4AE	3	3	4AE	4AE	4AE	4AE			
TPH CWG with Clean Up										
Ali >C5-C6 _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
Ali >C6-C8 _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
Ali >C8-C10 _A	<1	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-055s
Ali >C10-C12 _A ^{M#}	<1	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-055s
Ali >C12-C16 _A ^{M#}	<1	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-055s
Ali >C16-C21 _A ^{M#}	<1	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-055s
Ali >C21-C35 _A ^{M#}	13	<1	<1	10	14	15	14	mg/kg	1	A-T-055s
Total Aliphatics _A	13	<1	<1	10	14	15	14	mg/kg	1	Calc-As Recd
Aro >C5-C7 _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
Aro >C7-C8 _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
Aro >C8-C10 _A	<1	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-055s
Aro >C10-C12 _A	<1	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-055s
Aro >C12-C16 _A	<1	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-055s
Aro >C16-C21 _A ^{M#}	3	<1	<1	1	1	3	3	mg/kg	1	A-T-055s
Aro >C21-C35 _A ^{M#}	4	<1	<1	3	3	4	4	mg/kg	1	A-T-055s
Total Aromatics _A	7	<1	<1	4	4	7	7	mg/kg	1	Calc-As Recd
TPH (Ali & Aro >C5-C35) _A	20	<1	<1	14	18	22	21	mg/kg	1	Calc-As Recd
BTEX - Benzene _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
BTEX - Toluene _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
BTEX - Ethyl Benzene _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
BTEX - m & p Xylene _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
BTEX - o Xylene _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
MTBE _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s

Envirolab Job Number: 23/00393

Client Project Name: CNG Hinckley

Client Project Ref: Not specified

Lab Sample ID	23/00393/8							Units	Limit of Detection	Method ref
Client Sample No										
Client Sample ID	WS7									
Depth to Top	0.20									
Depth To Bottom										
Date Sampled	16-Jan-23									
Sample Type	Soil - ES									
Sample Matrix Code	4AE									
% Stones >10mm _A	<0.1							% w/w	0.1	A-T-044
pH _D ^{M#}	6.96							pH	0.01	A-T-031s
Sulphate (water sol 2:1) _D ^{M#}	0.04							g/l	0.01	A-T-026s
Sulphate (acid soluble) _D ^{M#}	1200							mg/kg	200	A-T-028s
Cyanide (total) _A ^{M#}	<1							mg/kg	1	A-T-042sTCN
Phenols - Total by HPLC _A	<0.2							mg/kg	0.2	A-T-050s
Organic Matter _D ^{M#}	7.9							% w/w	0.1	A-T-032s
Arsenic _D ^{M#}	8							mg/kg	1	A-T-024s
Boron (water soluble) _D ^{M#}	2.6							mg/kg	1	A-T-027s
Cadmium _D ^{M#}	1.6							mg/kg	0.5	A-T-024s
Copper _D ^{M#}	35							mg/kg	1	A-T-024s
Chromium _D ^{M#}	105							mg/kg	1	A-T-024s
Chromium (hexavalent) _D	<1							mg/kg	1	A-T-040s
Lead _D ^{M#}	55							mg/kg	1	A-T-024s
Mercury _D	0.31							mg/kg	0.17	A-T-024s
Nickel _D ^{M#}	26							mg/kg	1	A-T-024s
Selenium _D ^{M#}	<1							mg/kg	1	A-T-024s
Zinc _D ^{M#}	124							mg/kg	5	A-T-024s

Envirolab Job Number: 23/00393/8

Client Project Name: CNG Hinckley

Client Project Ref: Not specified

Lab Sample ID	23/00393/8							Units	Limit of Detection	Method ref
Client Sample No										
Client Sample ID	WS7									
Depth to Top	0.20									
Depth To Bottom										
Date Sampled	16-Jan-23									
Sample Type	Soil - ES									
Sample Matrix Code	4AE									
Asbestos in Soil (inc. matrix) [^] @										
Asbestos in soil [#]	NAD									A-T-045
Asbestos Matrix (visual) ₀	-									A-T-045
Asbestos Matrix (microscope) ₀	-									A-T-045
Asbestos ACM - Suitable for Water Absorption Test? ₀	N/A									A-T-045

Envirolab Job Number: 23/00393

Client Project Name: CNG Hinckley

Client Project Ref: Not specified

Lab Sample ID	23/00393/8							Units	Limit of Detection	Method ref
Client Sample No										
Client Sample ID	WS7									
Depth to Top	0.20									
Depth To Bottom										
Date Sampled	16-Jan-23									
Sample Type	Soil - ES									
Sample Matrix Code	4AE									
PAH-16MS										
Acenaphthene _A ^{M#}	<0.01							mg/kg	0.01	A-T-019s
Acenaphthylene _A ^{M#}	<0.01							mg/kg	0.01	A-T-019s
Anthracene _A ^{M#}	<0.02							mg/kg	0.02	A-T-019s
Benzo(a)anthracene _A ^{M#}	<0.04							mg/kg	0.04	A-T-019s
Benzo(a)pyrene _A ^{M#}	<0.04							mg/kg	0.04	A-T-019s
Benzo(b)fluoranthene _A ^{M#}	<0.05							mg/kg	0.05	A-T-019s
Benzo(ghi)perylene _A ^{M#}	<0.05							mg/kg	0.05	A-T-019s
Benzo(k)fluoranthene _A ^{M#}	<0.07							mg/kg	0.07	A-T-019s
Chrysene _A ^{M#}	<0.06							mg/kg	0.06	A-T-019s
Dibenzo(ah)anthracene _A ^{M#}	<0.04							mg/kg	0.04	A-T-019s
Fluoranthene _A ^{M#}	<0.08							mg/kg	0.08	A-T-019s
Fluorene _A ^{M#}	<0.01							mg/kg	0.01	A-T-019s
Indeno(123-cd)pyrene _A ^{M#}	<0.03							mg/kg	0.03	A-T-019s
Naphthalene _A ^{M#}	<0.03							mg/kg	0.03	A-T-019s
Phenanthrene _A ^{M#}	<0.03							mg/kg	0.03	A-T-019s
Pyrene _A ^{M#}	<0.07							mg/kg	0.07	A-T-019s
Total PAH-16MS _A ^{M#}	<0.08							mg/kg	0.01	A-T-019s

Envirolab Job Number: 23/00393/8

Client Project Name: CNG Hinckley

Client Project Ref: Not specified

Lab Sample ID	23/00393/8							Units	Limit of Detection	Method ref
Client Sample No										
Client Sample ID	WS7									
Depth to Top	0.20									
Depth To Bottom										
Date Sampled	16-Jan-23									
Sample Type	Soil - ES									
Sample Matrix Code	4AE									
TPH CWG with Clean Up										
Ali >C5-C6 _A [#]	<0.01							mg/kg	0.01	A-T-022s
Ali >C6-C8 _A [#]	<0.01							mg/kg	0.01	A-T-022s
Ali >C8-C10 _A	<1							mg/kg	1	A-T-055s
Ali >C10-C12 _A ^{M#}	<1							mg/kg	1	A-T-055s
Ali >C12-C16 _A ^{M#}	<1							mg/kg	1	A-T-055s
Ali >C16-C21 _A ^{M#}	<1							mg/kg	1	A-T-055s
Ali >C21-C35 _A ^{M#}	18							mg/kg	1	A-T-055s
Total Aliphatics _A	18							mg/kg	1	Calc-As Recd
Aro >C5-C7 _A [#]	<0.01							mg/kg	0.01	A-T-022s
Aro >C7-C8 _A [#]	<0.01							mg/kg	0.01	A-T-022s
Aro >C8-C10 _A	<1							mg/kg	1	A-T-055s
Aro >C10-C12 _A	<1							mg/kg	1	A-T-055s
Aro >C12-C16 _A	<1							mg/kg	1	A-T-055s
Aro >C16-C21 _A ^{M#}	3							mg/kg	1	A-T-055s
Aro >C21-C35 _A ^{M#}	3							mg/kg	1	A-T-055s
Total Aromatics _A	6							mg/kg	1	Calc-As Recd
TPH (Ali & Aro >C5-C35) _A	24							mg/kg	1	Calc-As Recd
BTEX - Benzene _A [#]	<0.01							mg/kg	0.01	A-T-022s
BTEX - Toluene _A [#]	<0.01							mg/kg	0.01	A-T-022s
BTEX - Ethyl Benzene _A [#]	<0.01							mg/kg	0.01	A-T-022s
BTEX - m & p Xylene _A [#]	<0.01							mg/kg	0.01	A-T-022s
BTEX - o Xylene _A [#]	<0.01							mg/kg	0.01	A-T-022s
MTBE _A [#]	<0.01							mg/kg	0.01	A-T-022s

REPORT NOTES

General

This report shall not be reproduced, except in full, without written approval from Envirolab.

The results reported herein relate only to the material supplied to the laboratory.

The residue of any samples contained within this report, and any received with the same delivery, will be disposed of six weeks after initial scheduling. For samples tested for Asbestos we will retain a portion of the dried sample for a minimum of six months after the initial Asbestos testing is completed.

Analytical results reflect the quality of the sample at the time of analysis only.

Opinions and interpretations expressed are outside the scope of our accreditation.

If results are in italic font they are associated with an AQC failure, these are not accredited and are unreliable.

A deviating samples report is appended and will indicate if samples or tests have been found to be deviating. Any test results affected may not be an accurate record of the concentration at the time of sampling and, as a result, may be invalid.

The Client Sample No, Client Sample ID, Depth to Top, Depth to Bottom and Date Sampled were all provided by the client.

Soil chemical analysis:

All results are reported as dry weight (<40°C).

For samples with Matrix Codes 1 - 6 natural stones, brick and concrete fragments >10mm and any extraneous material (visible glass, metal or twigs) are removed and excluded from the sample prior to analysis and reported results corrected to a whole sample basis. This is reported as '% stones >10mm'.

For samples with Matrix Code 7 the whole sample is dried and crushed prior to analysis and this supersedes any "A" subscripts

All analysis is performed on the sample as received for soil samples which are positive for asbestos or the client has informed asbestos may be present and/or if they are from outside the European Union and this supersedes any "D" subscripts.

TPH analysis of water by method A-T-007:

Free and visible oils are excluded from the sample used for analysis so that the reported result represents the dissolved phase only.

Electrical Conductivity of water by Method A-T-037:

Results greater than 12900µS/cm @ 25°C / 11550µS/cm @ 20°C fall outside the calibration range and as such are unaccredited.

Asbestos:

Asbestos in soil analysis is performed on a dried aliquot of the submitted sample and cannot guarantee to identify asbestos if only present in small numbers as discrete fibres/fragments in the original sample.

Stones etc. are not removed from the sample prior to analysis.

Quantification of asbestos is a 3 stage process including visual identification, hand picking and weighing and fibre counting by sedimentation/phase contrast optical microscopy if required. If asbestos is identified as being present but is not in a form that is suitable for analysis by hand picking and weighing (normally if the asbestos is present as free fibres) quantification by sedimentation is performed. Where ACMs are found a percentage asbestos is assigned to each with reference to 'HSG264, Asbestos: The survey guide' and the calculated asbestos content is expressed as a percentage of the dried soil sample aliquot used.

Predominant Matrix Codes:

1 = SAND, 2 = LOAM, 3 = CLAY, 4 = LOAM/SAND, 5 = SAND/CLAY, 6 = CLAY/LOAM, 7 = OTHER, 8 = Asbestos bulk ID sample, 9 = INCINERATOR ASH.

Samples with Matrix Code 7 & 8 are not predominantly a SAND/LOAM/CLAY mix and are not covered by our BSEN 17025 or MCERTS accreditations, with the exception of bulk asbestos which are BSEN 17025 accredited.

Secondary Matrix Codes:

A = contains stones, B = contains construction rubble, C = contains visible hydrocarbons, D = contains glass/metal,

E = contains roots/twigs.

Key:

IS indicates Insufficient Sample for analysis.

US indicates Unsuitable Sample for analysis.

NDP indicates No Determination Possible.

NAD indicates No Asbestos Detected.

N/A indicates Not Applicable.

Superscript # indicates method accredited to ISO 17025.

Superscript "M" indicates method accredited to MCERTS.

Subscript "A" indicates analysis performed on the sample as received.

Subscript "D" indicates analysis performed on the dried sample, crushed to pass a 2mm sieve

Subscript "A" indicates analysis has dependant options against results. Testing dependant on results appear in the comments area of your sample receipt.

EPH CWG results have humics mathematically subtracted through instrument calculation

TPH results "with Cleanup" indicates results cleaned up with Silica during extraction

EPH CWG GCxGC ID from TPH CWG

Where we have identified humic substances in any ID's from TPH CWG with Clean Up please note that the concentration of these humic substances is not included in the quantified results and are included in the ID for information.

Please contact us if you need any further information.

Envirolab Deviating Samples Report

Units 7&8 Sandpits Business Park, Mottram Road, Hyde, SK14 3AR
Tel. 0161 368 4921 email. ask@envlab.co.uk

Client:	BEK Enviro Ltd, Suite One , No 3 Mitton Road Business Park , Mitton Road , Whalley , Lancashire , BB7 9YE	Project No:	23/00393
Project:	CNG Hinckley	Date Received:	19/01/2023 (am)
Clients Project No:		Cool Box Temperatures (°C):	3.3

NO DEVIATIONS IDENTIFIED with respect to sampling dates or containers received.

Note: If, at any point before reaching the laboratory, the temperature of the samples has breached those set in published standards, e.g. BS-EN 5667-3 (for water samples $5 \pm 3^{\circ}\text{C}$), ISO 18400-105:2017, then the concentration of any affected analytes may differ from that at the time of sampling.

Envirolab Analysis Dates

Lab Sample ID	23/00393/1	23/00393/2	23/00393/3	23/00393/4	23/00393/5	23/00393/6	23/00393/7	23/00393/8
Client Sample No								
Client Sample ID/Depth	WS4 0.15m	WS1 1.40m	WS7 1.00m	WS1 0.10m	WS2 0.15m	WS5 0.20m	WS6 0.10m	WS7 0.20m
Date Sampled	16/01/23	16/01/23	16/01/23	16/01/23	16/01/23	16/01/23	16/01/23	16/01/23
A-T-004s	25/01/2023	25/01/2023	25/01/2023					
A-T-007s	23/01/2023	23/01/2023	23/01/2023					
A-T-019s	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023
A-T-022s	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023
A-T-024s	25/01/2023	25/01/2023	25/01/2023	25/01/2023	25/01/2023	25/01/2023	25/01/2023	25/01/2023
A-T-025w	25/01/2023	25/01/2023	25/01/2023					
A-T-026s	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023
A-T-026w	25/01/2023	25/01/2023	25/01/2023					
A-T-027s	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023
A-T-028s	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023
A-T-030s	24/01/2023	24/01/2023	24/01/2023					
A-T-031s	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023
A-T-031w	25/01/2023	25/01/2023	25/01/2023					
A-T-032s	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023
A-T-032w	25/01/2023	25/01/2023	25/01/2023					
A-T-037w	25/01/2023	25/01/2023	25/01/2023					
A-T-040s	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023
A-T-042sTCN	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023
A-T-044	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023
A-T-045	20/01/2023	20/01/2023	20/01/2023	20/01/2023	20/01/2023	20/01/2023	20/01/2023	20/01/2023
A-T-050s	20/01/2023	20/01/2023	20/01/2023	20/01/2023	20/01/2023	20/01/2023	20/01/2023	20/01/2023
A-T-050w	25/01/2023	25/01/2023	25/01/2023					
A-T-055s	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023
A-T-ANCs	23/01/2023	23/01/2023	23/01/2023					
Calc-As Recd	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023	23/01/2023
Calc-no stones	25/01/2023	25/01/2023	25/01/2023					
Probe (w)	25/01/2023	25/01/2023	25/01/2023					

The above dates are the analysis completion dates, please note that these are not necessarily the date that the analysis was weighed/extracted.

End of Report

Final Test Report

Envirolab Job Number: 23/00393
Issue Number: 1

Date: 25-Jan-23

Client: BEK Enviro Ltd
Suite One
No 3 Mitton Road Business Park
Mitton Road
Whalley
Lancashire, BB7 9YE

Project Manager: Mick Buckley
Project Name: CNG Hinckley
Project Ref: Not specified
Order No: 7684-23005-J

Date Samples Received: 18-Jan-23
Date Instructions Received: 19-Jan-23
Date Analysis Completed: 25-Jan-23

Notes - Soil analysis

All results are reported as dry weight (<40°C).

For samples with Matrix Codes 1 - 6 natural stones >10mm are removed or excluded from the sample prior to analysis and reported results corrected to a whole sample basis.

For samples with Matrix Code 7 the whole sample is dried and crushed prior to analysis.

Notes - General

This report shall not be reproduced, except in full, without written approval from Envirolab.

Subscript "A" indicates analysis performed on the sample as received. "D" indicates analysis performed on the dried sample, crushed to pass a 2mm sieve, unless asbestos is found to be present in which case all analysis is performed on the sample as received.

All analysis is performed on the dried and crushed sample for samples with Matrix Code 7 and this supercedes any "A" subscripts.

All analysis is performed on the sample as received for soil samples from outside the European Union and this supercedes any "D" subscripts

For complex, multi-compound analysis, quality control results do not always fall within chart limits for every compound and we have criteria for reporting in these situations.

If results are in *italic font* they are associated with such quality control failures and may be unreliable.

A deviating samples report is appended and will indicate if samples or tests have been found to be deviating. Any test results affected may not be an accurate record of the concentration at the time of sampling and, as a result, may be invalid

Predominant Matrix Codes: 1 = SAND, 2 = LOAM, 3 = CLAY, 4 = LOAM/SAND, 5 = SAND/CLAY, 6 = CLAY/LOAM, 7 = OTHER, 8 = Asbestos bulk ID sample

Secondary Matrix Codes: A = contains stones, B = contains construction rubble, C = contains visible hydrocarbons, D = contains glass/metal, E = contains roots/twigs.

IS indicates Insufficient sample for analysis, NDP indicates No Determination Possible and NAD indicates No Asbestos Detected.

Analytical results reflect the quality of the sample at the time of analysis only. Opinions and interpretations expressed are outside the scope of our accreditation.

Please contact us if you need any further information.

HWOL TPH Code: EH_CU_ID_AL: Extractable hydrocarbons - i.e. everything extracted by the solvent(s), Clean-up - e.g. by florisil, silica gel, GC - Single coil gas chromatography, Aliphatics only

Approved by:



Richard Wong
Client Manager

Sample Details					Landfill Waste Acceptance Criteria Limits			
Lab Sample ID	Method	ISO17025	MCERTS	23/00393/1				
Client Sample Number					Inert Waste Landfill	Stable Non-reactive Hazardous Waste in Non-Hazardous Landfill	Hazardous Waste Landfill	
Client Sample ID				WS4				
Depth to Top				0.15				
Depth to Bottom								
Date Sampled				16/01/2023				
Sample Type				Soil - ES				
Sample Matrix Code				4AE				
Solid Waste Analysis								
pH (pH Units) _D	A-T-031	N	N	7.91	-	>6	-	
ANC to pH 4 (mol/kg) _D	A-T-ANC	N	N	0.06	-	to be evaluated	to be evaluated	
ANC to pH 6 (mol/kg) _D	A-T-ANC	N	N	0.03	-	to be evaluated	to be evaluated	
Loss on Ignition (%) _D	A-T-030	N	N	18.5	-	-	10	
Total Organic Carbon (%) _D	A-T-032	N	N	5.24	3	5	6	
PAH Sum of 17 (mg/kg) _A	A-T-019	N	N	<0.08	100	-	-	
Mineral Oil (mg/kg) _{A EH, CU, ID, AL}	A-T-007	N	N	<20	500	-	-	
Sum of 7 PCBs (mg/kg) _A	A-T-004	N	N	<0.007	1	-	-	
Sum of BTEX (mg/kg) _A	A-T-022	N	N	<0.01	6	-	-	
Eluate Analysis				10:1 mg/l	10:1 mg/kg	Limit values for compliance leaching test using BS EN 12457-2 at L/S 10 l/kg (mg/kg)		
Arsenic	A-T-025	N	N	<0.001	<0.01	0.5	2	25
Barium	A-T-025	N	N	0.123	1.230	20	100	300
Cadmium	A-T-025	N	N	<0.001	<0.01	0.04	1	5
Chromium	A-T-025	N	N	<0.001	<0.01	0.5	10	70
Copper	A-T-025	N	N	0.009	0.090	2	50	100
Mercury	A-T-025	N	N	<0.0005	<0.005	0.01	0.2	2
Molybdenum	A-T-025	N	N	<0.001	<0.01	0.5	10	30
Nickel	A-T-025	N	N	0.003	0.030	0.4	10	40
Lead	A-T-025	N	N	0.006	0.060	0.5	10	50
Antimony	A-T-025	N	N	<0.001	<0.01	0.06	0.7	5
Selenium	A-T-025	N	N	<0.001	<0.01	0.1	0.5	7
Zinc	A-T-025	N	N	0.011	0.110	4	50	200
Chloride	A-T-026	N	N	4	39	800	15000	25000
Fluoride	A-T-026	N	N	0.3	3.0	10	150	500
Sulphate as SO ₄	A-T-026	N	N	31	308	1000	20000	50000
Total Dissolved Solids	A-T-035	N	N	26	260	4000	60000	100000
Phenol Index	A-T-050	N	N	<0.01	<0.1	1	-	-
Dissolved Organic Carbon	A-T-032	N	N	<2.0	<200	500	800	1000
Leach Test Information								
pH (pH Units)	A-T-031	N	N	7.1				
Conductivity (µS/cm)	A-T-037	N	N	53				
Mass Sample (kg)				0.286				
Dry Matter (%)	A-T-044	N	N	61.3				
Stated acceptance limits are for guidance only and Envirolab cannot be held responsible for any discrepancies with current legislation								

Sample Details					Landfill Waste Acceptance Criteria Limits			
Lab Sample ID	Method	ISO17025	MCERTS	23/00393/2				
Client Sample Number					Inert Waste Landfill	Stable Non-reactive Hazardous Waste in Non-Hazardous Landfill	Hazardous Waste Landfill	
Client Sample ID				WS1				
Depth to Top				1.4				
Depth to Bottom								
Date Sampled				16/01/2023				
Sample Type				Soil - ES				
Sample Matrix Code				3				
Solid Waste Analysis								
pH (pH Units) _D	A-T-031	N	N	8.40	-	>6	-	
ANC to pH 4 (mol/kg) _D	A-T-ANC	N	N	1.71	-	to be evaluated	to be evaluated	
ANC to pH 6 (mol/kg) _D	A-T-ANC	N	N	0.37	-	to be evaluated	to be evaluated	
Loss on Ignition (%) _D	A-T-030	N	N	5.2	-	-	10	
Total Organic Carbon (%) _D	A-T-032	N	N	0.52	3	5	6	
PAH Sum of 17 (mg/kg) _A	A-T-019	N	N	<0.08	100	-	-	
Mineral Oil (mg/kg) _{A EH_CU_ID_AL}	A-T-007	N	N	<20	500	-	-	
Sum of 7 PCBs (mg/kg) _A	A-T-004	N	N	<0.007	1	-	-	
Sum of BTEX (mg/kg) _A	A-T-022	N	N	<0.01	6	-	-	
Eluate Analysis				10:1 mg/l	10:1 mg/kg	Limit values for compliance leaching test using BS EN 12457-2 at L/S 10 l/kg (mg/kg)		
Arsenic	A-T-025	N	N	<0.001	<0.01	0.5	2	25
Barium	A-T-025	N	N	0.015	0.150	20	100	300
Cadmium	A-T-025	N	N	<0.001	<0.01	0.04	1	5
Chromium	A-T-025	N	N	<0.001	<0.01	0.5	10	70
Copper	A-T-025	N	N	<0.004	<0.04	2	50	100
Mercury	A-T-025	N	N	<0.0005	<0.005	0.01	0.2	2
Molybdenum	A-T-025	N	N	<0.001	<0.01	0.5	10	30
Nickel	A-T-025	N	N	<0.002	<0.02	0.4	10	40
Lead	A-T-025	N	N	<0.001	<0.01	0.5	10	50
Antimony	A-T-025	N	N	<0.001	<0.01	0.06	0.7	5
Selenium	A-T-025	N	N	<0.001	<0.01	0.1	0.5	7
Zinc	A-T-025	N	N	0.004	0.040	4	50	200
Chloride	A-T-026	N	N	<1.00	<10	800	15000	25000
Fluoride	A-T-026	N	N	1.0	10.0	10	150	500
Sulphate as SO ₄	A-T-026	N	N	50	504	1000	20000	50000
Total Dissolved Solids	A-T-035	N	N	118	1180	4000	60000	100000
Phenol Index	A-T-050	N	N	<0.01	<0.1	1	-	-
Dissolved Organic Carbon	A-T-032	N	N	<2.0	<200	500	800	1000
Leach Test Information								
pH (pH Units)	A-T-031	N	N	8.1				
Conductivity (µS/cm)	A-T-037	N	N	237				
Mass Sample (kg)				0.22				
Dry Matter (%)	A-T-044	N	N	79.4				
Stated acceptance limits are for guidance only and Envirolab cannot be held responsible for any discrepancies with current legislation								

Sample Details								
Lab Sample ID	Method	ISO17025	MCERTS	23/00393/3	Landfill Waste Acceptance Criteria Limits			
Client Sample Number					Inert Waste Landfill	Stable Non-reactive Hazardous Waste in Non-Hazardous Landfill	Hazardous Waste Landfill	
Client Sample ID				WS7				
Depth to Top				1				
Depth to Bottom								
Date Sampled				16/01/2023				
Sample Type				Soil - ES				
Sample Matrix Code				3				
Solid Waste Analysis								
pH (pH Units) _D	A-T-031	N	N	8.56	-	>6	-	
ANC to pH 4 (mol/kg) _D	A-T-ANC	N	N	1.67	-	to be evaluated	to be evaluated	
ANC to pH 6 (mol/kg) _D	A-T-ANC	N	N	0.3	-	to be evaluated	to be evaluated	
Loss on Ignition (%) _D	A-T-030	N	N	4.8	-	-	10	
Total Organic Carbon (%) _D	A-T-032	N	N	0.68	3	5	6	
PAH Sum of 17 (mg/kg) _A	A-T-019	N	N	<0.08	100	-	-	
Mineral Oil (mg/kg) _{A EH_CU_1D_AL}	A-T-007	N	N	<20	500	-	-	
Sum of 7 PCBs (mg/kg) _A	A-T-004	N	N	<0.007	1	-	-	
Sum of BTEX (mg/kg) _A	A-T-022	N	N	<0.01	6	-	-	
Eluate Analysis				10:1 mg/l	10:1 mg/kg	Limit values for compliance leaching test using BS EN 12457-2 at L/S 10 l/kg (mg/kg)		
Arsenic	A-T-025	N	N	<0.001	<0.01	0.5	2	25
Barium	A-T-025	N	N	0.017	0.170	20	100	300
Cadmium	A-T-025	N	N	<0.001	<0.01	0.04	1	5
Chromium	A-T-025	N	N	<0.001	<0.01	0.5	10	70
Copper	A-T-025	N	N	<0.004	<0.04	2	50	100
Mercury	A-T-025	N	N	<0.0005	<0.005	0.01	0.2	2
Molybdenum	A-T-025	N	N	0.002	0.020	0.5	10	30
Nickel	A-T-025	N	N	<0.002	<0.02	0.4	10	40
Lead	A-T-025	N	N	<0.001	<0.01	0.5	10	50
Antimony	A-T-025	N	N	<0.001	<0.01	0.06	0.7	5
Selenium	A-T-025	N	N	<0.001	<0.01	0.1	0.5	7
Zinc	A-T-025	N	N	<0.002	<0.02	4	50	200
Chloride	A-T-026	N	N	3	30	800	15000	25000
Fluoride	A-T-026	N	N	1.1	11.0	10	150	500
Sulphate as SO ₄	A-T-026	N	N	69	695	1000	20000	50000
Total Dissolved Solids	A-T-035	N	N	137	1370	4000	60000	100000
Phenol Index	A-T-050	N	N	<0.01	<0.1	1	-	-
Dissolved Organic Carbon	A-T-032	N	N	<2.0	<200	500	800	1000
Leach Test Information								
pH (pH Units)	A-T-031	N	N	8.1				
Conductivity (µS/cm)	A-T-037	N	N	275				
Mass Sample (kg)				0.221				
Dry Matter (%)	A-T-044	N	N	79.3				
Stated acceptance limits are for guidance only and Envirolab cannot be held responsible for any discrepancies with current legislation								

APPENDIX C

Geotechnical Test Results

TEST REPORT

Client BEK Enviro Ltd

Address Suite One
No. 3 Mitton Road Business Park
Mitton Road
Whalley
Lancashire
BB7 9YE

Contract CNG Hinckley

Job Number MRN 4627/3
Date of Issue 01 February 2023
Page 1 of 4

Approved Signatories

S J Hutchings, O P Davies

Notes

- 1 All remaining samples and remnants from this contract will be disposed 28 days from the date of this report unless you notify us to the contrary.
- 2 Result certificates, in this report, not bearing a UKAS mark, are not included in our UKAS accreditation schedule.
- 3 Opinions and interpretations expressed herein are outside the scope of our UKAS accreditation.
- 4 Certified that the samples have been examined and tested in accordance with the terms of the contract/order and unless otherwise stated conform to the standards/specifications quoted.
- 5 The results included within the report are representative of the samples submitted for analysis.
- 6 This certificate should not be reproduced, except in full, without the express permission of the laboratory.



Andrew House, Hadfield Street, Dukinfield, Cheshire SK16 4QX Tel: 0161 475 0870
Email: enquiries@murrayrix.com Website: www.murrayrix.com

Also at: London: 020 8523 1999

Murray Rix is the trading name of Murray Rix (Northern) Limited. Registered in England 2878361

MURRAY RIX

ANDREW HOUSE, HADFIELD STREET,
DUKINFIELD, CHESHIRE SK16 4QX
TEL 0161 475 0870



TEST CERTIFICATE

LIQUID LIMIT BS EN ISO 17892-12:2018+A1:2021 Clause 5.3 (30° FALL CONE) 1 POINT METHOD

PLASTIC LIMIT BS EN ISO 17892-12:2018+A1:2021 Clause 5.5

WATER CONTENT METHOD BS EN ISO 17892-1:2014


CLIENT	BEK Enviro Ltd
SITE	CNG Hinckley
JOB NUMBER	MRN 4627/3

SAMPLE LABEL	WS1 (1.5-2m)	DATE SAMPLED	16-Jan-23
SAMPLE No.	120591	DATE RECEIVED	23-Jan-23
DATE TESTED	23-Jan-23	SAMPLED BY	Client

MATERIAL	Stiff grey brown silty slightly sandy CLAY		
ADVISED SOURCE	Site Investigation Sample	WATER CONTENT	Increasing
SAMPLE HISTORY	Natural State	% RET. 425um BY	Wet Sieved

Test Readings mm (average)		Moisture Content %	Correction Factor	Correction factor from Clayton and Jukes 1978
Determination 1 (avg)	18.6	63.9	1.023	
Determination 2 (avg)	18.9	63.9		

Natural Moisture Content (%)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Passing 425 micron (%)
28.9	65	26	39	100

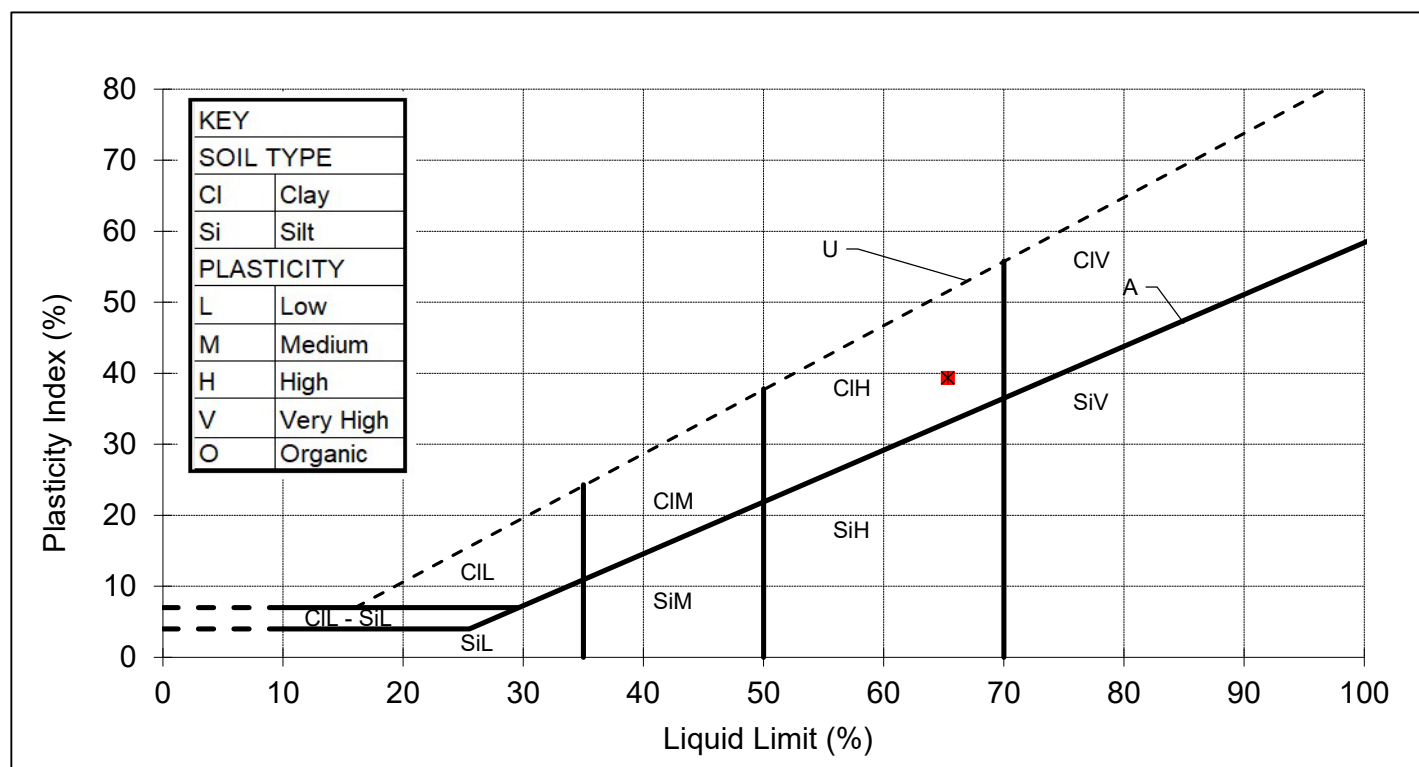

REMARKS

SIGNED

NAME

O.P. Davies BA (Hons)
(Laboratory Manager)

DATE

01-Feb-23

MURRAY RIX

ANDREW HOUSE, HADFIELD STREET,
DUKINFIELD, CHESHIRE SK16 4QX
TEL 0161 475 0870



TEST CERTIFICATE

LIQUID LIMIT BS EN ISO 17892-12:2018+A1:2021 Clause 5.3 (30° FALL CONE) 1 POINT METHOD

PLASTIC LIMIT BS EN ISO 17892-12:2018+A1:2021 Clause 5.5

WATER CONTENT METHOD BS EN ISO 17892-1:2014


CLIENT	BEK Enviro Ltd
SITE	CNG Hinckley
JOB NUMBER	MRN 4627/3

SAMPLE LABEL	WS3 (2.0-2.5m)	DATE SAMPLED	16-Jan-23
SAMPLE No.	120592	DATE RECEIVED	23-Jan-23
DATE TESTED	23-Jan-23	SAMPLED BY	Client

MATERIAL	Stiff grey brown silty slightly sandy CLAY		
ADVISED SOURCE	Site Investigation Sample	WATER CONTENT	Increasing
SAMPLE HISTORY	Natural State	% RET. 425um BY	Wet Sieved

Test Readings mm (average)		Moisture Content %	Correction Factor	Correction factor from Clayton and Jukes 1978
Determination 1 (avg)	19.0	65.0	1.018	
Determination 2 (avg)	19.0	65.0		

Natural Moisture Content (%)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Passing 425 micron (%)
29.8	66	25	41	100

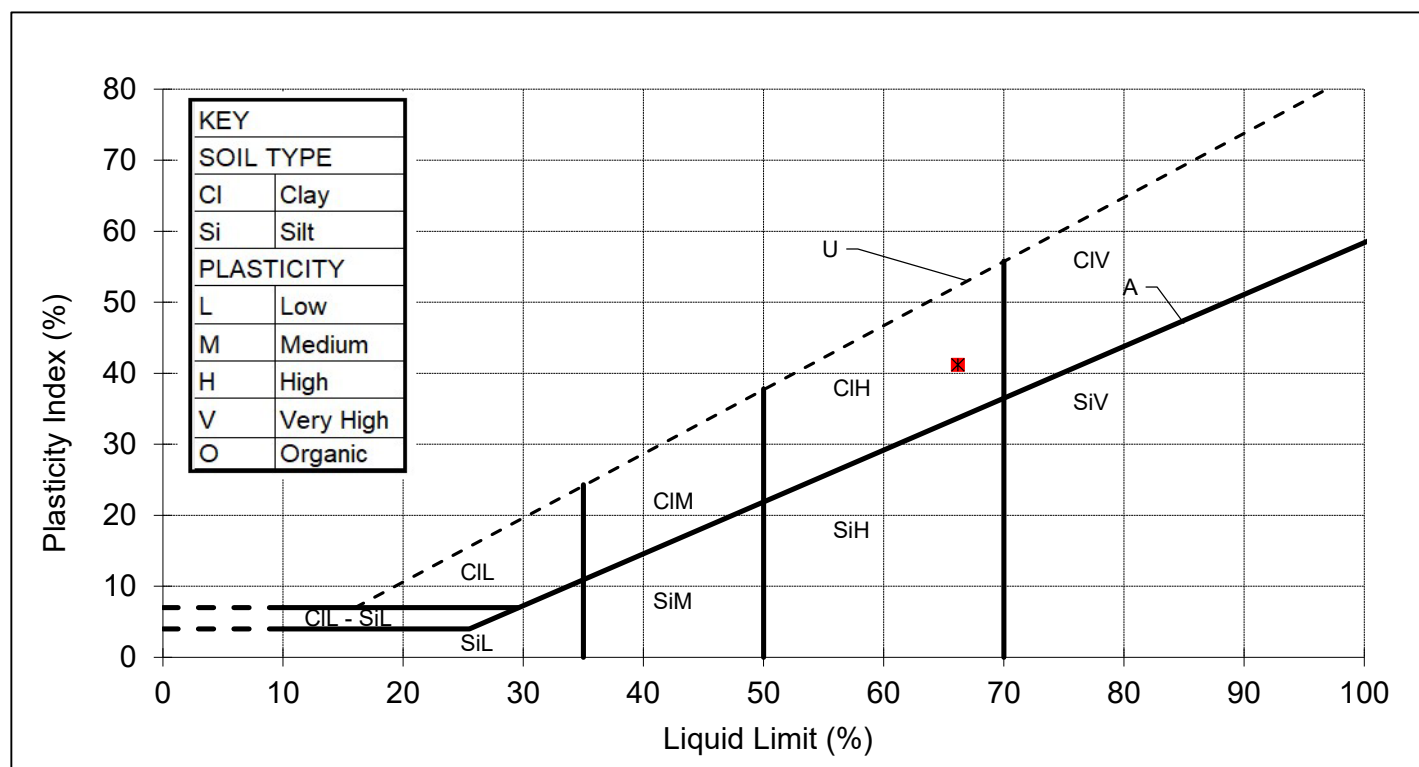

REMARKS

SIGNED

NAME

O.P. Davies BA (Hons)
(Laboratory Manager)

DATE

01-Feb-23

MURRAY RIX

ANDREW HOUSE, HADFIELD STREET,
DUKINFIELD, CHESHIRE SK16 4QX
TEL 0161 475 0870



TEST CERTIFICATE

LIQUID LIMIT BS EN ISO 17892-12:2018+A1:2021 Clause 5.3 (30° FALL CONE) 1 POINT METHOD

PLASTIC LIMIT BS EN ISO 17892-12:2018+A1:2021 Clause 5.5

WATER CONTENT METHOD BS EN ISO 17892-1:2014


CLIENT	BEK Enviro Ltd
SITE	CNG Hinckley
JOB NUMBER	MRN 4627/3

SAMPLE LABEL	WS7 (1.0-1.5m)	DATE SAMPLED	16-Jan-23
SAMPLE No.	120593	DATE RECEIVED	23-Jan-23
DATE TESTED	23-Jan-23	SAMPLED BY	Client

MATERIAL	Stiff grey brown silty slightly sandy CLAY		
ADVISED SOURCE	Site Investigation Sample	WATER CONTENT	Increasing
SAMPLE HISTORY	Natural State	% RET. 425um BY	Wet Sieved

Test Readings mm (average)		Moisture Content %	Correction Factor	Correction factor from Clayton and Jukes 1978
Determination 1 (avg)	19.7	63.7	1.007	
Determination 2 (avg)	19.6	63.2		

Natural Moisture Content (%)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Passing 425 micron (%)
29.8	64	26	38	100

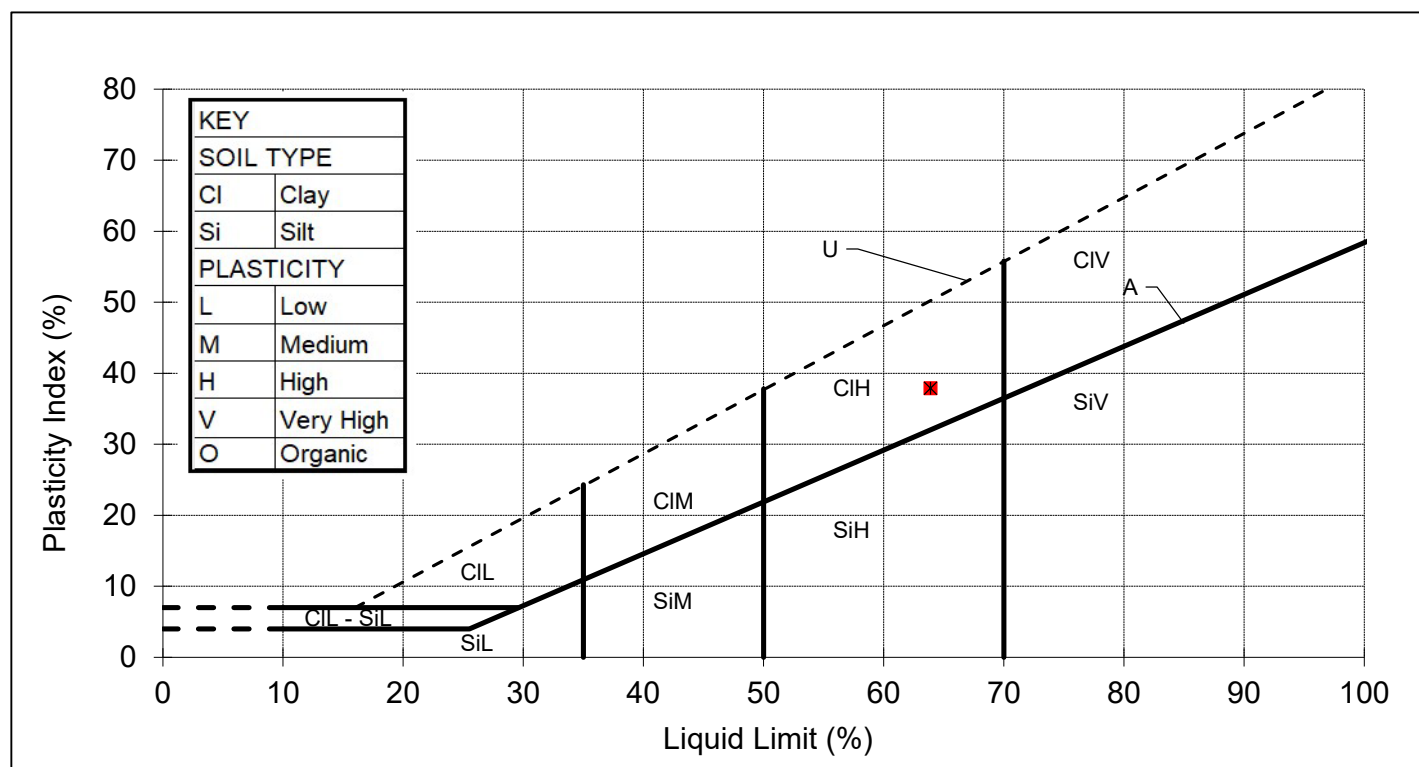

REMARKS

SIGNED

NAME


O.P. Davies BA (Hons)
(Laboratory Manager)

DATE

01-Feb-23

APPENDIX D

Drawings

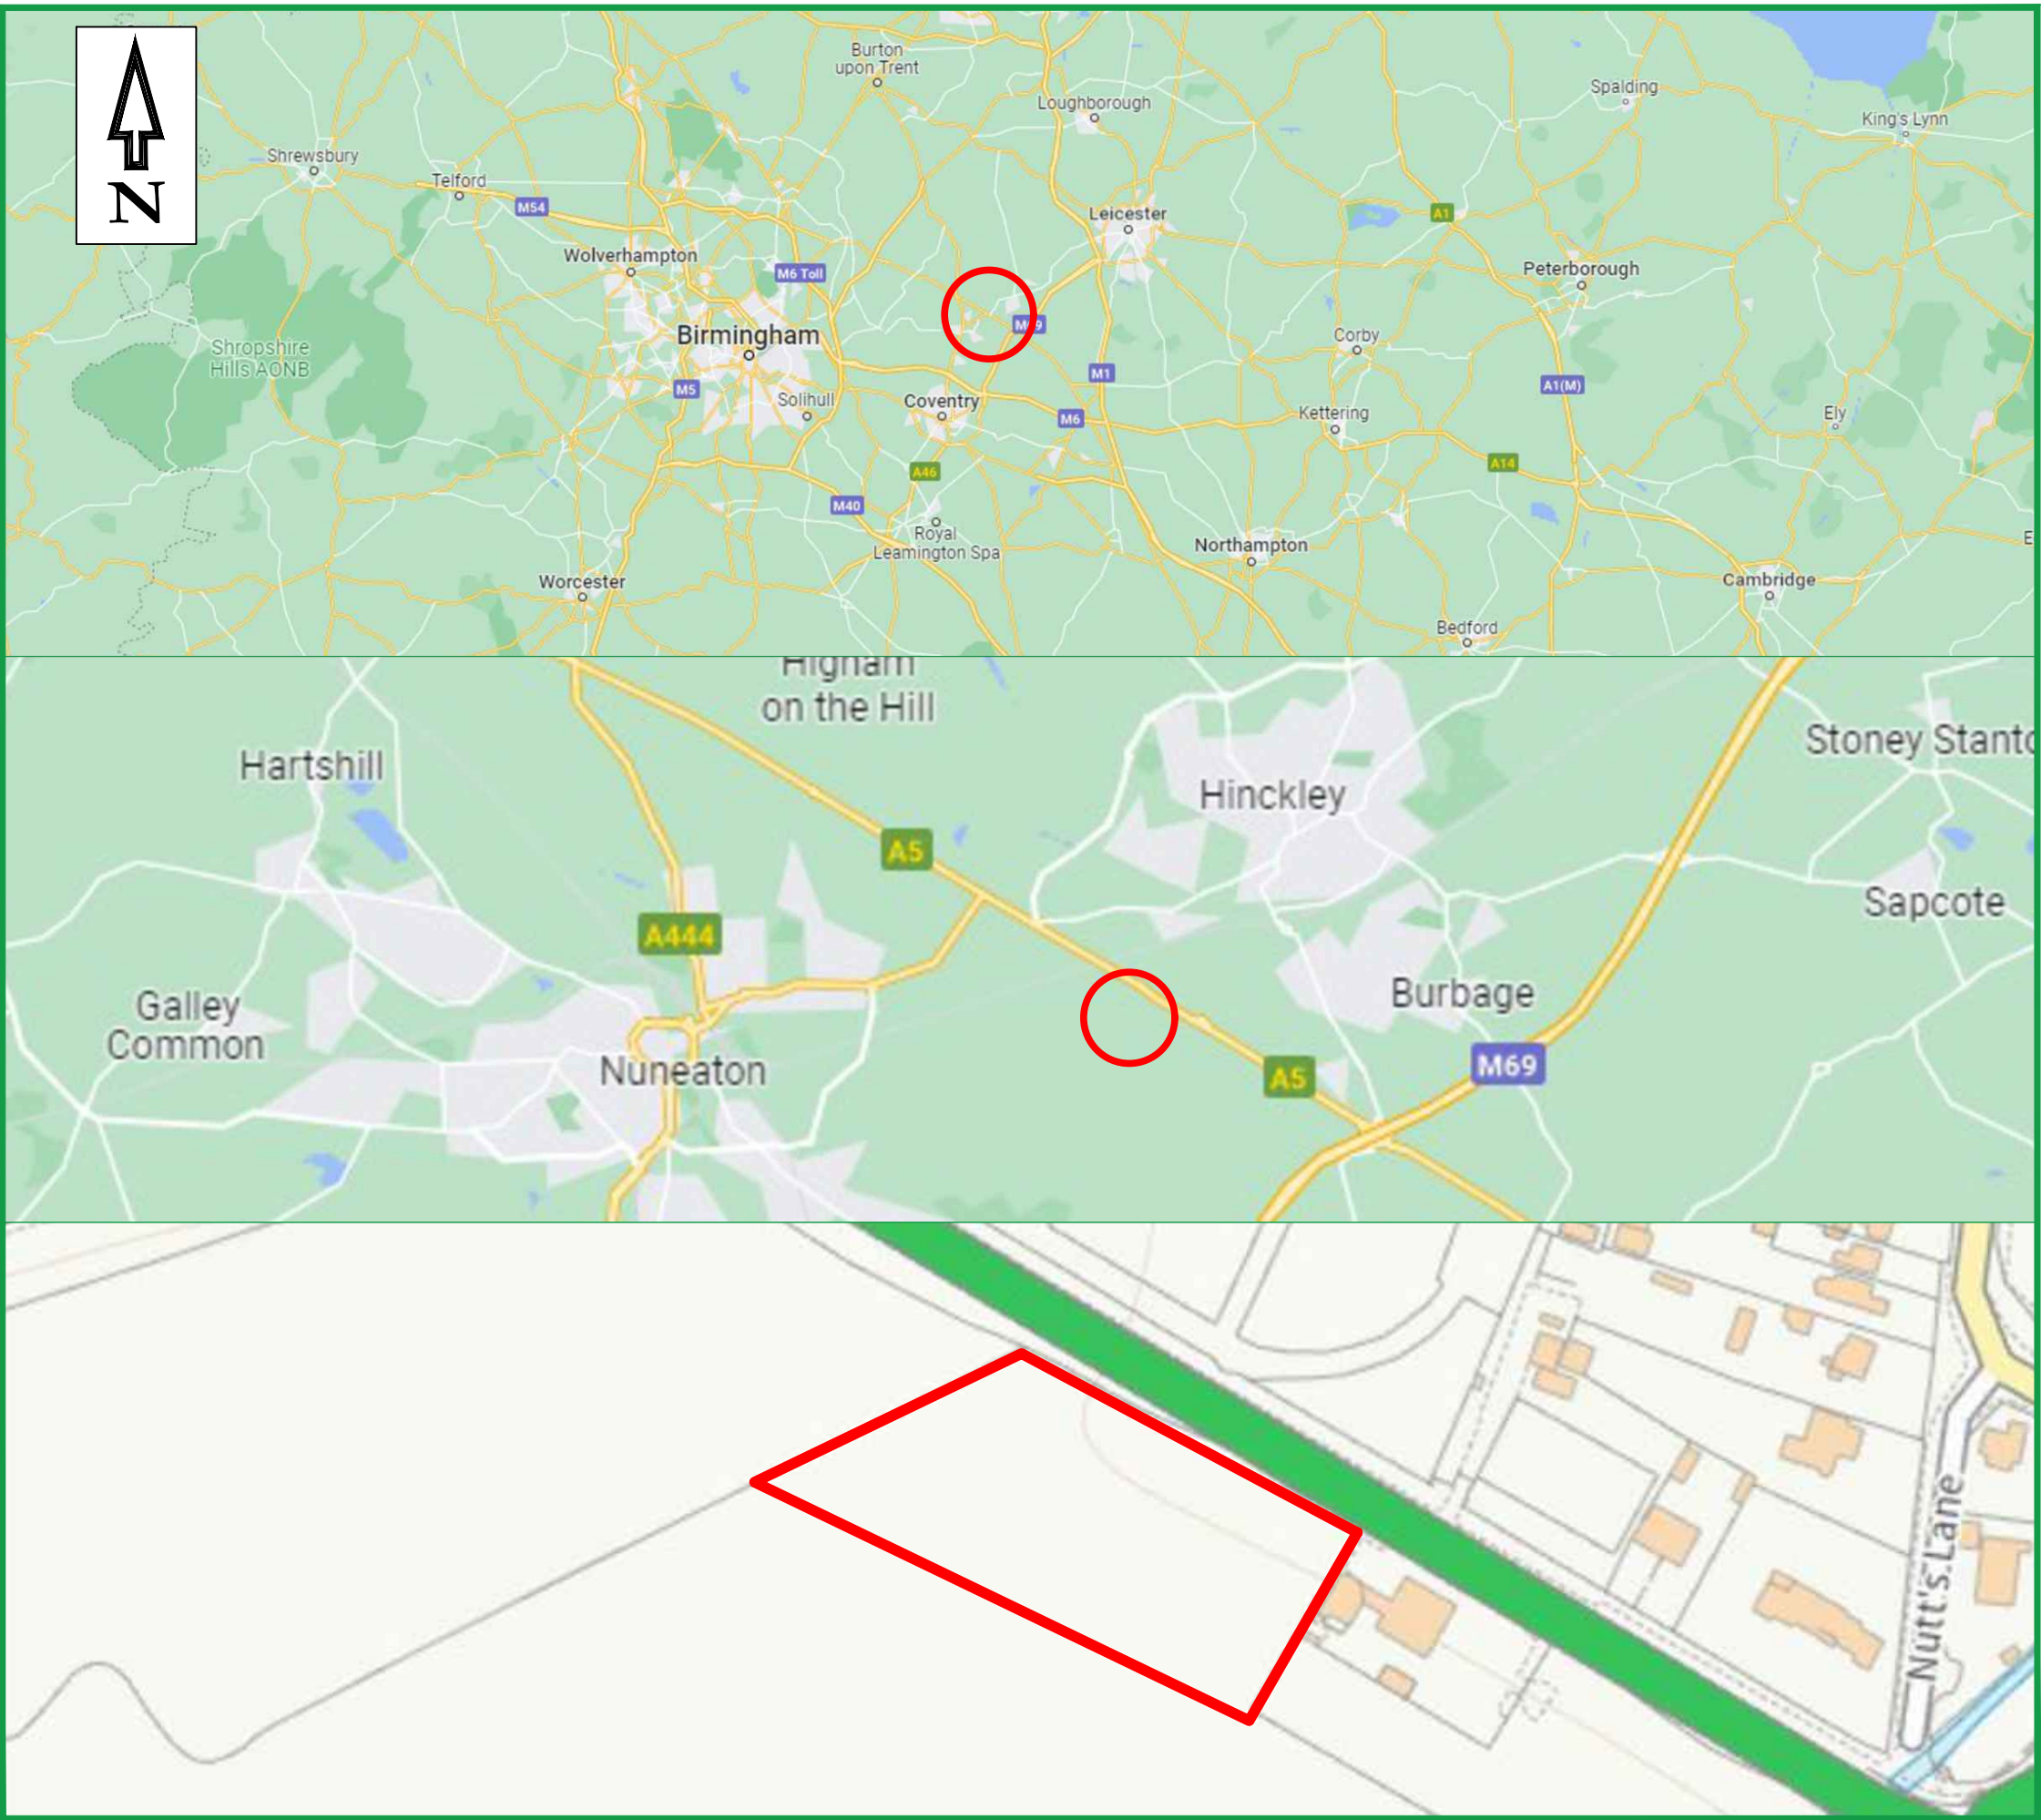

LEGEND

— SITE LOCATION

REV	DESCRIPTION	DATE	BY



GEO-ENVIRONMENTAL CONSULTING ENGINEERS
Suite One, No 3 Mitton Road Business Park,
Mitton Road, Whalley, Lancashire, BB7 9YE
Tel: 01254 377 622
Email: mbuckley@bekenviro.co.uk
Web: www.bekenviro.co.uk

CLIENT.
CNG FUELS LTD

JOB TITLE.
LAND SOUTH OF A5 WATLING STREET, HINCKLEY

DRAWING TITLE.
SITE LOCATION PLAN

SCALE © A3. N'TS	DRAWN BY. D.E.	APPROVED BY. M.B.	DATE. 31/01/23
DRAWING No. 23005-1			REV. -



LEGEND

— SITE FOOTPRINT

REV	DESCRIPTION	DATE	BY



GEO-ENVIRONMENTAL CONSULTING ENGINEERS
Suite One, No 3 Mitton Road Business Park,
Mitton Road, Whalley, Lancashire, BB7 9YE
Tel: 01254 377 622
Email: mbuckley@bekenviro.co.uk
Web: www.bekenviro.co.uk

CLIENT.

CNG FUELS LTD

JOB TITLE.

LAND SOUTH OF A5 WATLING STREET, HINCKLEY

DRAWING TITLE.

SITE LAYOUT PLAN

SCALE @ A3. NTS	DRAWN BY. D.E.	APPROVED BY. M.B.	DATE. 31/01/23
DRAWING No. 23005-2			REV. -



LEGEND

 WINDOW SAMPLE BOREHOLE

 INFILTRATION TEST LOCATION

REV	DESCRIPTION	DATE	BY



GEO-ENVIRONMENTAL CONSULTING ENGINEERS
Suite One, No 3 Mitton Road Business Park,
Mitton Road, Whalley, Lancashire, BB7 9YE
Tel: 01254 377 622
Email: mbuckley@bekenviro.co.uk
Web: www.bekenviro.co.uk

CLIENT.	CNG FUELS LTD
---------	---------------

JOB TITLE.	LAND SOUTH OF A5 WATLING STREET, HINCKLEY
------------	---

DRAWING TITLE.	SITE INVESTIGATION PLAN
----------------	-------------------------

SCALE @ A3. NTS	DRAWN BY. D.E.	APPROVED BY. M.B.	DATE. 31/01/23
DRAWING No. 23005-3	REV. -		



PLANNING ISSUE

REVISIONS:				
REV	DESCRIPTION	DATE	CHK	APP
A	PRE APP PLANNING ISSUE	24-10-22	MS	MS
B	PRE APP PLANNING ISSUE	11-04-23	MS	MS
C	PLANNING ISSUE	05-05-23	MS	MS
D	PLANNING ISSUE	11-05-23	MS	MS
E	PLANNING ISSUE	17-05-23	MS	MS
F	PLANNING ISSUE	19-05-23	MS	MS
G	PLANNING ISSUE	12-09-23	MS	MS
H	PLANNING ISSUE	23-02-24	MS	MS
I	PLANNING ISSUE	28-02-24	MS	MS
J	PLANNING ISSUE	29-02-24	MS	MS

NOTES.

1. TO BE READ IN CONJUNCTION WITH PROPOSED SITE ELEVATION VIEWS. DRG. No. 042-01-CNG-105

KEY

	PROPOSED CNG STATION REDLINE BOUNDARY
	SECURITY PALISADE FENCE 2.4m HIGH
	SITE BOUNDARY FENCE V MESH IN BLACK 2.4m HIGH
	SITE BOUNDARY FENCE CLOSE BOARDED TIMBER 2.4m HIGH
	SURFACE CHANNEL FOR BELOW GROUND PIPE ROUTING.
	CRASH BARRIER
	NEW TREES
	PROPOSED GRASSED LANDSCAPED AREA
	PROPOSED HEDGEROW
	EXISTING LEYLANDII TREES
	EXISTING HEDGEROW
	EXISTING TREE / VEGETATION ROAD SCREENING

CLIENT:	
PROJECT:	
HINCKLEY CNG STATION WATLING STREET	
TITLE:	
PROPOSED CNG STATION SITE LAYOUT PLAN	
SCALE: 1:500	@ A3
CHECKED: MS	CAD:
APPROVED: MS	DATE: 11-10-2022
	SHEET: 1 OF 1
PROJECT No: 042	
DRAWING No: 042-01-CNG-104	
REVISION: J	
THOMAS HOUSE 84 ECCLESTON SQUARE LONDON SW1V 1PX TEL: 0203 961 9925 WEB: www.cngfuels.com	

