




LV AC/DC CABLE TRENCH IN OPEN
GROUND SINGLE CIRCUIT

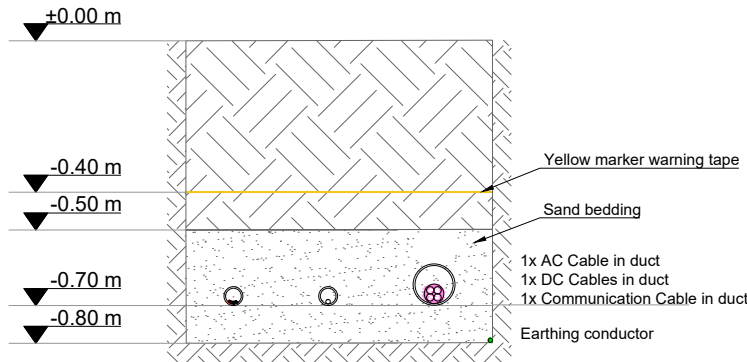


LV AC/DC CABLE TRENCH IN OPEN
GROUND TWIN CIRCUIT

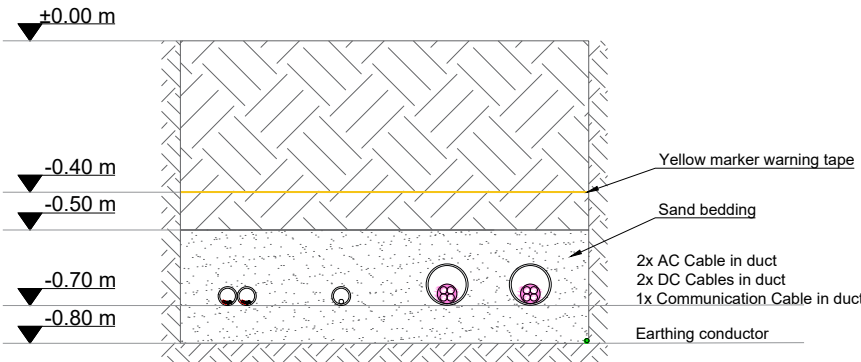


LV DC CABLE TRENCH IN OPEN
GROUND SINGLE CIRCUIT

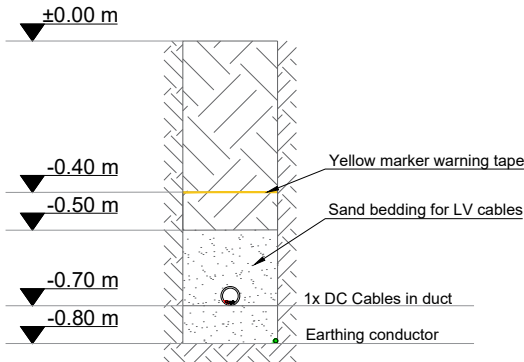

LV DC CABLE TRENCH IN OPEN
GROUND SINGLE CIRCUIT

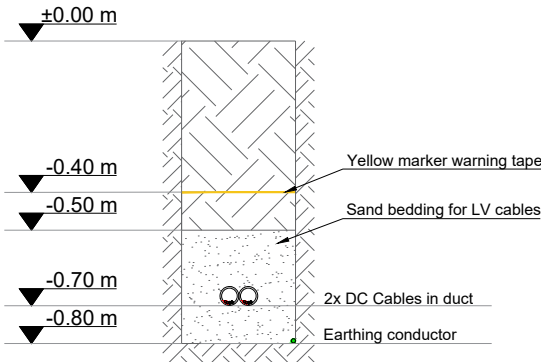

MV CABLE TRENCH IN OPEN GROUND
SINGLE CIRCUIT

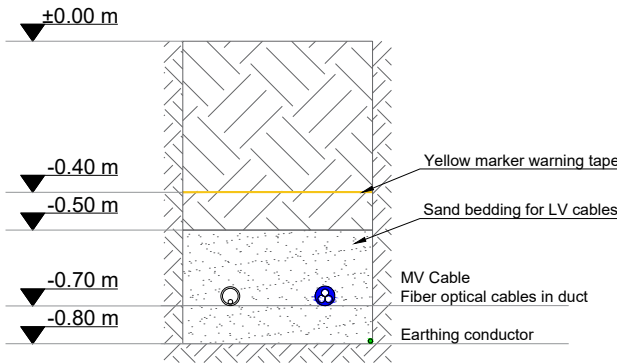

Notes:

1. All dimensions to be confirmed on site prior to installation.
2. All dimensions are indicative only and in mm unless otherwise specified.
3. Distances that needs to be site specific and decided by subcontractor.

Revisions:

Rev	Date	Comments	Drawn	Approve
0	09/08/24	First issue	IV	NM
1	08/07/25	Layout updates	GU	GU

Project: Heath Road
Location: Heath Road and Merry Lees,
Bagworth, LE9 9NR,
UK
52.648197°, -1.329302°
Title: Trench section details

Drawn: Detra Solar / GU Checked: AM
Scale: 1:20@A3 Date: 08/07/25
Drawing No: RCN1008-210 Rev: 1

 Renewable Connections
3rd floor, 141-145 Curtain Road
London, EC2A 3BX
+44 (0)20 7749 2650
www.renewableconnections.co.uk

 Detra Solar
Lvovo str. 25-104,
LT-09320 Vilnius
www.detrasolar.com

Do not scale from this drawing. Site verify all dimensions prior to construction. Report all discrepancies to the drawing originator immediately. This drawing is to be read in conjunction with all relevant documents and drawings.