


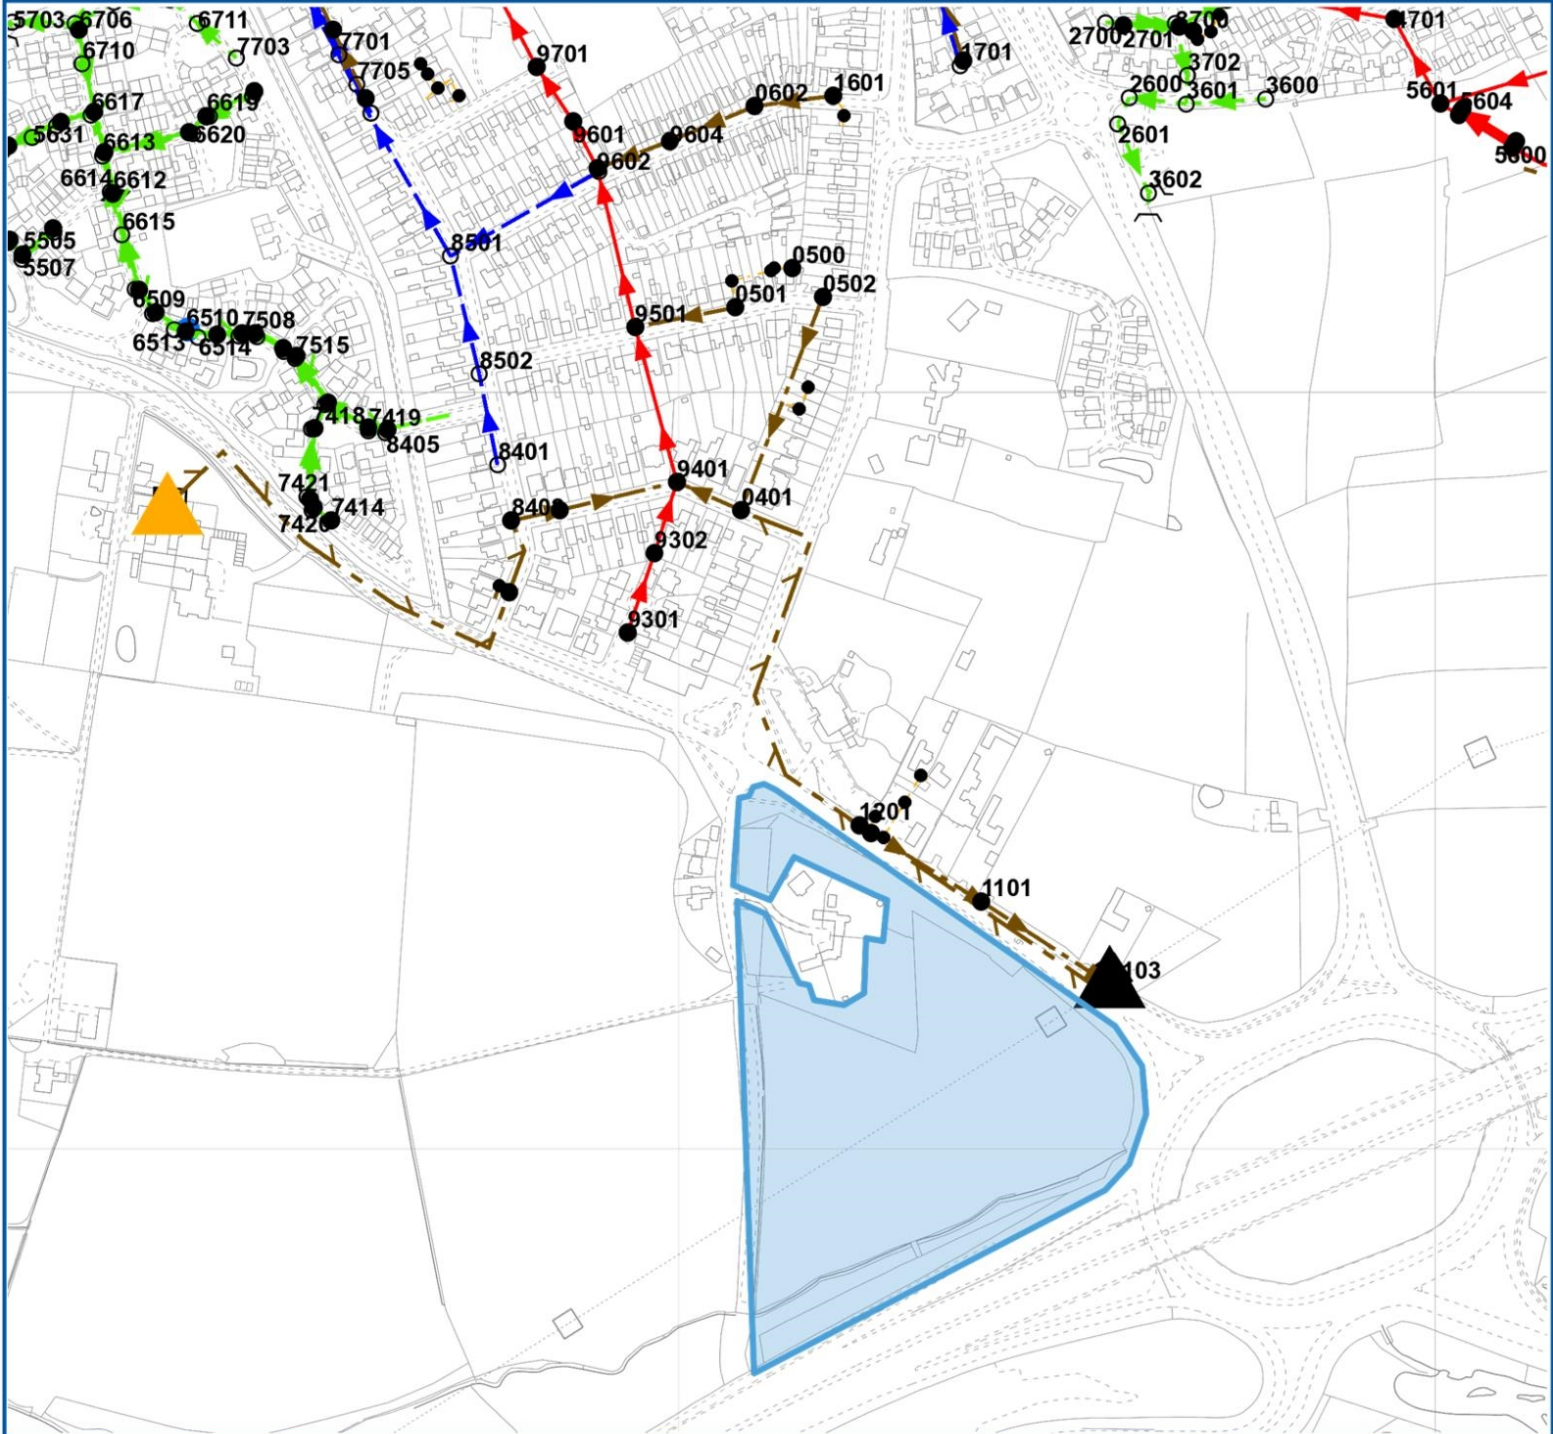

Reference	Cover Level	Invert Level Upstream	Invert Level Downstream	Purpose	Material	Pipe Shape	Max Size	Min Size	Gradient	Year Laid
SP42916617	116.85	113.113	113.031	S	U	C	600	<UNK>	289.421	01/03/2018 00:00:00
SP42917415	119.905	117.953	117.501	F	U	C	100	<UNK>	12.96	01/03/2018 00:00:00
SP43913602	<UNK>	<UNK>	<UNK>	S	<UNK>	<UNK>	<UNK>	<UNK>	<UNK>	31/12/1899 00:00:00
SP43913602	<UNK>	<UNK>	<UNK>	S	<UNK>	<UNK>	<UNK>	<UNK>	<UNK>	31/12/1899 00:00:00
SP42916619	119.48	117.6	117.3	F	U	C	150	<UNK>	51.847	01/03/2018 00:00:00
SP42917417	118.65	116.622	116.405	S	U	C	450	<UNK>	166.567	01/03/2018 00:00:00
SP43910500	<UNK>	<UNK>	<UNK>	F	U	U	150	<UNK>	<UNK>	31/12/1899 00:00:00
SP42916614	118.24	114.318	113.202	S	U	C	300	<UNK>	21.763	01/03/2018 00:00:00
SP42918501	121.4499	119.65	118.42	S	VC	C	300	<UNK>	123.79	31/12/1899 00:00:00
SP43911201	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
<UNK>	<UNK>	<UNK>	<UNK>	S	<UNK>	<UNK>	<UNK>	<UNK>	<UNK>	31/12/1899 00:00:00
SP42919603	122.3499	121.37	119.84	S	VC	C	150	<UNK>	73.77	31/12/1899 00:00:00
SP42916621	119.5	118.003	117.82	S	U	C	300	<UNK>	85.88	01/03/2018 00:00:00
SP43913601	<UNK>	<UNK>	<UNK>	S	<UNK>	<UNK>	<UNK>	<UNK>	<UNK>	31/12/1899 00:00:00
SP42917511	118.14	115.983	115.912	F	U	C	150	<UNK>	144.437	01/03/2018 00:00:00
SP42917513	117.88	116.052	115.705	S	U	C	525	<UNK>	34.476	01/03/2018 00:00:00
SP43910502	122.5999	121.82	120.04	F	VC	C	150	<UNK>	84.83	31/12/1899 00:00:00
SP43915605	120.493	<UNK>	<UNK>	C	PE	C	1800	<UNK>	<UNK>	25/01/2017 00:00:00
SP42916512	116.86	114.605	114.54	S	U	C	600	<UNK>	300.123	01/03/2018 00:00:00
SP42919402	122.25	120.96	119.77	F	VC	C	150	<UNK>	67.08	31/12/1899 00:00:00
SP43915602	119.97	116.645	116.43	C	PE	C	1800	<UNK>	<UNK>	25/01/2017 00:00:00
SP43915602	119.97	<UNK>	<UNK>	C	PE	C	1800	<UNK>	<UNK>	25/01/2017 00:00:00
SP42919701	<UNK>	<UNK>	<UNK>	C	<UNK>	<UNK>	<UNK>	<UNK>	0	31/12/1899 00:00:00
SP43913702	<UNK>	<UNK>	<UNK>	S	<UNK>	<UNK>	<UNK>	<UNK>	<UNK>	31/12/1899 00:00:00
SP42917413	120.06	118.23	116.232	F	U	C	150	<UNK>	15.728	01/03/2018 00:00:00
SP42916508	117.2	113.79	113.353	F	U	C	150	<UNK>	150.957	01/03/2018 00:00:00
SP43910401	122.1699	120.04	119.76	F	VC	C	150	<UNK>	165.32	31/12/1899 00:00:00
SP43915606	120.574	<UNK>	<UNK>	C	PE	C	1800	<UNK>	<UNK>	25/01/2017 00:00:00
SP43911601	123.3499	121.81	120.79	F	VC	C	150	<UNK>	51.44	31/12/1899 00:00:00

LEGEND

Operational Site

Waste Water Pump

Transfered Asset

S24

S104

S102

Null Private

Null

None

Highway Drain

Adopted Sewer

Storage

DS

Disposal Site

Off-Line Waste Water Storage

On-Line Waste Water Storage

Wet Well

Waste Water Process Structure

Sewage Treatment Point

Sewage Treatment Structure

Sludge Treatment Point

Sludge Treatment Structure

Manhole

Foul Bifurcation Manhole

Combined Bifurcation Manhole

Surface Water Bifurcation Manhole

Dual Manhole

Foul Single Manhole

Combined Single Manhole

Surface Water Single Manhole

Twin Manhole

Foul Adopted Manhole

Combined Adopted Manhole

Surface Adopted Manhole

Transfered Manhole

Unsurveyed Manhole

Gravity Sewer Pipe

Foul Gravity Sewer

Combined Gravity Sewer

Surface Water Gravity Sewer

S104 Surface Water Gravity Sewer

S104 Combined Gravity Sewer

S104 Foul Gravity Sewer

Private Surface Water Gravity Sewer

Private Combined Gravity Sewer

Private Foul Gravity Sewer

Surface Water Unserved Pipe

Combined Unserved Pipe

Foul Vacuum Sewer

Combined Vacuum Sewer

S104 Surface Water Vacuum Sewer

S104 Combined Vacuum Sewer

S104 Foul Vacuum Sewer

Private Surface Water Vacuum Sewer

Private Combined Vacuum Sewer

Private Foul Vacuum Sewer

Surface Water Siphon

Combined Siphon

Foul Siphon

Private Surface Water Siphon

Private Combined Siphon

S104 Surface Water Siphon

S104 Combined Siphon

Surface Water Unserved Pipe

Combined Unserved Pipe

Foul Unserved Pipe

Disposal Pipe

Service Pipe

Surface Water Lateral Drain

Combined Lateral Drain

Foul Lateral Drain

Foul Unserved Pipe

Transfered Surface Water Sewer

Transfered Combined Sewer

Transfered Foul Sewer

Disposal Pipe

Overflow Pipe

Culverted Water Course

Waste Internal Site Pipe

Sewer Service Connection

Gravity Sewer Others

Pressure Sewer Pipe

Surface Water Pressure Sewer

Combined Pressure Sewer

Foul Pressure Sewer

S104 Surface Water Pressure Sewer

S104 Combined Pressure Sewer

S104 Foul Pressure Sewer

Private Surface Water Pressure Sewer

Private Combined Pressure Sewer

Private Foul Pressure Sewer

Surface Water Vacuum Sewer

Surface Water Lateral Drain

Lamp Post

Sewerage Air Valve

Sewerage Chemical Injection Point

Sewerage Hatch Box

Sewerage Pressure Washout

Vent Column

Waste Water Outfall

Control Valve

Hydrobrake

Pentstock

Sewerage Isolation Valve

Sewerage Non Return Valve

Print500mLine

Ancillary

Balancing Lagoon

Grease Trap

Interceptor

Screen

Chamber

Flushing Chamber

Scalaway

Overflow

Fitting

Blind Shaft

Facility Connector

Head Node

MATERIALS

- NONE
- AC - ASBESTOS CEME
- BR - BRICK
- CC - CONCRETE BOX CULVERT
- CI - CAST IRON
- CO - CONCRETE
- CSB - CONCRETE SEGMENTS (BOLTED)
- CSU - CONCRETE SEGMENTS (UNBOLTED)
- DI - DUCTILE IRON
- GRP - GLASS REINFORCED PLASTIC
- MAC - MASONRY IN REGULAR COURSES
- MAR - MASONRY RANDOMLY COURSED
- PE - POLYETHYLENE
- PF - PITCH
- PP - POLYPROPYLENE
- PSC - POLYVINYL CHLORIDE
- PVC - REINFORCED PLASTIC MATRIX
- RPM - SPUN (GREY) IRON
- SI - STEEL
- ST - UNKNOWN
- U - VITRIFIED CLAY
- VC - OTHER
- XXX

CATEGORIES

- W - WEIR
- C - CASCADE
- DB - DAMBOARD
- SE - SIDE ENTRY
- FV - FLAP VALVE
- BD - BACK DROP
- S - SIPHON
- D - HIGHWAY DRAIN
- S104 - SECTION 104

SHAPE

- C - CIRCULAR
- E - EGG SHAPED
- O - OTHER
- R - RECTANGLE
- S - SQUARE
- T - TRAPEZOIDAL
- U - UNKNOWN

PURPOSE

- C - COMBINED
- E - FINAL EFFLUENT
- F - FOUL
- L - SLUDGE
- S - SURFACE WATER



Severn Trent Water Limited
Asset Data Management
PO Box 5344
Coventry
CV3 9FT
Telephone: 0345 601 6616

SEWER RECORD (Tabular)

O/S Map Scale: 1:5,000

This map is centred upon:

Date of Issue: 11-08-23

X: 443082.03

Y: 291270.31

Disclaimer Statement

- 1 Do not scale off this Map.
- 2 This plan and any information supplied with it is furnished as a general guide, is only valid at the date of issue and no warranty as to its correctness is given or implied. In particular this plan and any information shown on it must not be relied upon in the event of any development or works (including but not limited to excavations) in the vicinity of SEVERN TRENT WATER assets or for the purposes of determining the suitability of a point of connection to the sewerage or distribution systems.
- 3 On 1 October 2011 most private sewers and private lateral drains in Severn Trent Water's sewerage area, which were connected to a public sewer as at 1 July 2011, transferred to the ownership of Severn Trent Water and became public sewers and public lateral drains. A further transfer takes place on 1 October 2012. Private pumping stations, which form part of these sewers or lateral drains, will transfer to ownership of Severn Trent Water on or before 1 October 2016. Severn Trent Water does not possess complete records of these assets. These assets may not be displayed on the map.
- 4 Reproduction by permission of Ordnance Survey on behalf of HMSO. Crown Copyright and database right 2004. All rights reserved.
- 5 Ordnance Survey licence number: 100031673
- 6 Document users other than SEVERN TRENT WATER business users are advised that this document is provided for reference purpose only and is subject to copyright, therefore, no further copies should be made from it.

