





EXISTING FRONT ELEVATION
1:100




EXISTING REAR ELEVATION
1:100

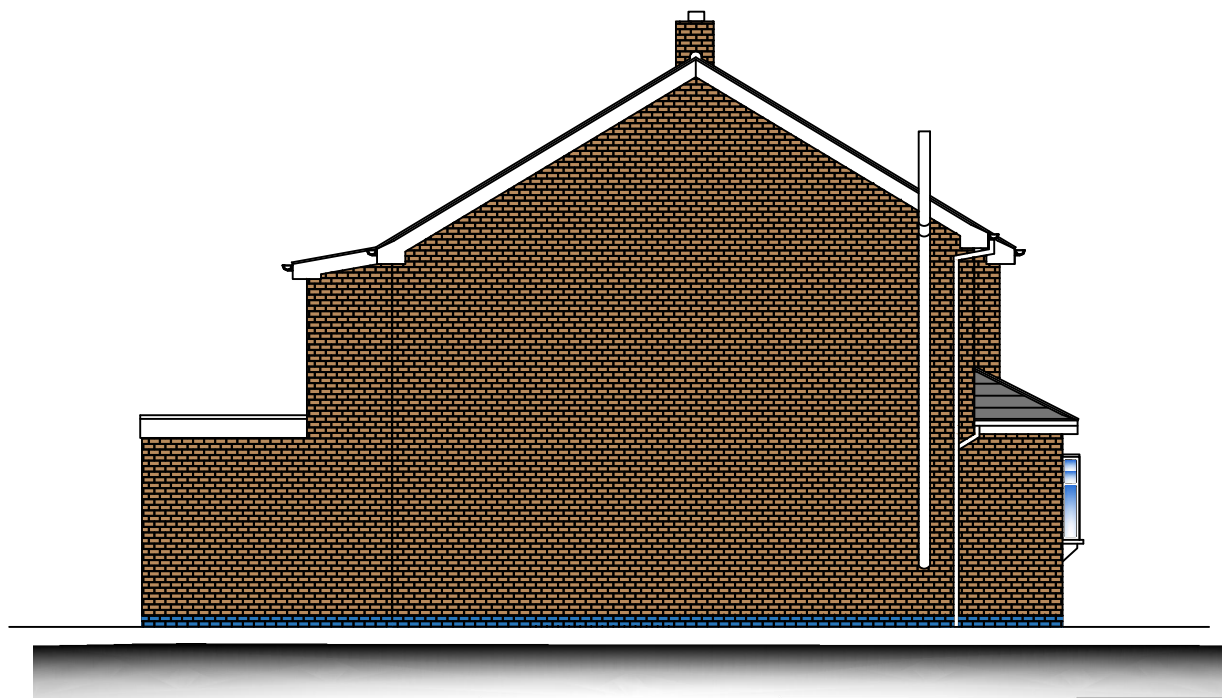


EXISTING SIDE ELEVATION
1:100

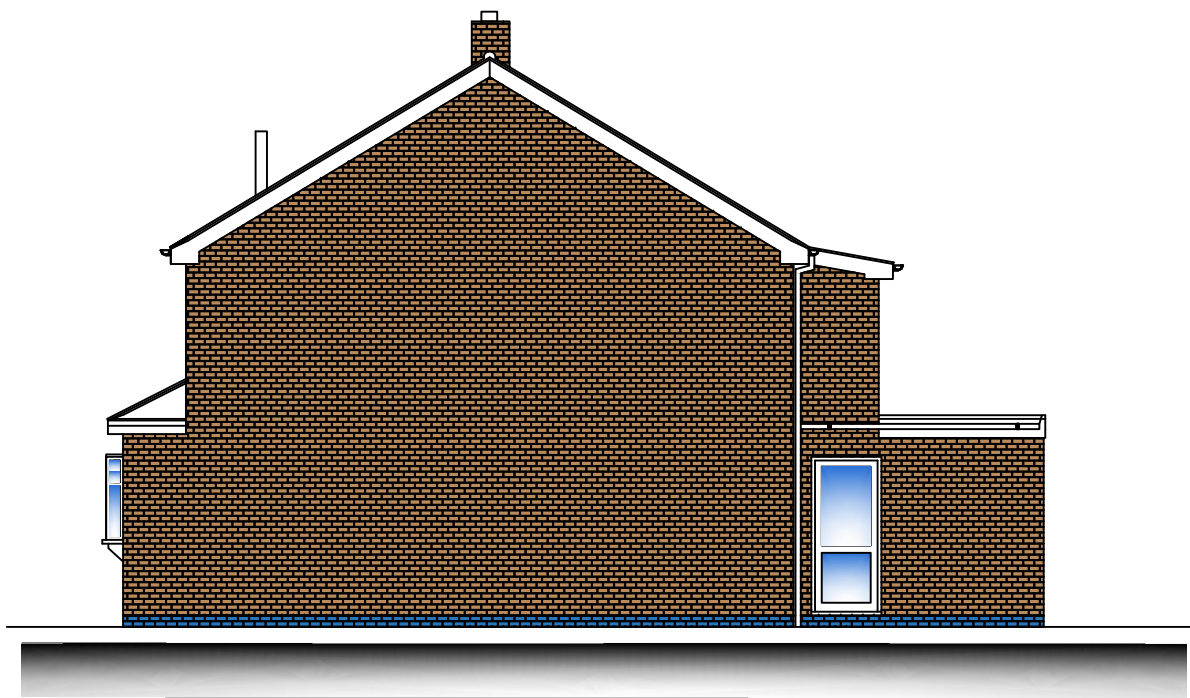


EXISTING SIDE ELEVATION
1:100

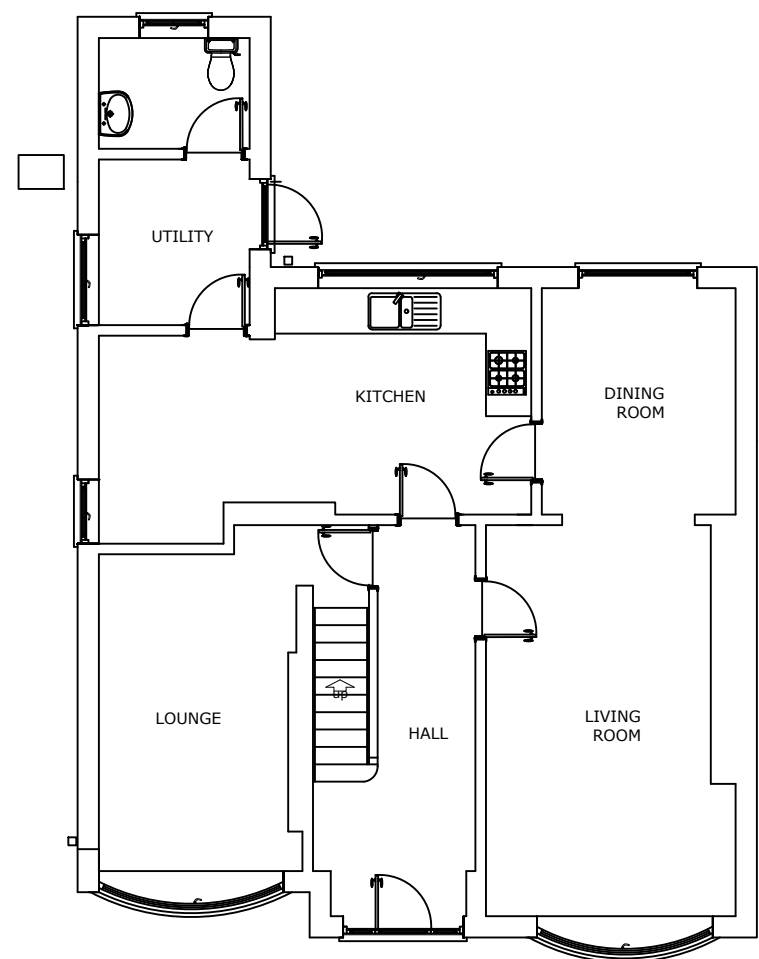

EXISTING GROUND FLOOR PLAN
1:100

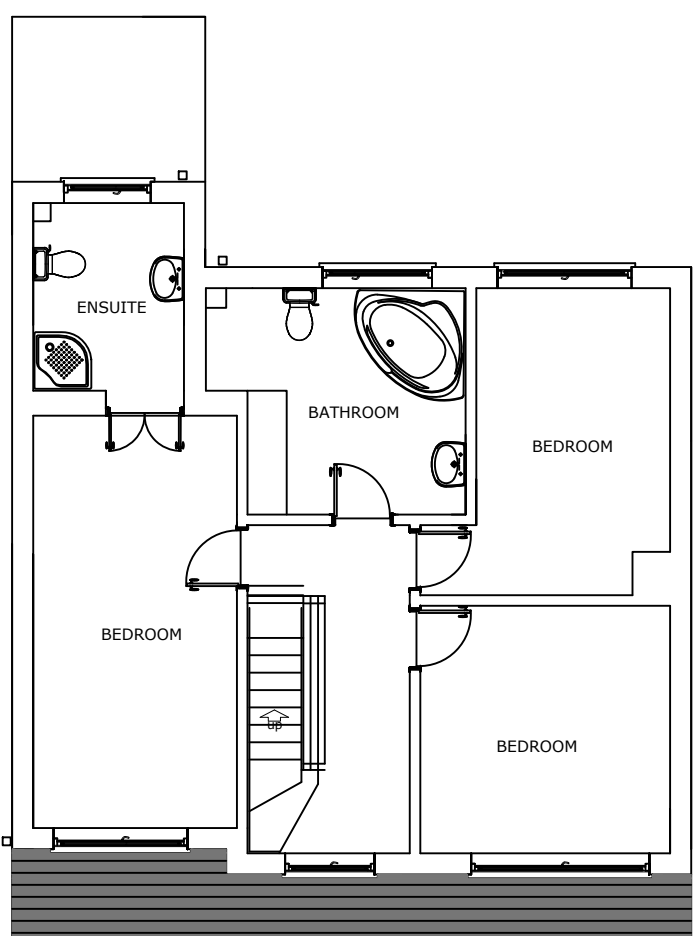

EXISTING FIRST FLOOR PLAN
1:100

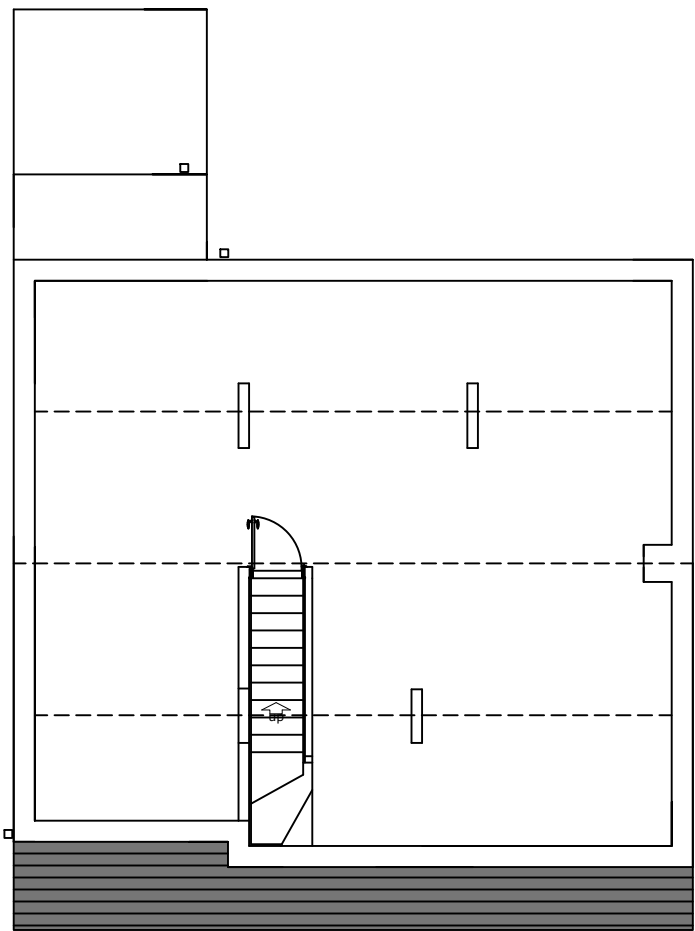

FOUNDATIONS.
NEW FOOTINGS TO BE 450-600 TRENCH FILL FOUNDATIONS, MINIMUM BASE DEPTH OF 1000 BELOW NATURAL GROUND LEVEL- STEP UP MAX 500-. OR TO BELOW INVERT OF ADJACENT DRAINS. OR TO THE BOTTOM OF EXISTING HOUSE FOUNDATIONS WHICHEVER IS THE LOWER. EXACT DEPTH TO BE AGREED ON SITE WITH BUILDING CONTROL INSPECTOR IN ACCORDANCE WITH NHBC CHAPTER DEPTHS DUE TO ANY TREES IN VICINITY. CONCRETE TO BE GEN 1 BS 5328 PT2.

EXTERNAL WALLS (U-VALUE <0.18 W/M²K)
WALLS TO BE RENDERED TO CLIENTS APPROVAL. 100 CAVITY WITH 100 UNILIN CAVITYTHERM OR SIMILAR INSULATION INSTALLED TO MANUFACTURERS INSTRUCTIONS. 100 TARMAC TOPLITE STANDARD BLOCKS OR SIMILAR. DRYLINE ALL WALLS WITH 12.5 'GYPROC' PLASTERBOARD ON DABS WITH TAPED JOINTS AND SKIM COAT. STAINLESS STEEL WALL TIES TO BS EN 845-1 (TABLE 5 AD A) @ 750 HORIZONTAL AND 450 MAX VERTICAL CENTRES STAGGERED AND EVERY 300 WITHIN 225 OF OPENINGS. POLYMER DPC TO BS 743 MINIMUM 150 ABOVE GROUND LEVEL. PROPRIETRY INSULATED CAVITY CLOSERS TO SOFFITS, REVEALS AND CILLS. NEW WALL TO BE BONDED USING STAINLESS STEEL 'FURFIX' OR 'EXPAMET' STARTER PROFILES OR SIMILAR. MORTAR TO BE 1:3 BELOW DPC AND 1:4 MIX ABOVE.

LINTELS
INSULATED CAVITY WALL LINTELS, IG OR CATNIC OPEN BACK OR SIMILAR WITH MINIMUM 150 END BEARINGS. ALL SIZED TO SUIT LENGTH AND MANUFACTURERS DETAILS. FIT CAVITY TRAYS WITH STOPS ENDS AND 65 x 10 WEEPS HOLES ABOVE TO EVERY 3RD APPROX JOINT OR USE LINTELS WITH INTEGRAL DPC. ENCASE STEEL LINTELS IN PLASTERBOARD AND SKIM.
EXPOSE AND ASSESS EXISTING- REPLACE IF REQUIRED.

GROUND FLOOR (U-VALUE <0.18 W/M²K)
FINISH TO CLIENTS SPECIFICATION. 65 SCREED ON 100 CONCRETE SLAB (GEN 1 MIX) ON 500 GAUGE VCL ON 100 CELOTEX TYPE INSULATION ON 1200 GAUGE DPM TURNED UP AT PERIMETER WITH 25 POLYSTYRENE UPSTANDS. 150 MINIMUM WELL COMPACTED CLEAN INERT HARD CORE. DPM TO JOIN DPC. REINFORCE SLAB WITH MESH ABOVE ANY DRAINS. AIR BRICKS AND TELESCOPIC DUCTS TO MAINTAIN AIR VENTS TO EXISTING AS APPLICABLE.

LOWER ROOF (U-VALUE <0.15 M²K SLOPING)
TILES TO MATCH AND TO SUIT PITCH. COLOUR AS APPROVED BY CLIENT, LAID AS PER MANUFACTURERS INSTRUCTIONS. TO BS 5534. ALL ON 50 x 24 TANILISED SW BATTENS ON 1 LAYER OF BREATHABLE FELT 'TYVEK SUPRO' OR 'KLOBER PERMO FORTE' LAID AS PER MANUFACTURERS INSTRUCTIONS INCLUDING EAVES CARRIERS & 10-15 DRAPE. 47 X 150 SW C24 RAFTERS @ MAX 400 CENTRES BIRDSMOUTHED TO 75 x 100 SW WALL PLATES FIXED TO WALL WITH 1200 x 38 x 5 STEEL STRAPS @ MAX 2000 CENTRES. WALL AND ROOF INSULATION TO BE CONTINUOUS. 12.5 FOIL BACKED (DUPLEX) PLASTERBOARD AND SKIM COAT. 120 CELOTEX BETWEEN WITH 50 UNDERNEATH.

INTERNAL WALLS
PARTITIONS TO CONSIST OF 38 x 63 SW STUDS INCLUDING FOOT AND HEADER PLATES WITH NOGGINS, WITH MIN. 25 THICK MINERAL FIBRE INSULATION (10KG/M³) WITHIN 12.5 PLASTERBOARD AND SKIM COAT TO EITHER SIDE. GYPROC MOISTURE RESISTANT PLASTERBOARD (GREEN FACED) TO ALL 'WET' AREAS.

LOFT STUD DWARF WALLS
75 x 100 SW STUDS INCLUDING FOOT AND HEADER PLATES WITH NOGGINS, WITH MIN. 100 THICK CELOTEX INSULATION WITHIN AND 25 CELOTEX INTERNALLY. 12.5 FOIL BACKED PLASTERBOARD AND SKIM COAT TO INNER SIDE.

ROOF (U-VALUE <0.18 M²K WHERE SLOPING)
47 x 195 SW C24 RAFTERS TO SIDE OF EXISTING- PURLINS REMOVED. INSULATE SLOPING CEILINGS WITH 150 CELOTEX BETWEEN RAFTERS (MIN 50 AIRGAP TO TOP MAINTAINED) WITH 25 UNDERNEATH. WALL AND ROOF INSULATION TO BE CONTINUOUS. 12.5 FOIL BACKED (DUPLEX) PLASTERBOARD AND SKIM COAT. DOUBLE UP AND BOLT TOGETHER RAFTER EITHER SIDE OF VELUX WINDOWS.

DORMER CHEEKS (U-VALUE <0.18 W/M²K)
50 x 120 SW STUDS INCLUDING FOOT AND HEADER PLATES WITH NOGGINS, 12 PLYWOOD SHEATHING TO OUTER FACE, 50 CELOTEX AND 12.5 PLASTERBOARD AND SKIM COAT TO INSIDE. INSULATE INTERNALLY WITH 100 CELOTEX. EXTERNALLY APPLY TYVEC BREATHABLE FELT 12 EXTERIOR PLY, BATTENS AND CEDRAL CLADDING TO MANUFACTURERS DETAILS. CODE 4 LEAD FLASHING TO LSA DETAILING.

DORMER FLAT ROOF (U-VALUE <0.15 W/M²K)
47 x 150 SW C24 JOISTS AT 400 CENTRES. MIN 50 FIRING STRIPS TO RUN AND DRAIN TO REAR. 3 LAYER FELT OR GRP COVERING WITH AA/B/C RATING ON 18 OSB OR PLY. 50X 50 ANGLE FILLETS AND INTEGRAL FLASHING. 1:40 FALL. 100 CELOTEX BETWEEN WITH 25 UNDER. INSTALLED AS PER MANUFACTURERS INSTRUCTIONS. WALL AND ROOF INSULATION TO BE CONTINUOUS. 12.5 FOIL BACKED (DUPLEX) PLASTERBOARD AND SKIM COAT. BASIC WORKMANSHIP DETAILS FOR TIMBERS TO TRADA PUBLICATION 'SPAN TABLES FOR SOLID TIMBER MEMBERS IN FLOORS, CEILINGS AND ROOFS (EXCLUDING TRUSSED RAFTER ROOFS) FOR DWELLINGS - PART 3.2.

LEADWORK
CODE 4 LEAD FLASHING WITH MINIMUM 150 LAP TO ROOF AND 75 UP WALL TO LSA DETAILING.

LOFT FLOOR
47 X 195 C24 FLOOR JOISTS @ 400 CENTRES TO SIDE OF EXISTING. TRIM AROUND STAIRS WITH TRIPLE JOISTS BOLTED TOGETHER. 100 MINIMUM MINERAL WOOL BETWEEN JOISTS. 2/3RD HEIGHT NOGGINS AT MID SPANS. 22 T&G CHIPBOARD TO TOP. FIX EXISTING TO NEW. DOUBLE UP AND BOLT TOGETHER UNDER STUD WALLS.

INTERNAL DOORS
DOORS AS MARKED- FD30 MIN FIRE DOORS WITH INTUMESCENT SEALS.

STAIRS
STAIRS IN PLACE. SW STAIRS TO BS5395. CLOSED RISERS. MAX 42 DEGREE PITCH. 223 GOINGS AND 200 RISERS. MIN 2000 HEADROOM. NON CLIMBABLE GUARDING TO BE 900-1000 HIGH WITH VERTICAL BALUSTRADING WITH NO GAPS GREATER THAN 99. ABLE TO RESIST A FORCE OF 0.36KN/M. HANDRAIL TO ONE SIDE AT 900-1000 HEIGHT.

STEELWORK
AS PER STRUCTURAL SPECIFICATION.

WINDOWS & DOORS (U-VALUE <1.4 W/M²K)
UPVC DOUBLE GLAZED TO CLIENTS SPECIFICATION. 16 ARGON FILLED GAP BETWEEN GLASS AND A SOFT 'E' SUCH AS 'PILKINGTON K' COATING TO INNER PANE. TESTED TO BS 5713. TOTAL OPENING LIGHTS TO BE A MINIMUM OF 1/20TH OF ROOM FLOOR AREA FOR HABITABLE AREAS. TRICKLE VENTS A MINIMUM OF 1700 OFF FLOOR. VENTILATION TO BE 8000mm² FOR HABITABLE ROOMS. EXACT SIZES TO BE MEASURED ON SITE. SET BACK 30 OVERLAP TO CAVITY. TOUGHENED GLASS TO BS6206 TO ALL DOORS, SIDE PANELS AND CRITICAL LOCATIONS.

BELOW GROUND DRAINS
ANY DRAINAGE TO BS 8301. CONTRACTOR TO ASCERTAIN ALL LEVEL, INVERTS AND DIRECTIONS BEFORE WORK COMMENCES ON DRAINS. 100 DIA UPVC DRAIN PIPES TO BS 4660 (1:40 FALL) WITH FLEXIBLE JOINTS, SURROUNDED BY 100 PEA GRAVEL, IF WITHIN 300 OF SLAB THEN ENCASE IN CONCRETE WITH EXPANSION JOINTS. WHERE PASSING THROUGH WALL RC LINTEL OVER AND LEAVE 50 GAP FILLED WITH FLEXIBLE NON DECAYING FILLER, OR USE ROCKER PIPES. ALL TRAPPED GULLIES TO BE RODDABLE, MOUNTED ON 100 CONCRETE. ENSURE ALL DIRECTIONS ARE RODDABLE. BUILDER TO LOCATE BEST CONNECTIONS.

RAINWATER DRAINS
CONTRACTOR TO ASCERTAIN ALL LEVEL, INVERTS AND DIRECTIONS BEFORE WORK COMMENCES ON DRAINS. 100 GUTTER TO 63 DOWNPIPE INTO RODDABLE TRAPPED GULLY. BRACKETS AT 1500 MAX VERTICAL CENTRES AND 1000 MAX HORIZONTAL CENTRES. SITE NOT SUITABLE FOR RAINWATER TO DISCHARGE INTO SOAKAWAYS. SW MINIMUM FALL 1:80. ENSURE ALL DIRECTIONS ARE RODDABLE.

CONTINUITY OF INSULATION & AIRTIGHTNESS
BUILDING FABRIC CONSTRUCTED IN LINE WITH 'TSO ROBUST DETAILS CATALOGUE' 'LIMITING THERMAL BRIDGING AND AIR LEAKAGE: ROBUST CONSTRUCTION DETAILS FOR DWELLINGS AND SIMILAR BUILDINGS 2002'

HEATING
HEATING AS SPECIFIED BY CLIENTS- CONFIRM BEFORE COMMENCEMENT. EXTEND EXISTING HOT WET SYSTEM TO ALL NEW FITTINGS, TRV'S TO ALL RADIATORS. ALLOW FOR RADIATORS AS PER CLIENTS SPECIFICATION AND AGREEMENT. BOILER ALTERATIONS TO BE UNDERTAKEN BY GAS SAFE REGISTERED INSTALLER.

VENTILATION
MECHANICAL EXTRACT FAN TO KITCHEN NOT LESS THAN 30L/S IF IN COOKER HOOD OR 60L/S ELSEWHERE. MECHANICAL EXTRACT FAN TO ENSUITES NOT LESS THAN 15L/S. TEST CERTIFICATE PROVIDED ON COMPLETION. 10 AIR GAP UNDER DOORS.


ELECTRICS
ELECTRICIAN TO BE 'PART P' REGISTERED UNLESS THE COUNCIL IS INFORMED BEFORE COMMENCEMENT.
EXTEND THE EXISTING POWER AND LIGHT SYSTEM INTO EXTENSION. CLIENT TO SUPPLY SPEC. ALLOW FOR ALL FITTING TO TAKE ENERGY SAVING LIGHT LAMPS GREATER THAN 40 LUMENS PER CIRCUIT WATT (TABLE 4 AD L1). ALL TO CURRENT I.E.E & N.I.C.E.I.C REGULATIONS. ALL ELECTRICAL WORK REQUIRED TO MEET THE REQUIREMENTS OF PART P (ELECTRICAL SAFETY) MUST BE DESIGNED, INSTALLED, INSPECTED AND TESTED BY A PERSON COMPETENT TO DO SO. PRIOR TO COMPLETION THE COUNCIL SHOULD BE SATISFIED THAT PART P HAS BEEN COMPLIED WITH. THIS MAY REQUIRE AN APPROPRIATE BS7671 ELECTRICAL INSTALLATION CERTIFICATE TO BE ISSUED FOR THE WORK BY A PERSON COMPETENT TO DO SO. ALLOW FOR THE NO. SOCKETS AS AGREED WITH CLIENT.
ELECTRICS TO CLIENTS SPECIFICATION.

INFORMATION
ALL OPERATION AND MAINTENANCE INFORMATION TO BE PROVIDED FOR THE FIXED BUILDING SERVICES TO THE OWNER.

WOODWORK
SKIRTINGS, ARCHITRAVES, DOORS, SOFFITS ETC TO MATCH EXISTING & TO CLIENTS SATISFACTION.

DEMOLITION
ALLOW FOR REMOVING EXISTING AS APPLICABLE.

GENERAL NOTES.
NO DIMENSIONS TO BE TAKEN FROM THIS DRAWING. ALL DIMENSIONS STATED ARE METRIC MILLIMETRES. ALL LEVELS, INVERTS AND DIMENSIONS TO BE CHECKED ON SITE BEFORE AND DURING WORK.
ALL WORK IS TO BE CARRIED OUT IN LINE WITH CURRENT BUILDING REGULATIONS, RELEVANT CODES OF PRACTICE, BRITISH & EUROPEAN STANDARDS AND MANUFACTURERS SPECIFICATIONS TO THE BUILDING INSPECTORS SATISFACTION, AND IN ACCORDANCE WITH PUBLIC AND PRIVATE UTILITIES REGULATIONS. NO WORK TO ENCROACH BOUNDARY LINES. IT IS THE CLIENTS RESPONSIBILITY TO ISSUE ANY 'PARTY WALL ACT 1996' NOTICE NECESSARY BEFORE ANY WORK COMMENCES ON THE BOUNDARY.
IT IS THE CLIENTS RESPONSIBILITY TO ENSURE ANY WORK SHOWN ON THIS PLAN DOES NOT CONTRAVENE ANY COVENANTS.
IT IS THE CLIENTS/ BUILDERS RESPONSIBILITY TO CHECK THE EXACT POSITION OF ALL SERVICES TO INCLUDE GAS, ELECTRICITY, WATER AND TELEPHONE, AND POSITION, OWNERSHIP AND DEPTHS OF FOUL AND RAINWATER DRAINAGE.
THE EXACT SPECIFICATION OF FINISHES, FITTINGS AND SERVICES TO BE INSTRUCTED BY THE CLIENT.
ANY DEVIATION FROM THESE PLANS SHOULD BE NOTIFIED TO THE BUILDING INSPECTOR AND AMLI DESIGN.
IT IS THE OWNERS/ CONTRACTORS RESPONSIBILITY TO NOTIFY THE BUILDING INSPECTOR WHEN THE WORK IS READY FOR THE RELEVANT INSPECTIONS AND FOR THE CLIENTS RECEIPT OF THE COMPLETION CERTIFICATE. IT IS ASSUMED NO PUBLIC SEWERS CROSS THE SITE.
THE CONTRACTOR IS ASSUMED TO HAVE VISITED SITE BEFORE TENDERING.
THIS DRAWING HAS BEEN PREPARED FOR LA PLANNING & BUILDING CONTROL CONSENT ONLY. USE IMPLIES THE CLIENT AGREES TO ALL TERMS AND CONDITIONS. UNTIL APPROVALS HAVE BEEN OBTAINED THESE DRAWINGS REMAIN PRELIMINARY. WORK SHOULD NOT COMMENCE OR MATERIALS ORDERED UNTIL APPROVAL IS OBTAINED. COPYRIGHT REMAINS WITH AMLI DESIGN.

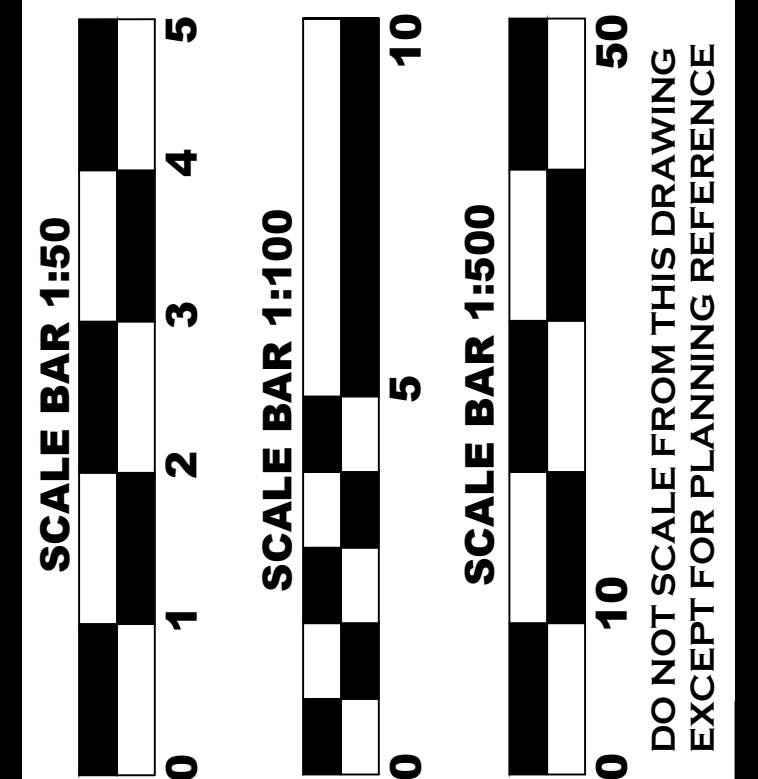

PROJECT NAME
EXTENSIONS, LOFT CONVERSION & ALTERATIONS
10 ATKINS WAY
BURBAGE
LEICESTERSHIRE LE10 2PH
FOR MR D. HOUGH

SCALE
1:100/1:50
A1

DWG NO.
10AW/2024
2/4

REV

DATE
JAN 2024

DRAWN
DRI

CHKD
DH
01/24