


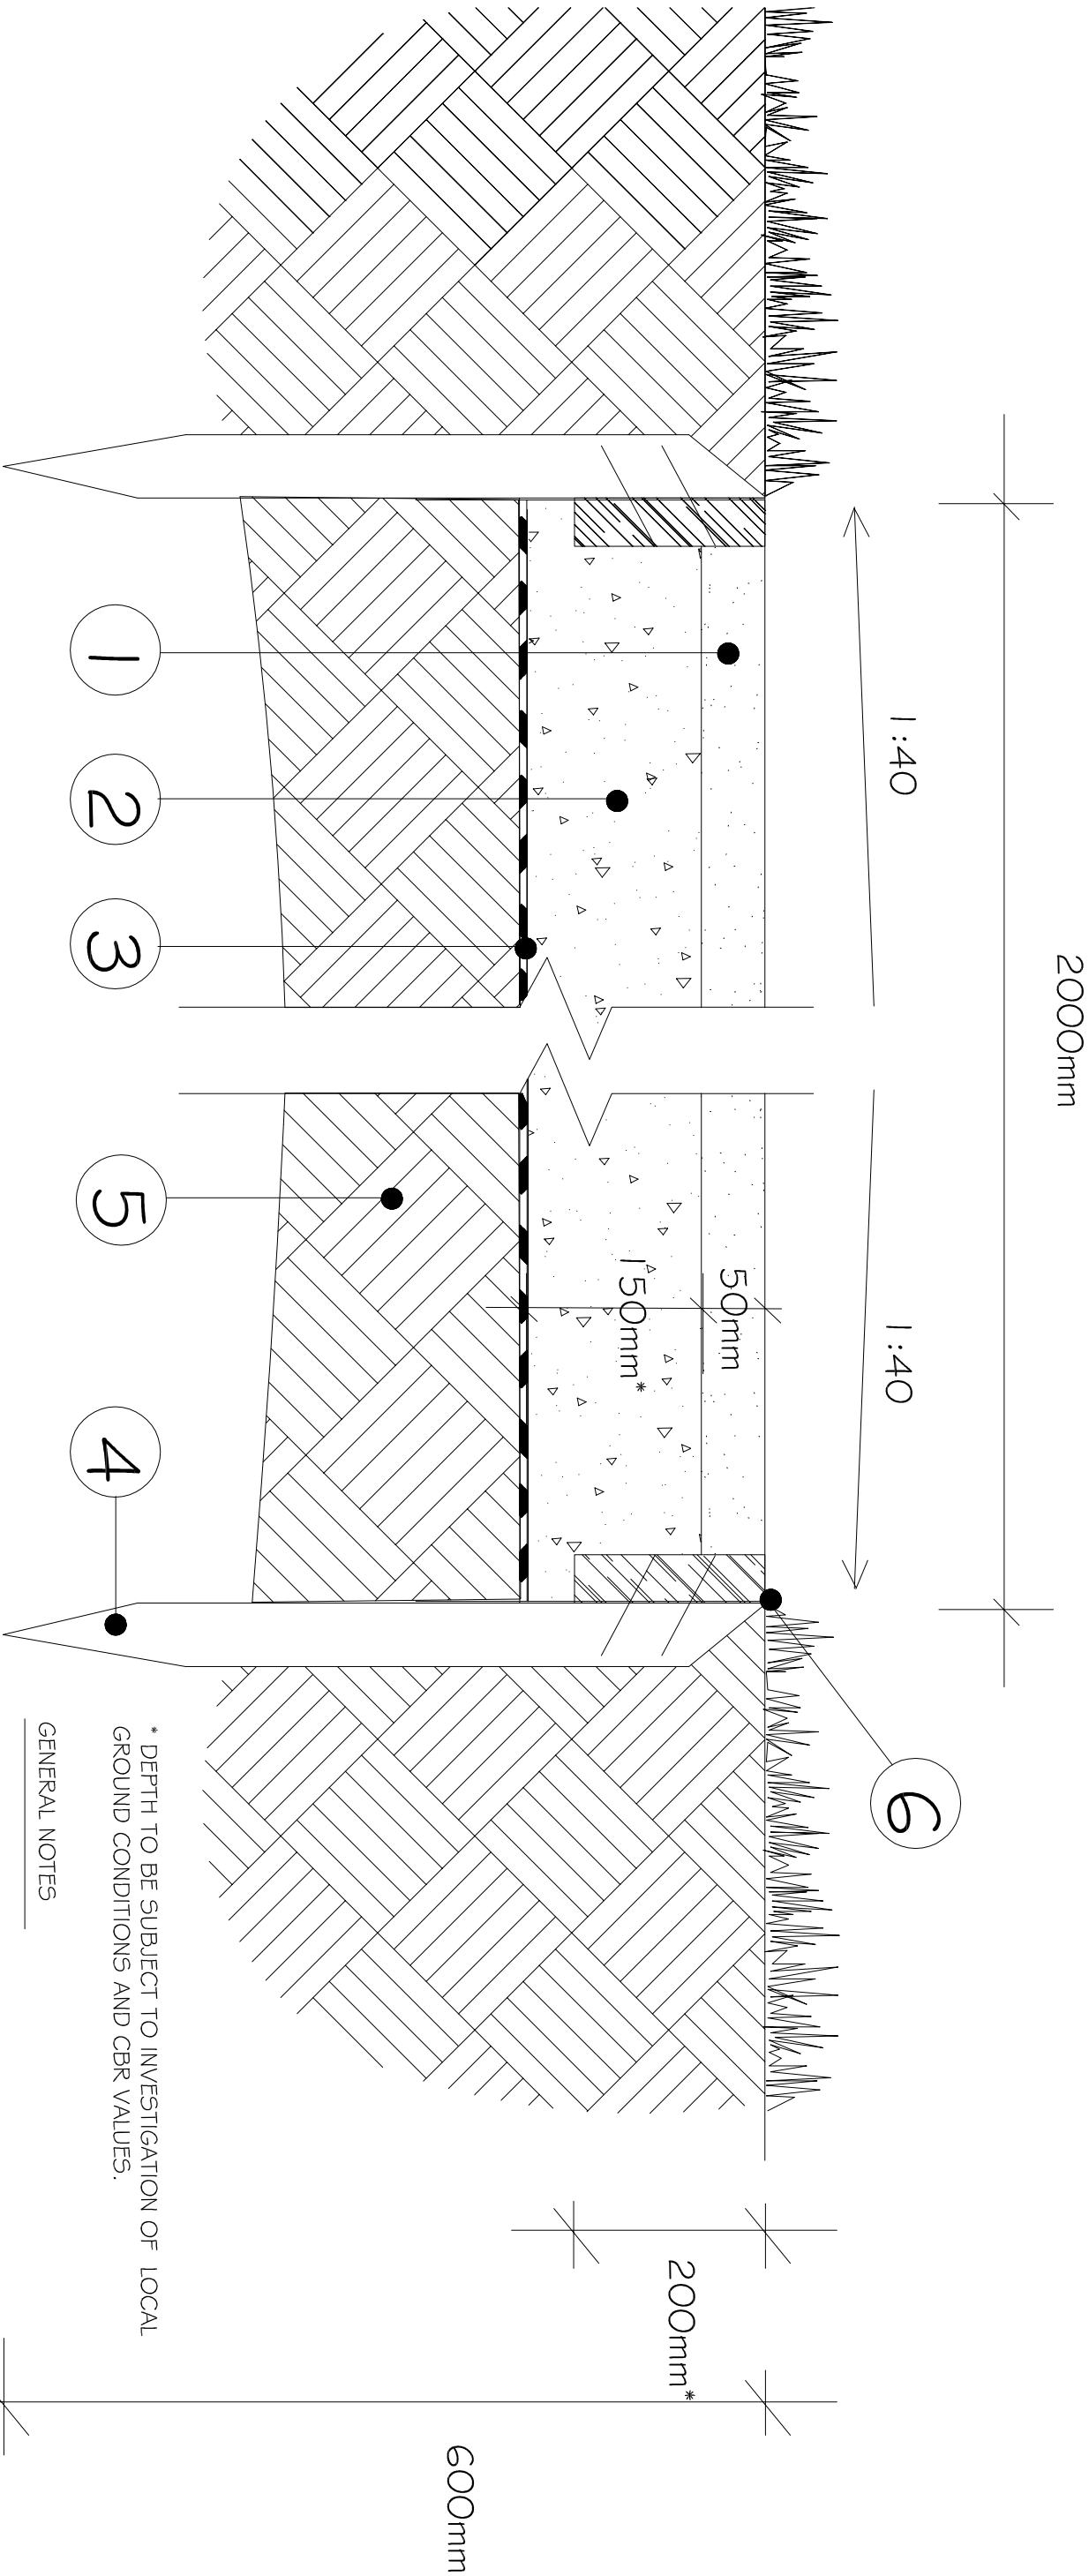

* DEPTH TO BE SUBJECT TO INVESTIGATION OF LOCAL GROUND CONDITIONS AND CBR VALUES.

GENERAL NOTES

- TOP SOIL ARISING FROM EXCAVATION TO BE CAREFULLY REUSED EITHER IN GRADING WORKS OR RETAINED TO SPREAD AROUND NEW TRACK LINE TO MARRY IN LEVELS ON COMPLETION OF WORKS.
- MIX 1 PART CEMENT TO 10 PARTS (BY VOLUME) STONE DUST TO STABILISE ANY SECTIONS WITH A GRADIENT.
- HOGGIN TO BE LIGHTLY WATERED AFTER LAYING AND BEFORE ROLLING.
- ALL TIMBER TO BE CCA TREATED TO BS 4072 PART 1 (DARK STAINED) IF TIMBER TREATMENT PROCESS NOT AVAILABLE THEN TREAT WITH INTEGRAL DARKSTAIN.
- DO NOT SCALE FROM THIS DRAWING
- ALL DIMENSIONS IN MILLIMETRES.

NOTES

- ① WEARING COURSE 50mm DEPTH OF WELL CONSOLIDATED HOGGIN. HOGGIN TO BE OF A SUITABLE MIX OF GRAVEL, SAND AND CLAY TO GIVE A SMOOTH AND DURABLE SURFACE WITH A MIN OF 85% BY WEIGHT PASSING A 10mm BS SIEVE. A SAMPLE OF HOGGIN MUST BE SUB- MITTED PRIOR TO LAYING FOR INSPECTION AND APPROVAL BY THE LANDSCAPE ARCHITECT AND LOCAL PLANNING AUTHORITY.
- ② MOT TYPE 2 GRANULAR SUB BASE WELL COMPACTED TO 150mm*, DEPTH DEPENDANT ON LOCAL GROUND CONDITIONS.
- ③ BLINDING OF HY-TEX 18 "GROUNDCOVER" OR SIMILAR AND APPROVED. AVAILABLE FROM HYTEX UK LTD TEL (01233) 720097. SHEETS TO BE OVERLAPPED BY 100mm AND PEGGED INTO SUB-BASE.
- ④ SAWN SOFTWOOD GRAVEL BOARD 38mm x 150mm ATTACHED WITH GALVANISED NAILS TO 50mm 50mm x 600mm LONG SOFTWOOD STAKES AT 1.5m CENTRES OR CLOSER AS REQUIRED AT JUNCTIONS. GRAVEL BOARD TO BE REDUCED TO 100mm DEPTH SOAKED AND SAWN VERTICALLY ALONG THE BACK TO BEND ROUND CURVES.
- ⑤ SUB GRADE TO BE PREPARED, CONSOLIDATED AND SHAPED TO THE REQUIRED FORMATION.
- ⑥ SOIL LEVELS OF GRASS SURFACES ADJACENT TO PATHS SHALL BE FLUSH BUT NOT PROUD OF TIMBER EDGING BOARDS (TOLERANCE TO BE A MAXIMUM OF 5mm BELOW EDGING BOARD). WHERE PLANTING BEDS ARE ADJACENT TO BOARDS THEN SOIL LEVELS SHALL BE 25mm BELOW EDGING BOARDS.

Development		Date	09-10-2015
STANDARD DETAIL		Scale	NOT TO SCALE
Drawing title		Drawn	-
HOGGING DETAIL		Drawn Ref.	SD 09-11