

Installation General Specification



The FIC requires a separate 16amp 240v.a.c. supply protected by a C10MCB.

The pumps must be fed by a 240v.a.c. single phase supply protected by an appropriate circuit breaker (as per the manufacturers specification).

Each piece of equipment e.g. fuel monitoring system, pumps, tank gauge, lighting circuits must have an individual/separate electrical supply and not be interlinked. Each piece of equipment must have its own means of isolation within the vicinity of the fuel island area i.e. not located at source of supply from consumer unit. Circuit breakers must be clearly identified with rating and the protected circuit. All cabling should be in good condition and secure.


The location of the Plinth mounted FIC must comprise of a suitable concrete hard standing and a 4" duct for cabling, all ducts must be clear of blockage and contain a draw rope. Sufficient space must be allowed for customer use and service maintenance. Adequate lighting must be provided. Exposed cabling must be routed using a suitable cable tray system.

For Plinth mount installation location information see sheet 2
For Plinth mount installation procedure guide see sheet 3

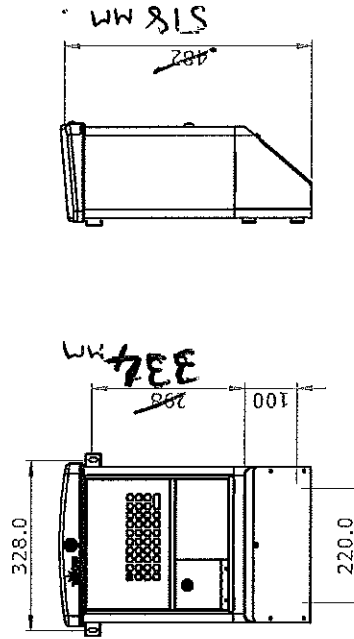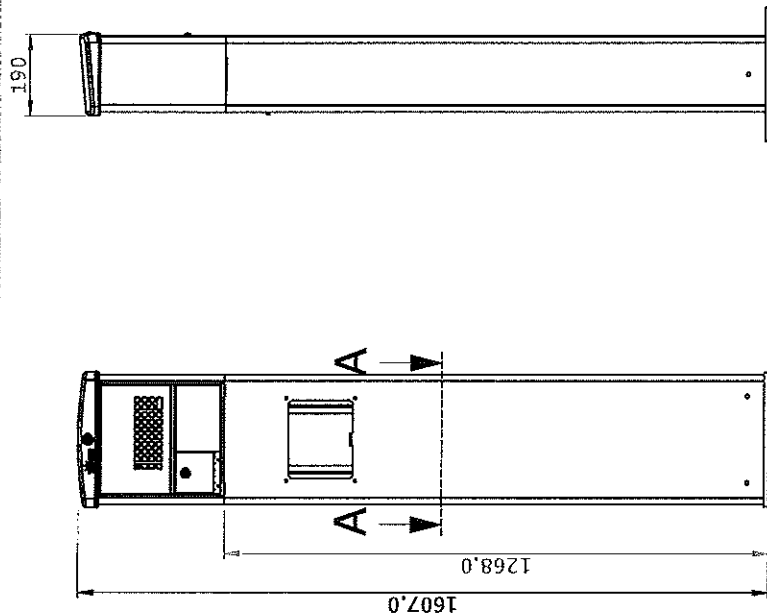

Wall mount O/All Dimensions

Plinth mount O/All Dimensions

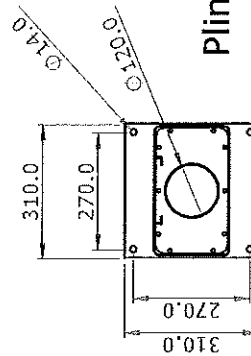

SECTION A-A

NOTES:
Material: N/A
Finish: N/A

FIRST ANGLE PROJECTION

ISS: Crp No. A

TITLE

Triscan FIC

TRISCAN
Our technology, your success
Phoenix park, Blakewater Rd, Blackburn,
Lancashire, BB1 5SJ
Tel: 08452253100 Fax: 08452253101

COPYRIGHT NOT TO BE LOANED OR COPIED
WITHOUT PERMISSION FROM TRISCAN SYSTEMS LIMITED

TOLERANCES:
Unless Otherwise Stated
0 decimal places $\pm 0.5\text{mm}$
1 decimal places $\pm 0.2\text{mm}$
2 decimal places $\pm 0.1\text{mm}$
3 decimal places $\pm 0.05\text{mm}$
Angular: $\pm 0.5^\circ$

Drawn By: B.D. Waring
Approved By: A. Deakin
Date: 11/11/11
Date: 11/11/11
SCALE: 1:12
DO NOT SCALE - IF IN DOUBT ASK

Installation Detail
DRAWING NUMBER **I10113**
SHEET 1
REV. A

A 3