





Front Elevation




Rear Elevation

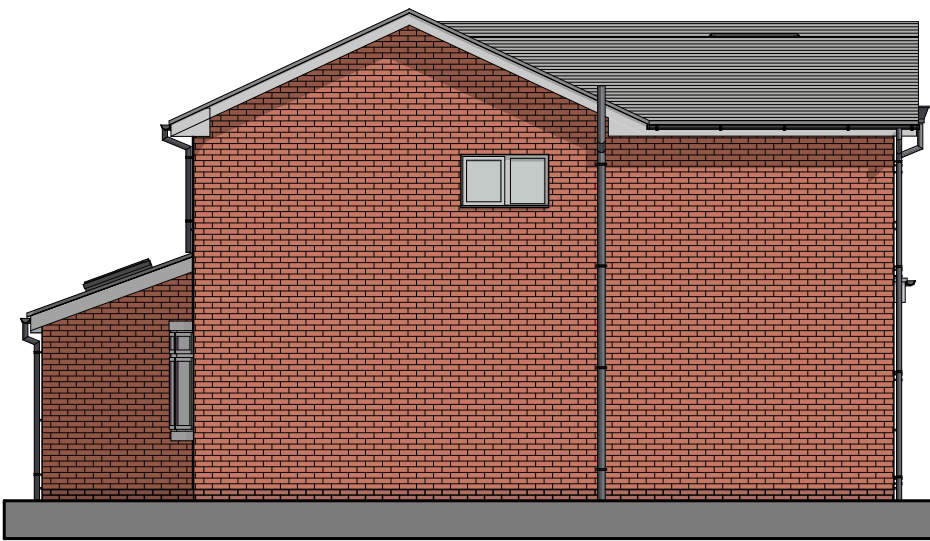


Side Elevation

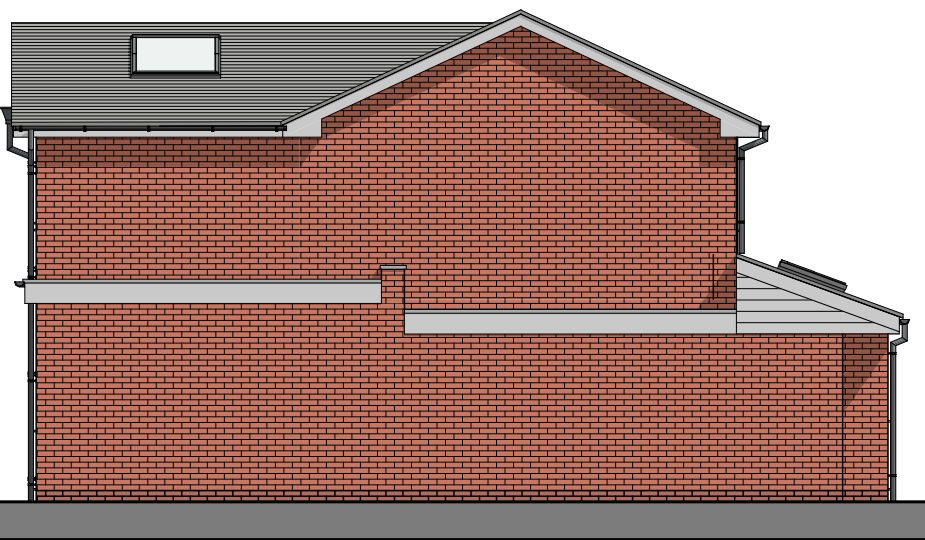

Side Elevation

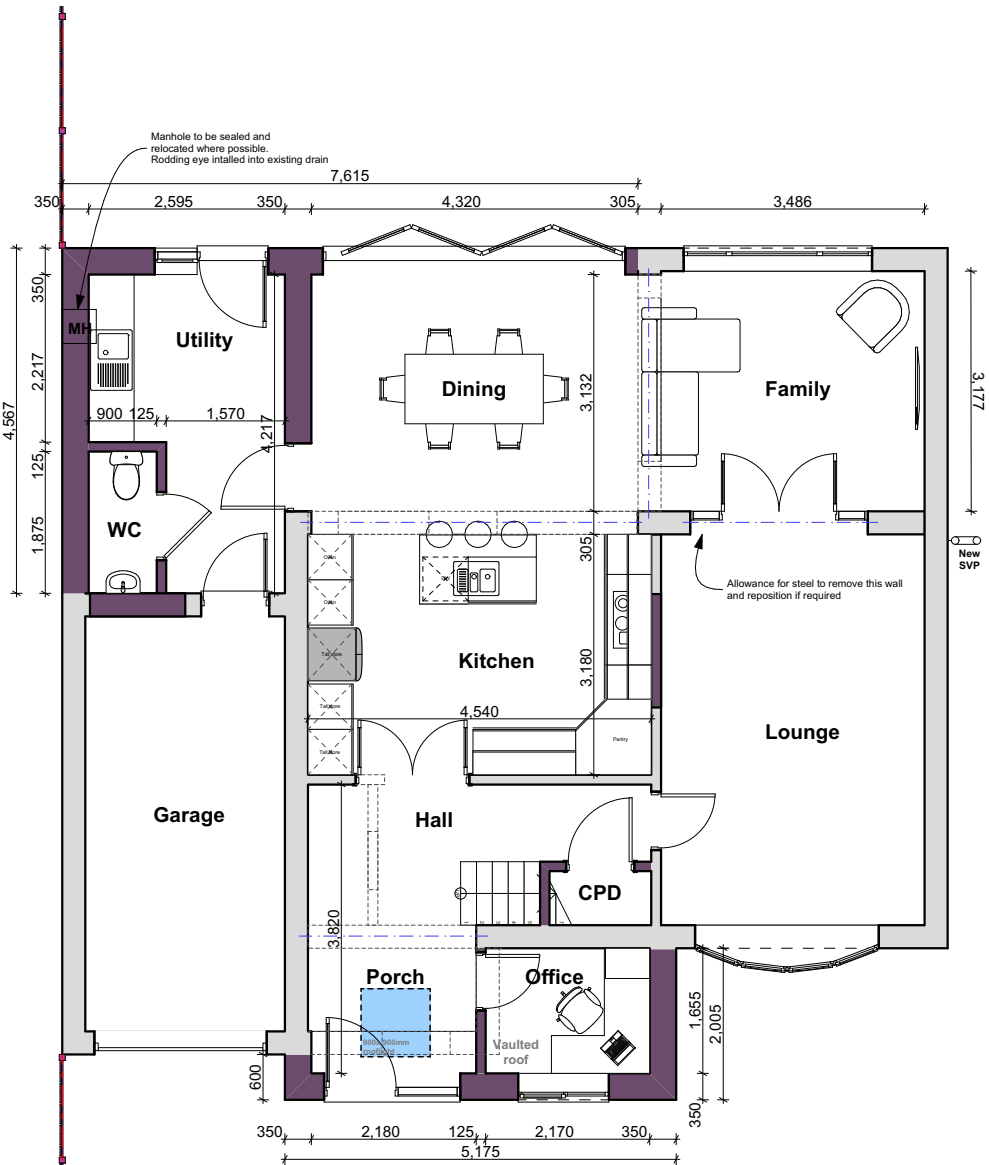

Ground Floor Plan

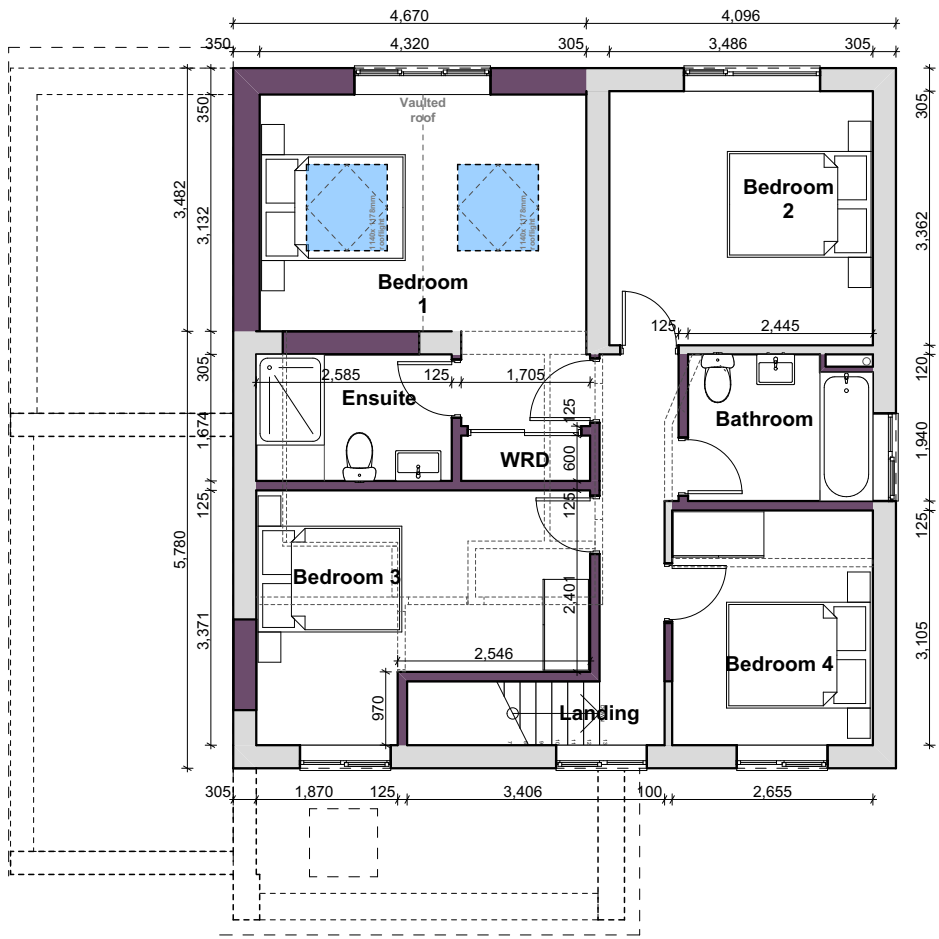

First Floor Plan

Existing drainage to be exposed and utilised where possible all new junctions to have access through manhole or rodding point.

BUILDING REGULATIONS NOTES

NOTICE OF COMMENCEMENT

A notice of commencement is to be submitted to Building Control within 5 days of work being regarded as commenced, under regulation 16 of The Building Regulations etc. (Amendment) (England) Regulations 2010.

Work will be deemed to have commenced when the build has progressed to at least one of the following:

For complex buildings - Foundations are constructed, and the structure of the lowest floor level is complete.
For new buildings and horizontal extensions - Sub surface structure of the building or the extension including all foundations and the structure of the ground floor level is completed.
For all other works - constructed 15% of the overall work.

TRENCH FOUNDATION

Provide 750mm thick trench fill concrete foundations with a minimum width equal to the width of the wall plus 300mm. Concrete mix to conform to BS EN 206:2013 (+A2:2021) and BS 8004:2015 Code of practice for foundations (+A1:2020). All foundations to be a minimum of 1000mm below ground level, depth and size of foundation to be approved on site by Building Control to suit site conditions. All constructed in accordance with 2010 Building Regulations A1/2 and BS 8004 Code of Practice for Foundations (+A1:2020). Ensure foundations are constructed below invert level of any adjacent drains. Base of foundations supporting internal walls to be min 600mm below ground level. Sulphate resistant cement to be used if required. Please note that should any adverse soil conditions or difference in soil type be found, or any major tree roots in excavations, Building Control to be contacted and the advice of a Structural Engineer should be sought.

SOLID FLOOR INSULATION UNDER SLAB

To meet min U value required of 0.18 W/m²K

P/A ratio 0.5

Solid ground floor to consist of 150mm consolidated well-rammed hardcore, blinded with 50mm sand blinding. Provide a 1200 gauge polythene DPM, DPM to be lapped in with DPC in walls. Floor to be insulated over DPM with 90mm thick Celotex GA4000 insulation. 25mm insulation to continue around floor perimeters to avoid thermal bridging. A VCL should be laid over the insulation boards and turned up 100mm at room perimeters behind the skirting, all joints to be lapped by 150mm and sealed, provide 100mm ST2 or Gen2 ground bearing slab concrete mix to conform to BS 8500-2:2023 and BS EN 206 over VCL. Finish with 65mm sand/cement finishing screed with light mesh reinforcement.

Where drain runs pass under new floor, provide A142 mesh 1.0m wide within bottom of slab min 50mm concrete cover over length of drain. Where existing suspended timber floor air bricks are covered by new extension, ensure cross-ventilation is maintained by connecting to 100mm dia UPVC pipes to terminate at new 65mm x 215mm air bricks built into new cavity wall with 100mm concrete cover laid under the extension. Ducts to be sleeved through cavity with cavity tray over.

FULL FILL CAVITY WALL

To achieve minimum U Value of 0.18 W/m²K

New cavity wall to comprise of 103mm suitable facing brick. Full fill cavity with 175mm Rockwool Cavity insulation as manufacturer's details. Inner leaf to be 100mm medium block, 0.45 W/m²K. Internal finish to be 12.5mm plasterboard on dabs. Walls to be built with 1:1:6 cement mortar.

WALL TIES

All walls constructed using stainless steel vertical twist type retaining wall ties built in at 750mm ctrs horizontally, 450mm vertically and 225mm ctrs at reveals and corners in staggered rows. Wall ties to be suitable for cavity width and in accordance with BS EN 845-1:2013. Wall ties for cavities over 150mm to be suitable for cavity width, and installed as manufacturer's details.

WARM FLAT ROOF: Utility

(imposed load max 1.0 kN/m² - dead load max 0.75 kN/m²)

To achieve U value 0.15 W/m²K

Flat roof covering to be single ply roofing membrane with BROOF(t4) fire rating in accordance with BS EN 13501-1:2018 and with a current BBA or other approved accreditation. Roof covering to be laid in compliance with manufacturer's details by flat roofing specialist. Single ply membrane to be fixed to 18mm exterior quality plywood (if required by manufacturer) over 150mm Celotex XR4000 insulation. Insulation bonded to vcl on 18mm external quality plywood decking or similar approved on sw firings to minimum 1 in 40 fall on sw treated 47 x 145mm flat roof C24 timber joists at 400mm ctrs to give a max span of 3.22m or as Structural Engineer's details and calculations. Fix 12.5mm plasterboard over vapour barrier to underside of joists, finish with a plaster skim. Provide cavity tray where new roof abuts existing house. Provide restraint to flat roof by fixing of 30 x 5 x 1200mm ms galvanised lateral restraint straps at maximum 2000mm centres fixed to 100 x 50mm wall plates and anchored to wall.

EXTRACT TO UTILITY ROOM AND KITCHEN

To utility room provide mechanical ventilation ducted to external air capable of extracting at a rate of 30 l/s. Internal doors should be provided with a 10mm gap below the door to aid air circulation. Ventilation provision in accordance with the Domestic Ventilation Compliance Guide. Intermittent extract fans to BS EN 13141-4. All fixed mechanical ventilation systems, where they can be tested and adjusted, shall be commissioned and a commissioning notice given to the Building Control Body.

INSPECTION CHAMBERS

Underground quality proprietary UPVC 450mm diameter inspection chambers to be provided at all connections, changes of level, changes in direction, and every 45m in straight runs. Inspection chambers to have bolt down double sealed covers in buildings and be adequate for vehicle loads in driveways.

UNVENTED PITCHED ROOF -Porch and Bedroom

Pitch 22-45° (imposed load max 0.75 kN/m² - dead load max 0.75 kN/m²)

To achieve U-value 0.15 W/m²K

Timber roof structures to be designed by an Engineer in accordance with NHBC Technical Requirement R9 Structural Design. Calculations to be based on BS EN 1995-1-1:2004 Eurocode 5: Design of timber structures (+A2:2014). Roofing tiles to match existing on 25 x 38mm tanalised sw treated battens on breathable sarking felt to relevant BBA Certificate. Supported on 47 x 150mm grade C24 rafters at max 400mm centres, max span 3.47m. Rafters supported on 100 x 50mm treated sw wall plates. Allow min 20mm air space to allow for drape of breathable felt.

Insulation to be 130mm Celotex XR4000 between rafters and 50mm GA4000 under. Fix 12.5mm plasterboard (joints staggered) over VCL. Finish with 3mm skim coat of finishing plaster to the underside of all ceilings. Provide cavity tray where roof meets existing wall. Restraint strapping - Ceiling joists tied to rafters (if raised collar roof consult Structural Engineer). 100mm x 50mm wall plate strapped down to walls. Ceiling joists and rafters to be strapped to walls and gable walls, straps built into cavity, across at least 3 timbers with noggins. All straps to be 1200 x 30 x 5mm galvanized straps or other approved to BS EN 845-1 (+A1:2016) at 2m centres.

INTERNAL STUD PARTITIONS

100mm x 50mm softwood treated timbers studs at 400mm ctrs with 50 x 100mm head and sole plates and solid intermediate horizontal noggins at 1/3 height or 450mm c/c. Provide min 10kg/m³ density acoustic soundproof quilt tightly packed (e.g. 100mm Rockwool or Isowool mineral fibre sound insulation) in all voids the full depth of the stud. Partitions to be built off doubled up joists where partitions run parallel or provide noggins where at right angles, or to be built off DPC on thickened concrete slab if solid ground floor. Walls faced throughout with 12.5mm plasterboard with skim plaster finish. Plasterboard to be taped and jointed complete with beads and stops.

INTERMEDIATE FLOORS

Intermediate floor to be 25mm t&g flooring grade chipboard or floorboards laid on 47mm x 170mm C24 grade soft wood joists at maximum 400mm centres, max span 3.77m (see Engineer's calculation for sizes and details). Lay 100mm Rockwool mineral fibre quilt insulation min 10kg/m³ or equivalent between floor joists. Ceiling to be 12.5 Fire-Line plasterboard with skim plaster set and finish. Joist spans over 2.5m to be strutted at mid span using 38 x 38mm herringbone strutting or 38mm solid strutting (at least 2/3 of joist depth), in areas such as kitchens, utility rooms and bathrooms, flooring to be moisture resistant grade in accordance with BS EN 312. Identification marking must be laid upper most to allow easy identification. Provide lateral restraint where joists run parallel to walls, floors are to be strapped to walls with 1200mm x 30mm x 5mm galvanised mild steel straps or other approved in compliance with BS EN 845-1 (+A1:2016) at max 2.0m centres, straps to be taken across minimum 3 no. joists. Straps to be built into walls. Provide 38mm wide x ¾ depth solid noggins between joists at strap positions.

NEW AND REPLACEMENT DOORS

New and replacement doors to achieve a U-Value of 1.4W/m²K. Glazed areas to be double glazed with 16-20mm argon gap and soft low-E glass. Glass to be toughened or laminated safety glass to BS 6206, BS EN 14179 or BS EN ISO 12543-1 and Part K of the current Building Regulations. Insulated plasterboard to be used in reveals to abut jambs and to be considered within reveal soffits. Fully insulated and continuous cavity closers to be used around reveals. Windows and door frames to be taped to surrounding openings using air sealing tape.

NEW AND REPLACEMENT WINDOWS

New and replacement windows to be double glazed with 16-20mm argon gap and soft coat low-E glass. Window Energy Rating to be Band B or better and to achieve U-value of 1.4 W/m²K. The door and window openings should be limited to 25% of the extension floor area plus the area of any existing openings covered by the extension. Insulated plasterboard to be used in reveals to abut jambs and to be considered within reveal soffits. Fully insulated and continuous cavity closers to be used around reveals. Windows and door frames to be taped to surrounding openings using air sealing tape. Windows to be fitted with trickle vents to provide adequate background ventilation in accordance with Approved Document F.



EXTRACT TO BATHROOM AND WC

Bathroom to have mechanical vent ducted to external air to provide min 15 l/s. Vent to be connected to light switch and to have 15 minute over run if no window in room. Internal doors should be provided with a 10mm gap below the door to aid air circulation. Ventilation provision in accordance with the Domestic Ventilation Compliance Guide. Intermittent extract fans to BS EN 13141-4. All fixed mechanical ventilation systems, where they can be tested and adjusted, shall be commissioned and a commissioning notice given to the Building Control Body.

Please Note:

- This drawing may be printed and scaled FOR PLANNING PURPOSES.
- All dimensions to be CHECKED ON SITE and any DISCREPANCY reported to Perfect Planning.
- The site boundary shown is the best assumed from available data and does NOT represent legal ownership.
- All dimensions in mm unless otherwise stated.

WALL LEGEND

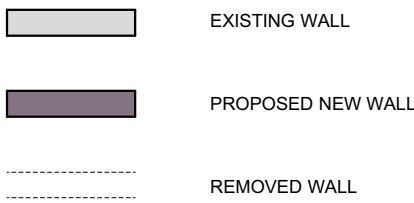

Scale Bar 1:100

B Amends following client comments 23-09-24
A Amends following client comments 06-08-24
Revisions.



e: info@perfect-planning.co.uk
t: 01455 272943
t: +44 (0) 7904 224864
t: +44 (0) 7912 413144
w: www.perfect-planning.co.uk

Project:
Two storey side, single storey front and rear extension
16 Manor Close
Burbage
Hinckley
LE10 2NL
Client:
Chris & Lilith Hitchman

Drawing Title:

Planning proposed scheme

Drawing by: AL / EB / SA Checked by: AL / AC
Date: 28/05/2024 Scale: 1:100@A2
Drawing Number: 786-02 Revision: B

