


Site Boundary Plan

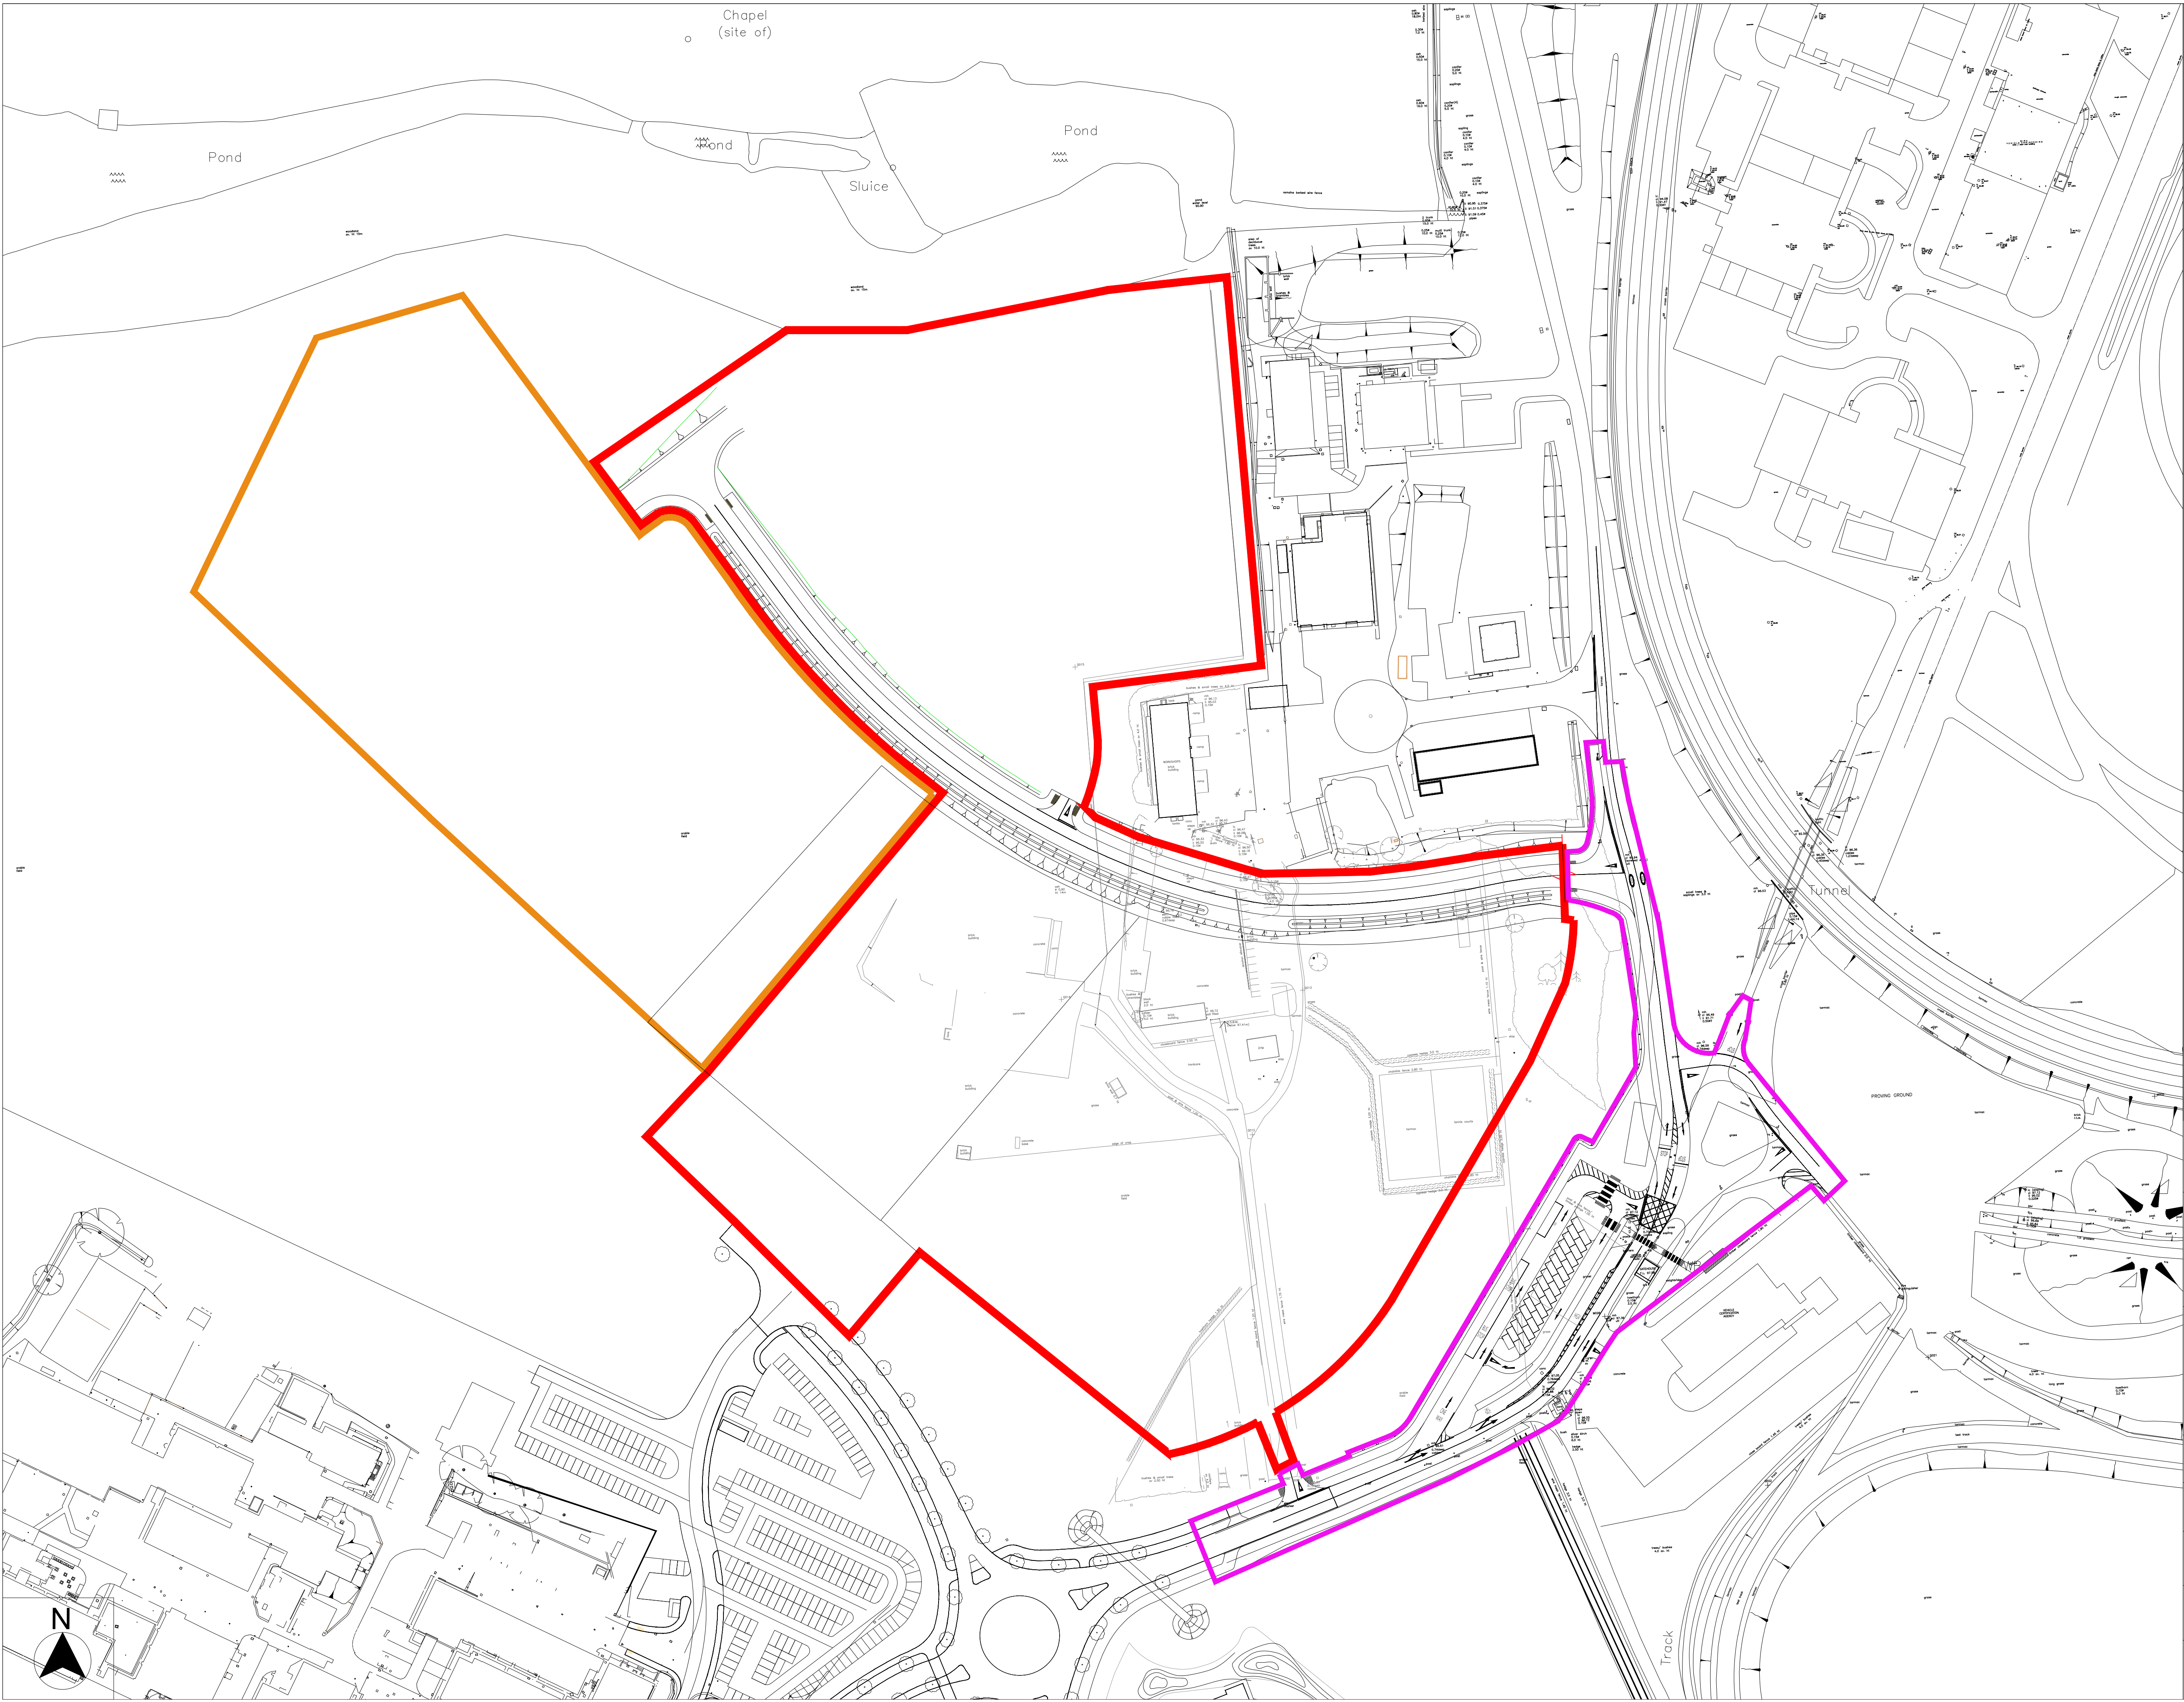

LEGEND

- Access required for soil placing
- Site Boundary GMI
- Site Boundary Fitzgerald

Rev.	Description	Drawn	Date
B	Fitzgeralds boundary shown	JRP	09.02.24

Geddes Architects 

Studio 3.31 Canterbury Court Kennington Park
1-3 Brixton Road London SW9 6DE
www.geddesarchitects.com T +44 203 150 4605

Client ERI MTP LTD


Project Plot 9

Title Site boundary

DATE	22.11.2023	CHECK STAGE	TENDER
DRAWN	JRP	CHECK DATE	22.11.2023
SCALE	1:1000 @ A3	CHECKED BY	CG

21.016(G)099 B

Proposed Development

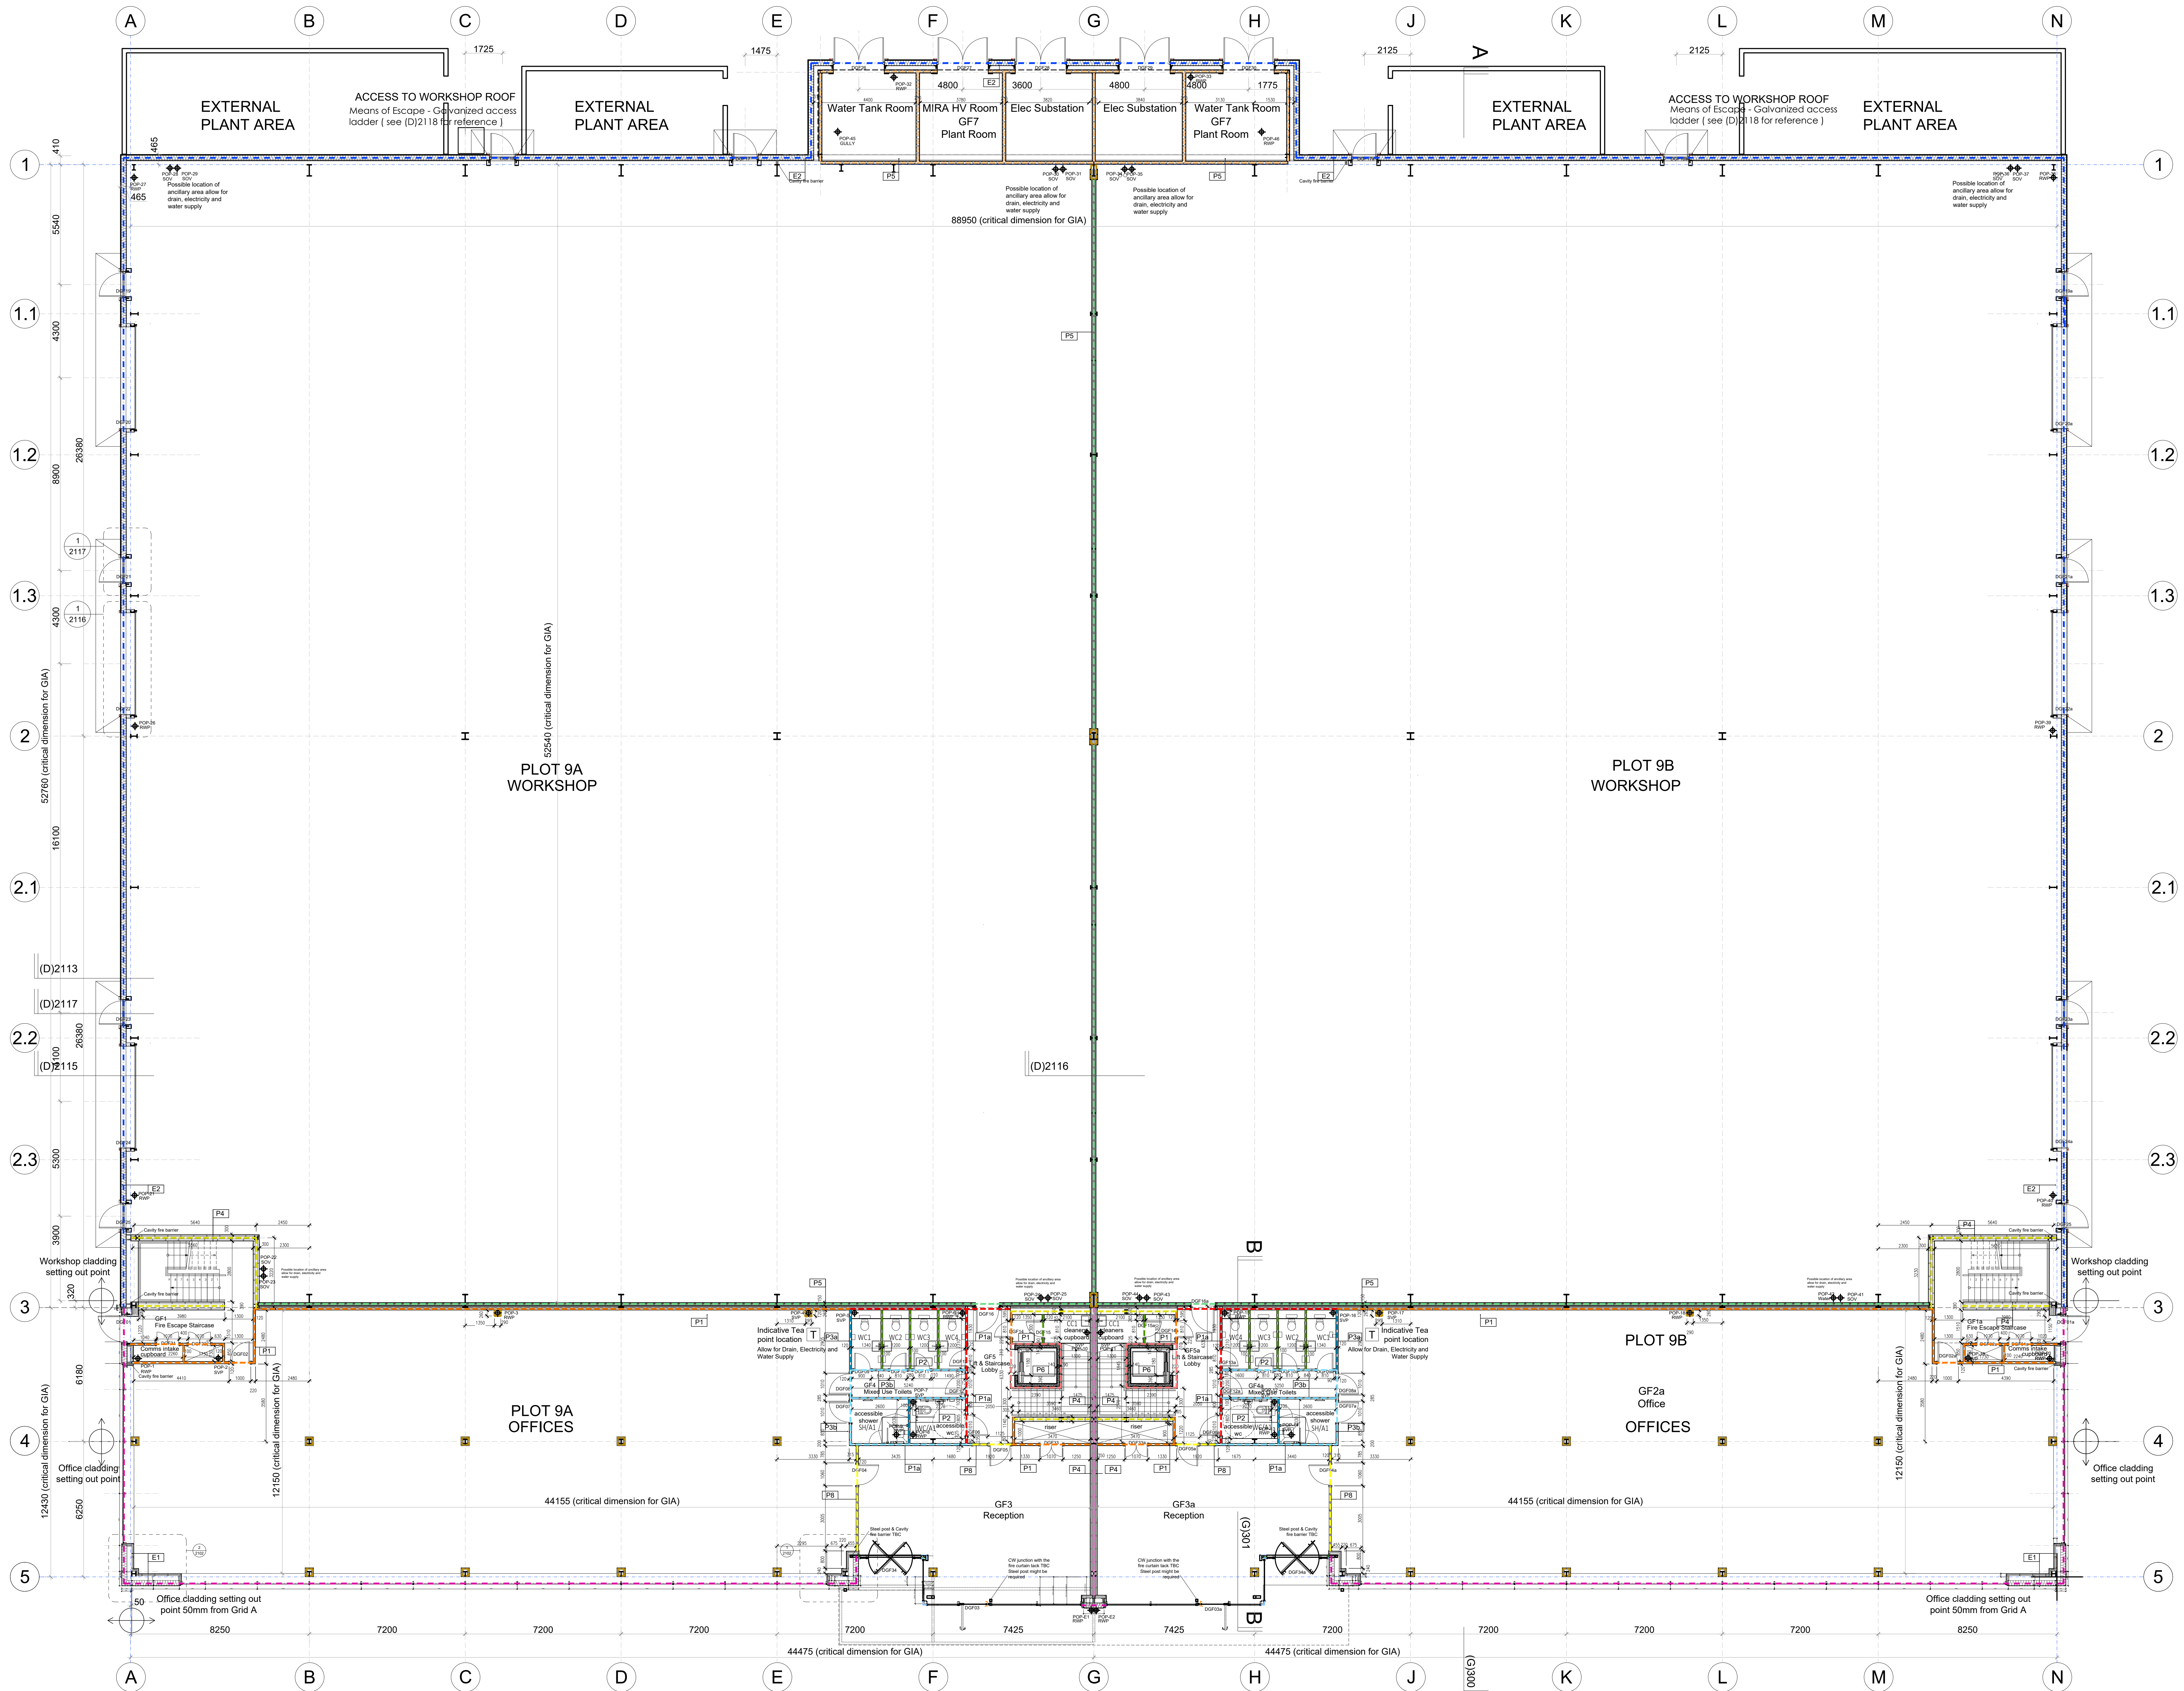

EXTERNAL WALLS TYPES

E1	E2
FRAMED CONCRETE WALL (P4044) Concrete wall with 100mm insulation 2 x 100mm plasterboard (P2104) to exterior 2 x 100mm plasterboard (P2104) to interior 2 x 100mm plasterboard (P2104) to exterior 2 x 100mm plasterboard (P2104) to interior	FRAMED CONCRETE WALL (P4044) Concrete wall with 100mm insulation 2 x 100mm plasterboard (P2104) to exterior 2 x 100mm plasterboard (P2104) to interior 2 x 100mm plasterboard (P2104) to exterior 2 x 100mm plasterboard (P2104) to interior

INTERNAL PARTITION TYPES

P1	P1a
2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104)	2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104)
P2	P3a
2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104)	2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104)
P3b	P4
2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104)	2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104)
P4a	P4b
2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104)	2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104)
P5	P5a
2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104)	2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104)
P6	P7
2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104)	2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104)
P8	
2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104) 2 x 100mm plasterboard (P2104)	

NOTES

These drawings reflect the current design which is in progress. The dimensions might change during the coordination with the subcontractors.

Current coordination with the subcontractors listed below is in progress and it is not finalized yet.

Curtain walling (TBC),
Cladding (Kynatlon),
Personnel door (ASSA ABLOY),
Overhead door (ASSA ABLOY),
White wall (Fire resistant wall),
Lift (Schindler),
Precast Slab (Instock)

Design might be revised due to the input of other subcontractors that are not involved yet.

All internal dimensions are still to be confirmed and they will be frozen after the coordination with M&E subcontractors is finalized.

NOTES

These drawings reflect the current design intent. They are subject to further development during detail design, including technical input from the full consultant design team, statutory, regulatory and trade authorities.

Do not scale from this drawing.

Contractor to take and check all dimensions on site before work commences. Discrepancies to be reported to architect. Subcontractor to verify all dimensions on site before making shop drawings or commencing manufacture. This drawing is copyright.

These proposals are subject to any planning requirements and conditions.

Rev.	Description	SM	Date
P1	Grid offset by 50mm (towards the outside)	SM	2024.02.26
C1	Structure and cladding updated to match subcontractors design	SM	2024.03.27
C2	Structure updated to match Compass design	SM	2024.04.16
C3	Wall colour coding added	SM	2024.04.30
C4	Pump outs relocated to avoid the clash with the foundations	SM	2024.05.15
C5	Pump outs relocated to avoid the clash with the foundations, reception CW as per subcontra	SM	2024.05.16

Geddes Architects

Studio 3.31 Canterbury Court Kennington Park
1-3 Brixton Road London SW9 6DE
www.geddesarchitects.com T +44 (0) 203 150 4605


ERI MTP LTD

PLOT 9A & 9B


Ground Floor Plan

DATE	04.01.2024	CHECK STAGE	Construction
DRAWN	SM	CHECK DATE	04.02.2024
SCALE	1:100 @ A0	CHECKED BY	CG

L040-GED-21-ZZ.GF-D-A-000110 C5

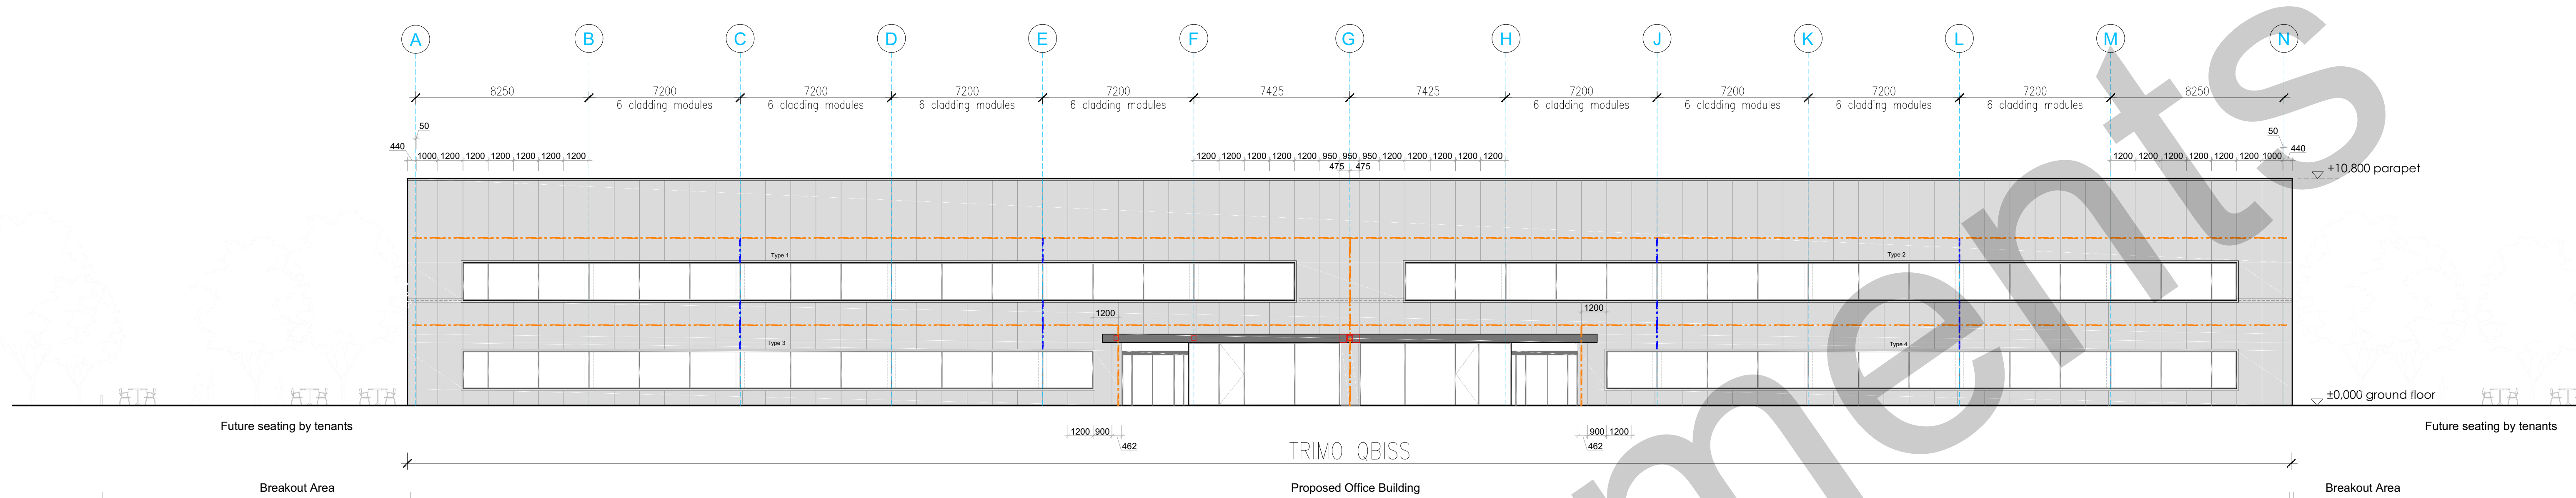

Front (south) elevation, Scale 1:150

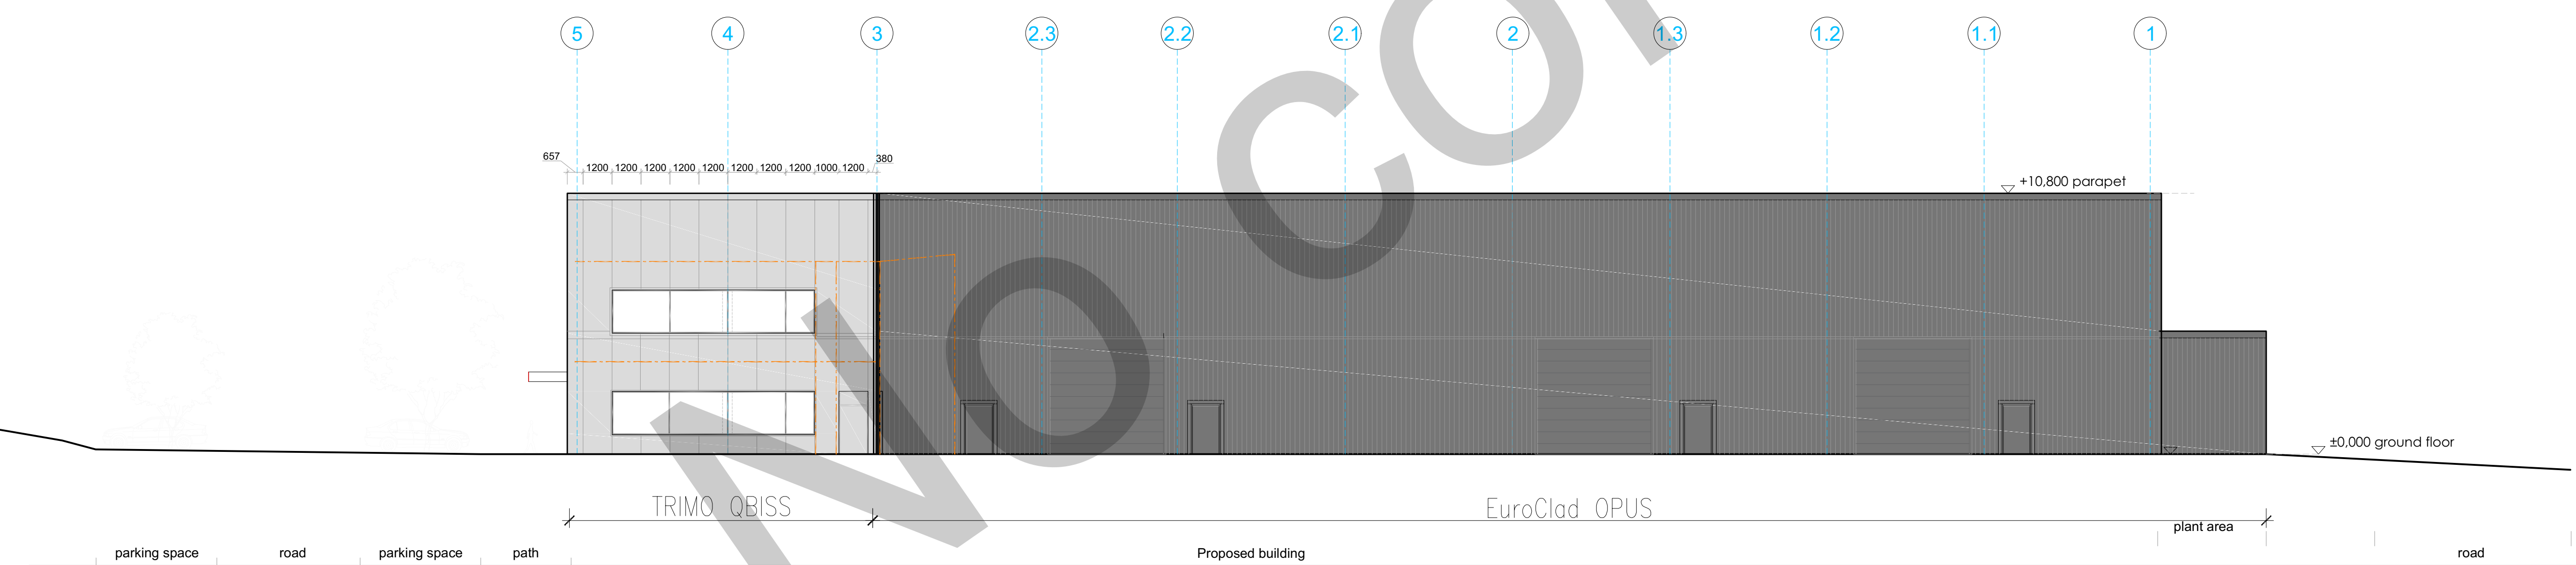

Side (east) elevation, Scale 1:150

KEY:

- Location of cavity barriers
- Smoke barriers within the raised floor and ceiling void to continue between the cladding and the lining
- TBC by the fire consultants

Silver colour to:

- QBISS cladding
- 2No Doors and frames - DGF01 & DGF01A
- Required samples for Client's approval:
- Special Metallic Silver and equivalent Ral
- Special Metallic Light Silver and equivalent Ral
- Colourcoat Prisma Seren Silver and equivalent Ral

Dark grey colour to:

- Euroclad cladding
- Curtain walling and window frames
- Doors and door frames
- Canopy fascia and ceiling
- Required samples for Client's approval:
- Ral 7015
- Ral 7016
- Ral 7021
- Ral 7024

NOTES

These drawings reflect the current design intent. They are subject to further development during detail design, including technical input involving the full construction design team, statutory, regulatory and trade authorities. Do not scale from this drawing.

Contractor to take and check all dimensions on site before work commences. Discrepancies to be reported to architect. Subcontractor to verify all dimensions on site before making shop drawings or commencing manufacture. This drawing is copyright.

These proposals are subject to any planning requirements and conditions.

NOTES

These drawings reflect the current design which is work in progress. The dimensions might change during the coordination with the subcontractors.

Current coordination with the subcontractors listed below is in progress and it is not finalized yet.

Steel structure (Compass)
Curtain walling (ARGUA)
Cladding (Kynastion)
Personnel door (ASSA ABLOY)
Overhead door (ASSA ABLOY)
White wall (fire resistant wall)
Lift (Schindler)

Design might be revised due to the input of other subcontractors that are not involved yet. All internal dimensions are still to be confirmed and they will be frozen after the coordination with M&E subcontractors is finalized.

Rev.	Description	Drawn	Date
P2	Grids and cladding amended	JRP	01.03.24
P3	Cavity barriers indicated	HK	25.03.24
C1	Structure and cladding updated to match subcontractors design	SM	27.03.24
C2	Colour coding added	HK	22.04.24

Geddes Architects

Studio 3.31 Canterbury Court Kennington Park
1-3 Broken Road London SW9 6DE
www.geddesarchitects.com T +44 203 150 4605

Client: ERI MTP LTD


Project: PLOT 9A & 9B

Title: South and East Elevations


DATE	05.02.2024	CHECK STAGE	Construction
DRAWN	S2M	CHECK DATE	05.02.2024
SCALE	1:150 @ A1	CHECKED BY	CG

L040-GED-41-ZZ-ZZ-D-A-000200 C2

© Geddes Architects Limited

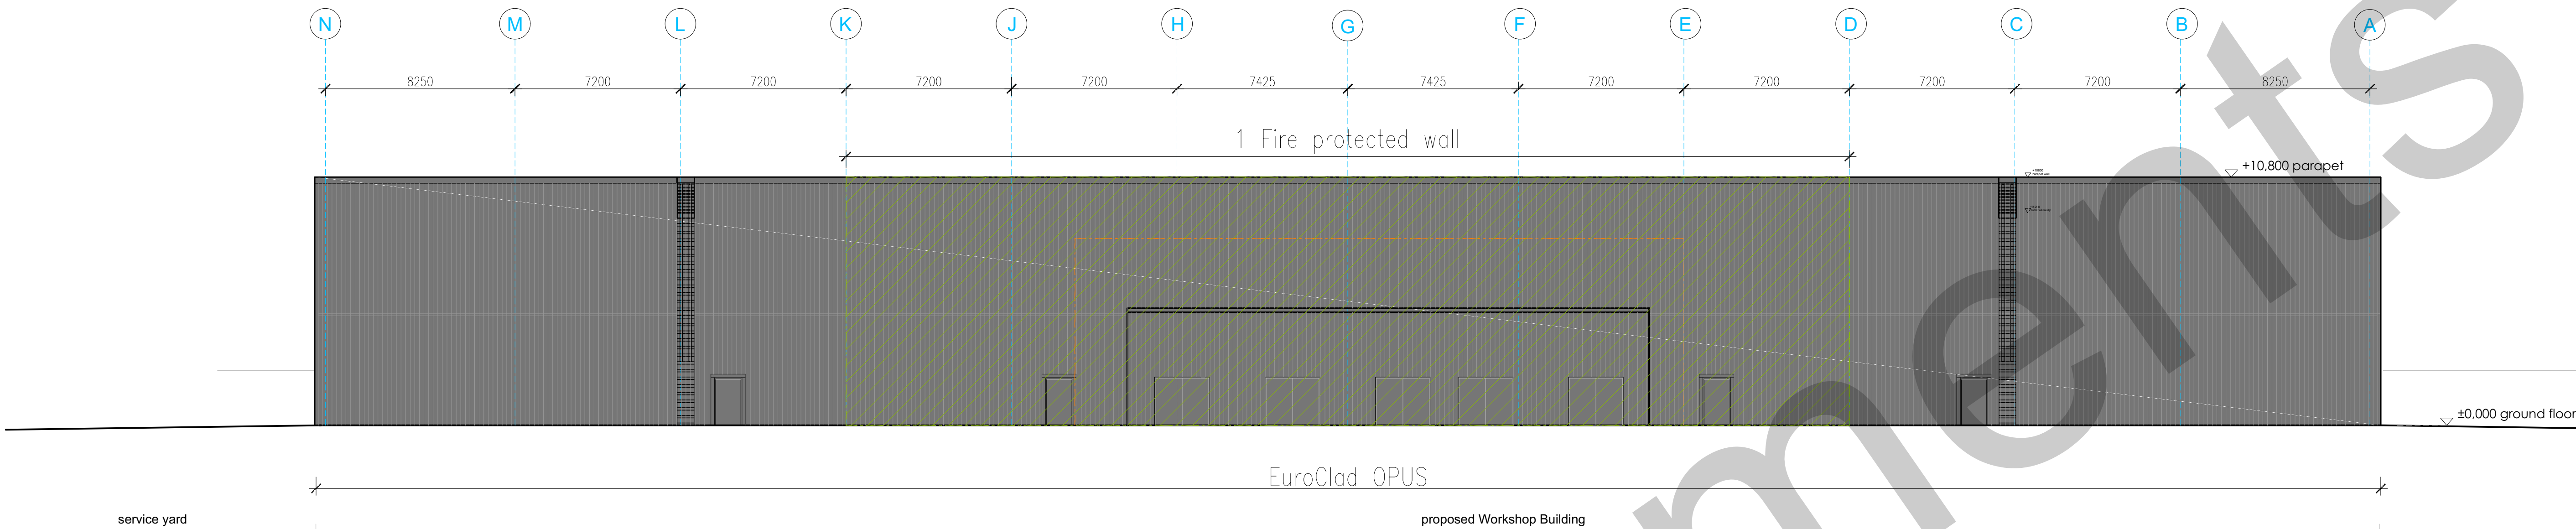

Back (north) elevation, Scale 1:150

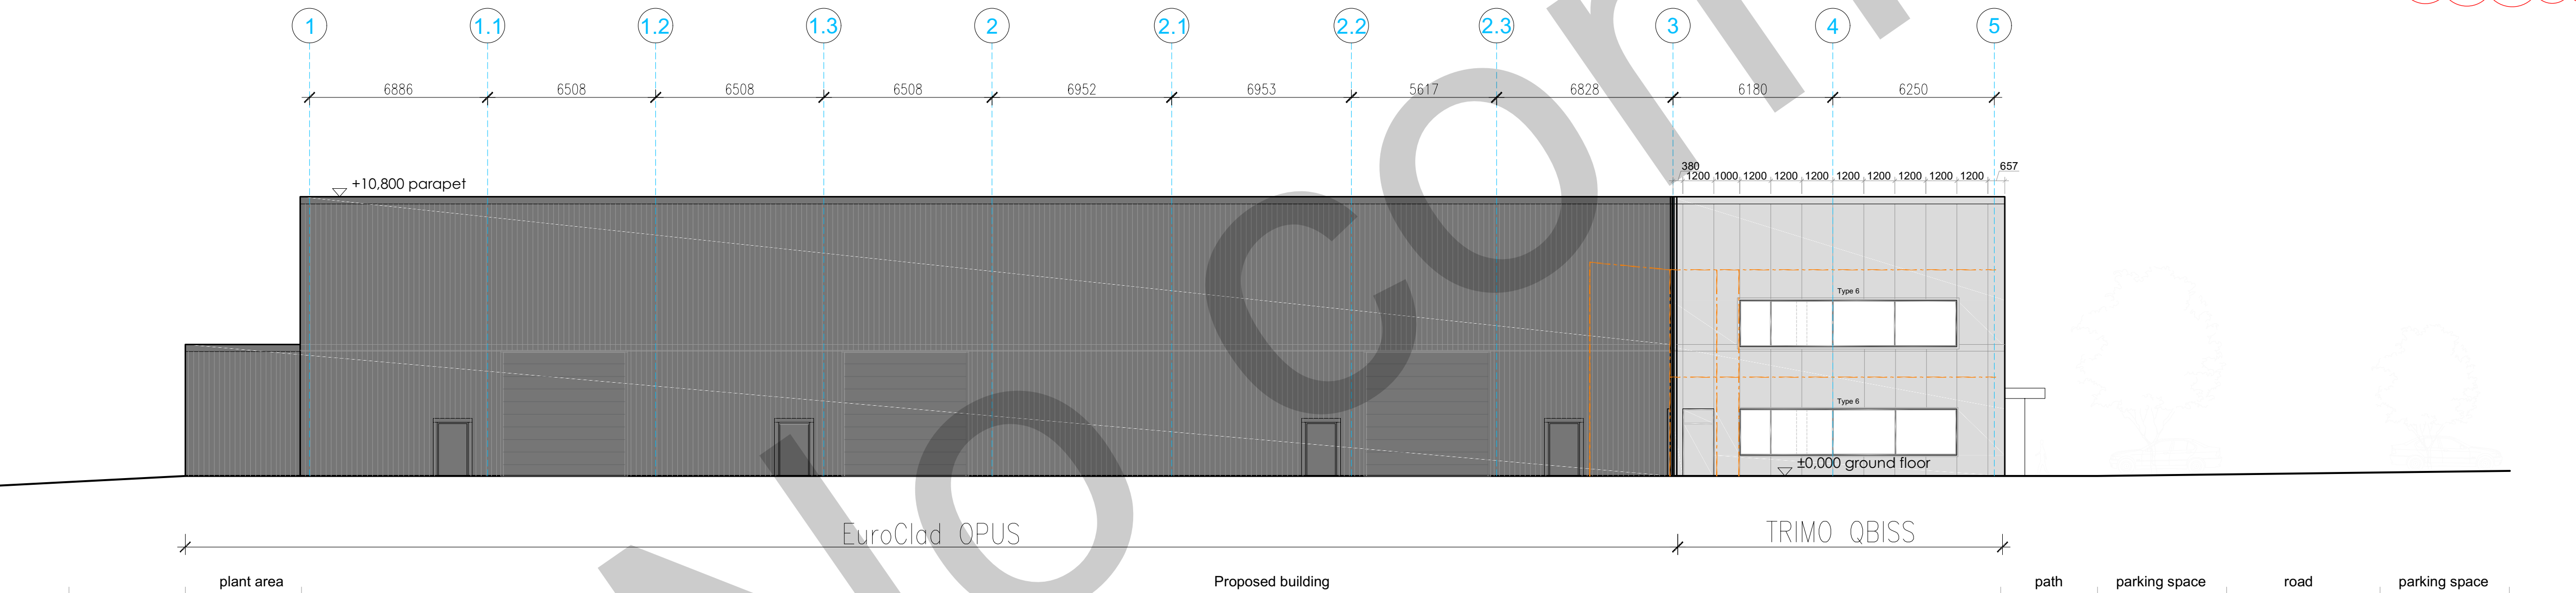

Side (west) elevation, Scale 1:150

KEY:

- Location of cavity barriers
- Smoke barriers within the raised floor and ceiling void to continue between the cladding and the lining
- TBC by the fire consultants
- 1 Hour Fire Protected Wall

Silver colour to:

- QBISS cladding
- 2 No Doors and frames - DGF01 & DGF01A

Required samples for Client's approval:

- Special Metallic Silver and equivalent Ral
- Special Metallic Light Silver and equivalent Ral
- Colourcoat Prisma Series Silver and equivalent Ral

Dark grey colour to:

- Euroclad cladding
- Curtain walling and window frames
- Doors and door frames
- Canopy fascia and ceiling

Required samples for Client's approval:

- Ral 7015
- Ral 7021
- Ral 7024

NOTES

These drawings reflect the current design intent. They are subject to further development - during detail design, including technical input involving the full construction design team, statutory, regulatory and trade authorities.

Do not scale from this drawing.

Contractor to take and check all dimensions on site before work commences. Discrepancies to be reported to architect. Subcontractor to verify all dimensions on site before making shop drawings or commencing manufacture. This drawing is copyright.

These proposals are subject to any planning requirements and conditions.

NOTES

These drawings reflect the current design which is work in progress. The dimensions might change during the coordination with the subcontractors.

Current coordination with the subcontractors listed below is in progress and it is not finalized yet.

Steel structure (Compass)
Curtain walling (ARQA),
Cladding (Kynaston),
Personnel door (ASSA ABLOY),
Overhead door (ASSA ABLOY),
White wall (fire resistant wall) Ltd. (Schlinder).

Design might be revised due to the input of other subcontractors that are not involved yet.

All internal dimensions are still to be confirmed and they will be frozen after the coordination with M&E subcontractors is finalized.

Rev.	Description	Drawn	Date
P2	Grids and cladding amended	JRP	01.03.24
P3	Cavity barriers indicated	HK	25.03.24
C1	Structure and cladding updated to match subcontractors design	SM	27.03.24
C2	Colour coding added	HK	22.04.24

Geddes Architects
Studio 3.31 Canterbury Court Kennington Park
1-3 Broken Road London SW9 6DE
www.geddesarchitects.com T +44 203 150 4605

Client: ERI MTP LTD

Project: PLOT 9A & 9B

Title: North and West Elevations

DATE	05.02.2024	CHECK STAGE	Construction
DRAWN	S2M	CHECK DATE	05.02.2024
SCALE	1:150 @ A1	CHECKED BY	CG

L040-GED-41-ZZ-ZZ-D-A-000201 C2



SPECIFICATION NOTES

1. General.
This plan to be read in conjunction with the following documents:
• Landscape works specification and other drawings by terra firma
• Arboricultural report and survey by B. Harverson

2. General landscaping.
i. Existing levels to be preserved around retained existing trees and vegetation. Existing trees and vegetation to be retained are to be protected in accordance with BS5837:2012 during construction.
ii. All landscape works to be undertaken by competent persons, with appropriate training and equipment.
iii. All arisings to be removed from site at contractor's expense unless noted otherwise. (e.g. woodchip, gravel, topsoil, timber sleepers).

3. Services.
The contractor must ascertain for himself/herself the exact location of underground services before commencing work.

4. Soil Materials Generally.
i. Purity: Soils shall be free from roots, stonions, rhizomes, propagules of perennial or invasive weeds couch grass, bindweed, docks, Japanese knotweed, giant hogweed and horsetail/mineral (Equisetum arvense).
ii. Foreign matter: On visual inspection, free from non-soil material, brick and other building materials and wastes, sharps, and any other foreign matter or material or substance that would render the soil or soil ameliorant unsuitable for use.
iii. Contamination: Do not use topsoil, subsoil, sand or compost contaminated with rubbish or other materials that are:
• Corrosive, explosive or flammable;
• Hazardous to human or animal life;
• Detrimental to healthy plant growth.
iv. Give notice: If any evidence or symptoms of soil contamination are discovered on the site or in topsoil, subsoil, sand or compost or other planting media to be used.

5. Soil testing
Each soil source (imported and site-won subsoil and topsoil - see below) shall be analysed by Tim O'Hare Associates, Howbery Park, Wallingford, Oxon OX10 8BA, Tel: 01491 622653. Email: info@oha.co.uk, www.oha.co.uk (or equivalent approved).

6. Subsoil for general planting areas (sample of site-won and/or imported subsoil to be sent for testing to check compliance with parameters below)
Provide subsoil as necessary to make up deficiency on site. Natural or manufactured subsoil (from approved source) will be acceptable (within parameters given below). Subsoil to be tested to determine suitability for proposed use; test report to be submitted for approval and to enable amelioration recommendations. Subsoil should be free from commonly tested contaminants, including asbestos. Subsoil parameters to be within the following:

Parameter	Unit	Lower Limit	Upper
Clay (<0.002mm)	%	5	35
Silt (0.002-0.05mm)	%	0	35
Sand (0.05-2.0mm) of which at least 40% shall fall into fine to medium sand range	%	50	90
Stones (2-50mm)	% dry wt.	--	50
Stones (>50mm)	% dry wt.	--	0
pH Value	Unit	5.5	8.5
Electrical Conductivity (12.5 water extract)	µS/cm	--	1500
Electrical Conductivity (CaSO4 extract)	µS/cm	--	2800
Exchangeable Sodium Percentage	%	--	15
Organic Matter	%	--	1.5

7. Subsoil for tree pits (sample of site-won and/or imported subsoil to be sent for testing to check compliance with parameters below)
Provide subsoil as necessary to make up deficiency on site. Natural or manufactured subsoil (from approved source) will be acceptable (within parameters given below). Subsoil to be tested to determine suitability for proposed use; test report to be submitted for approval and to enable amelioration recommendations. Subsoil should be free from commonly tested contaminants, including asbestos. Subsoil parameters to be within the following:

Parameter	Unit	Lower Limit	Upper
Clay (<0.002mm)	%	5	18
Silt (0.002-0.05mm)	%	0	25
Sand (0.05-2.0mm) of which at least 40% shall fall into fine to medium sand range	%	60	90
Stones (2-50mm)	% dry wt.	--	50
Stones (>50mm)	% dry wt.	--	0
pH Value	Unit	5.5	8.5
Electrical Conductivity (12.5 water extract)	µS/cm	--	1500
Electrical Conductivity (CaSO4 extract)	µS/cm	--	2800
Exchangeable Sodium Percentage	%	--	15
Organic Matter	%	--	1.5

8. Subsoil for general landscaping (sample of site-won and/or imported topsoil to be sent for testing to check compliance with parameters below and to inform any necessary amelioration - see below)
Existing topsoil to be stripped and re-used, provided soil is within parameters given below when analysed. Imported topsoil to be good quality sandy loam or manufactured topsoil (from approved source, meeting parameters given below). Topsoil (site-won or imported) is to be tested to determine suitability for proposed use and should be free from commonly tested contaminants, including asbestos; test report to be submitted to Landscape Architect for approval and to enable amelioration recommendations to be made:

Parameter	Unit	Lower Limit	Upper
Clay (<0.002mm)	%	5	18
Silt (0.002-0.05mm)	%	0	35
Sand (0.05-2.0mm) of which at least 40% shall fall into fine to medium sand range	%	50	85
Stones (2-20mm)	% dry wt.	0	20
Stones (20-50mm)	% dry wt.	0	15
Stones (>50mm)	% dry wt.	0	0
pH Value	Unit	5.5	8.5
Electrical Conductivity (12.5 water extract)	µS/cm	--	1500
Electrical Conductivity (CaSO4 extract)	µS/cm	--	2800
Exchangeable Sodium Percentage	%	--	15
Organic Matter	%	4.0	8.0
Total Nitrogen	%	0.15	--
Carbon: Nitrogen Ratio	--	--	20:1
Extractable Phosphorus	mg/l	26	100
Extractable Potassium	mg/l	240	1200
Extractable Magnesium	mg/l	50	600

9. Ameliorant: fertilizer and compost (contractor is responsible for submitting a sample of imported or site-won topsoil (to inform requirements).
Topsoil amelioration to be determined by analysis. Once amelioration requirements ascertained as required, approved (peat free) composts to PAS100 and/or fertilizers to be incorporated during cultivation at required rate to full depth of growing medium.

10. Soil handling and depths.
Management of soils to be in accordance with the Construction Code of Practice for the Sustainable Use of Soils on Construction Sites
i. Topsoil and subsoil to be handled (i.e. excavated and/or imported, stored, spread, cultivated) in accordance with method agreed in writing by Landscape Architect prior to work commencing. All topsoil and subsoil areas shall be thoroughly cultivated by hand or suitable machinery to the full depth of the topsoil layer; incorporating any ameliorants as required. If compaction is suspected in sub-grade, subsoil or topsoil surfaces, these should be ripped as necessary to decompact and ensure adequate drainage.
ii. Hand cultivations shall be carried out to achieve the required finish on areas where machine cultivation is impossible adjacent to kerbs, manholes and footpath junctions, around retained trees etc. Surplus plant matter, rubbish and surface stones having any dimension greater than 25 mm shall be collected and removed from the site. Topsoil and subsoil to be stored in heaps, maximum of 2m in height, providing soil is reasonably dry and friable during stripping and handling - using a tracked excavator. To protect from wet weather once final height is achieved, an excavator should regrade the sides and top of stockpile to firm surface by tracking across it to form a smooth gradient.
iii. Final topsoil depth (allowing for settlement) to be 300mm for tree pits and general planting areas and 150mm for grass. Finished soil levels to be 25mm above/below adjoining paving or kerbs: not less than 150mm below dpc of adjoining buildings; shrub areas to be higher than adjoining grass areas by 25 mm. Topsoil to be spread in lightly compacted layers, max. 150mm depth, gently firm each layer before spreading the next.

11. Plant handling and establishment.
Plant handling shall be in accordance with 'Handling and establishing landscape plants', published by the CPSE through the JCLI. (<https://www.cshub.com/wp-content/uploads/2014/12/The-National-Plant-Specification-Handling-and-Establishment.pdf>) The contractor shall comply with Part 3: Recommendations for plant handling from delivery to site to ensure successful establishment.

12. General planting notes.
Details for tree, hedge and general planting to be finalised once final site conditions are known (i.e. compaction and permeability of ground). General plant stock to conform to BS 3936, advanced nursery stock to BS 8545, and planting to BS 4428. Plants shall be first class examples of their species or variety, free from all pests and diseases, with good fibrous root systems and materially undamaged. All planting operations to be in general compliance with BS4428: 'Code of Practice for general landscape operations'.
Only carry out all planting while soil and weather conditions are suitable:
• Do not plant during periods of frost or strong winds. Plant only during the following periods
• Deciduous and conifer trees: Late October to late March (rootball and bare root)
• Container grown plants: At any time if ground and weather conditions are favourable. Ensure that adequate watering is provided
• Bulbs: September/October
Setting out of planting beds to be approved by Landscape Architect before work commences. Ensure that plant beds are neatly defined, and rise from adjacent paved areas as specified above. All tree pits, tree circles in lawn and planting beds are to be mulched with approved bark mulch to 75mm depth after planting.

13. Plant biosecurity
Plant procurement should follow the latest recommendations from DEFRA and landscape contractors should verify the status of all specified species prior to procuring. Plant material should be sourced from UK growers with a sound Biosecurity Policy and management systems that can demonstrate the traceability of their stock with plant health certificates / plant passports or other documentation (commensurate with the HTA Plant Health Assurance Scheme (still in development phase)).
Selected plants, including trees should be propagated and grown on a UK nursery, or containerised and grown-on in the UK for a minimum of 5 years (trees) or 2 years (shrubs). Any Xylella host plants specified must come from a UK nursery and must not be imported from Europe or anywhere else in the world, directly to site. There must be full traceability on the Xylella host plants (ideally back to its origin). The contractor is responsible for checking compliance of growers and to submit their own Biosecurity Plan with their tender.

14. Tree planting
Any proposed substitutions of species shown on plan to be approved by landscape architect prior to planting. Details for tree planting to comply with BS8945. As a guide all trees to be planted in square pits with base undisturbed unless drainage / compaction problems known. Plant at a depth where the root flare is clearly visible at the soil surface. Where trees have been supplied with the root flare too deep excess soil or fibrous root growth should be removed before planting. All trees to have 'Pride' free irrigation/aeration system installed as supplied by Platipus 01737 762300 www.platipus-anchors.com or approved equivalent. Water-in heavily after planting and much surface, ensuring much is not in contact with trunk of tree. Tree support to comply with BS 8545. Bare root trees to have a single upright stake. Trees to be underground guyed shall have suitable guying systems installed as supplied by Platipus 01737 762300 www.platipus-anchors.com or approved equivalent. Any necessary remedial tree works are to be carried out by an approved tree surgeon to BS 3998. Trees planted within grass areas to be set in mulched earth circles, 1m diameter around tree trunk, with turf trimmed neatly to form circle.
i. Trees up to 20cm girth.
Depth of tree pits to be the same as the rootball and with overall width to be 150mm wider than the diameter of the rootball (75mm min. from rootball edge to tree pit side). Pits to be backfilled with 300mm depth of specified topsoil over subsoil as per spec.
ii. Trees - 20cm girth and above.
Depth of tree pits to be 200mm deeper than rootball and with overall width to be 150mm wider than the diameter of the rootball (75mm min. from rootball edge to tree pit side). Pits to be backfilled with 400mm depth of specified topsoil over washed medium coarse grade sand to a depth of 200mm below rootball.

15. Native tree and shrub mix (native buffer planting).
All plants to be planted in cultivated planting beds with species randomly mixed for natural effect, and planted in groups of 3-5 plants of any one species. Plants to be notch- or pit-planted. Plant on grid at spacing given in schedule. Provide and install each plant with an appropriate sized recyclable staked green tree or shrub shelter (available from Tubex Ltd phone 01621 874201 or similar approved). Position shelter stake on windward side of plant, drive vertically into bottom of pit before planting, to a min. depth of 300mm and consolidate backfill material around stake; attach shelter to stake with a minimum of two ties.

16. Native hedges.
Species to be randomly mixed for natural effect, and planted in groups of 3-5 plants of any one species. Depth of planting trench to be same as root system, overall width space 150mm wider than root system (75mm min. from root system edge to sides of trench). Trench to be backfilled with 300mm depth of specified topsoil over subsoil as per spec. Provide and install each plant with an appropriate sized recyclable staked green shrub shelter (available from Tubex Ltd, phone 01621 874201 or similar approved). Position shelter stake on windward side of plant, drive vertically into bottom of pit before planting, to a min. depth of 300mm and consolidate backfill material around stake, attach shelter to stake with a minimum of two ties.

17. Clipped hedges.
Depth of planting trench to be same as rootball, overall width 150mm wider than rootball (75mm min. from rootball edge to sides of trench). Trench to be backfilled with 300mm depth of specified topsoil over subsoil as per spec. Fertiliser to be incorporated as required to ensure establishment and continued thriving of plants - type and application rate to be determined by analysis. Central post and wire supporting to be provided with two line wires and plants to be tied in using horticultural plastic ties. On planting, hedges to be trimmed to 800mm ht. and sides trimmed to neat shape where necessary.

18. Shrub and Ground Cover Planting.
All plants to be planted into cultivated planting beds (with 300mm depth specified topsoil) at densities shown in plant schedule, backfilled with same topsoil. Fertiliser to be incorporated as required to ensure establishment and continued thriving of plants - type and application rate to be determined by analysis.

19. Grass.
Seeding shall be carried out only during appropriate seasons and while soil and weather conditions are suitable for the relevant operations. Only machinery and tools suitable for the site conditions and the work to be carried out shall be used. Hand tools shall be used around trees, plants and in confined spaces where it is impractical to use machinery. The soil shall be weed free prior to turfing and seeding. Contact herbicide as specified should be applied to all areas of weed growth 4-6 weeks before grassing and repeated if necessary to maintain a weed free bed. Where deep rooted weeds are present (docks, thistles etc.) approved Glyphosate-based herbicide should be applied as a spot treatment. Seed shall be laid on prepared, levelled soil (minimum 150mm depth) in the areas indicated on the drawings in accordance with BS 4428:1989 Code of practice for general landscape operations.

20. Root barrier.
Root barrier system to be used in locations as indicated on plan. To be supplied by GreenBlue Urban 01424 717797 or other approved supplier. Thickness, size and depth of installation of root barrier to be to manufacturer's recommendations for particular circumstances.

Notes:

- All materials to be as detailed or accepted equivalent.
- Refer also to architectural and engineering drawings as applicable.

Existing tree to be retained and protected in accordance with BS 5837:2012 - refer to arboricultural report '1233.bjh.AMS.MIRA.Plot&Sand9.31.05.22 by Bernie Harverson

Fenced Root Protection Area - refer to arboricultural report: To remain undisturbed and uncompacted (no material or equipment storage permitted)

Existing vegetation & proposed planting with Infrastructure II

Proposed specimen tree

Mixed native buffer planting with trees

Mixed native buffer planting without trees

Ornamental planting

Ornamental rain garden planting

Amenity grass

Meadow grass

Clipped hedgerow

Native hedgerow

Asphalt road and pavement

Brushed concrete surfacing to service yards

Acheson and Glover Xlfo block paving 100x200x80mm - Colour: Lakrid

Acheson and Glover Plaza block paving 600x200x80mm - Colours: Salt, Pepper, Lakrid

CEDEC Footpath Gravel - Gold Self-binding gravel

Gravel trench

Secure boundary fence

Indicative proposed contours

05	07.10.22	AS	LF	Tender issue
04	30.09.22	TJ	AS	Draft tender issue
03	08.07.22	TJ	LF	Service yard surface treatment amended, site plan updated
02	07.07.22	TJ	LF	Amendments to tree planting
01	07.07.22	TJ	LF	First issue
rev.	date	by	ch	notes

project Plot 8 & 9 - MIRA Horiba

title Landscape Proposals

status Planning scale @ A1 1:500

dwg no 1328-TFC-P9-00-DR-L-1001

terrafirma LANDSCAPE ARCHITECTS

South H. House, Bedford Road, Tel: +44 (0)1753 262 000 Peterfield, Hampshire GU22 2BA Web: www.terrafirmalandscape.co.uk © Copyright reserved 2022

Cut & Fill Plans