

SPECIFICATION

- Applies to all landscape operations.

1.1 Preliminaries
Health and Safety considerations are as the Bloor Homes Trade Specifications.
The following specification is in-line with the Trades Specification, however where there are specific requirements, these notes take precedence over the general guidance outlined within the Trade Specification.
The Site Manager should possess and distribute information to the relevant contractors regarding all underground services, engineering, drainage, lighting and ecological constraints and current proposed landscaping prior to external works and landscaping operations.
Tree and hedgerow protection, subsoil cultivation, topsoiling and levelling/grading operations outlined below are the responsibility of the Site Agent unless stated otherwise.
Trees in hard surfaces will require engineered tree pits which will require construction when surfaces and service routes are being installed. Reference should be made to the appropriate tree pit detail drawing provided by the engineers and on the landscape drawings where applicable.
Where tree pits are within 5m of roads and services, and within 3m of other paved surfaces* a linear root barrier is to be installed in accordance with the manufacturer's instructions. The barrier should be as near as possible to the surface or service route to be protected to provide as much rooting area as possible for the tree.
*distances may vary according to requirements.

1.2 Soft Landscaping Considerations
All soft landscaping should be carried out by specialist landscape sub-contractor who is either British Association of Landscape Industries (BALI) accredited or can demonstrate a proven track record.
All plants shall conform to the specification details shown on this drawing, which are taken from the National Plant Specification, and must be well rooted, healthy stock. Plants required for hedging or massing must be uniform in every respect.
Plants must be in accordance with the relevant section of the current BS 3936 Nursery Stock Specification, and trees to the most current BS 8545 Trees: **From Nursery to Independence in the Landscape.**
Supplying nurseries shall be registered under the RITA Nursery Certification Scheme.
All plants shall be packed, transported and handled in accordance with the Code of Practice for Plant Handling as produced by the Committee for Plant Supply and Establishment (CPSE) and handling of trees to the most current BS 8545.
Any variance from the specification stated on each landscape drawing may result in a request to replace planting, at the contractors expense.

1.3 Tendering and Implementation
Landscape Contractors are required to tender and implement as per the schedule and specification.
It is recognised that there are seasonal variations in plant availability and so it may be necessary for plant specifications to be revised. However any substitutions should be with a suitable alternative of comparable size to meet the schedule requirements, and should be approved by the Bloor Homes Landscape Design/Commercial Department.
All landscape implementation will be audited. Plant material not approved will be rejected and replaced at the Landscape Contractor's own expense, as stated in 1.2.
The site should be found in a condition as described in the Ground Workers' Trade Specification document which includes the removal of all builder's debris and the hardcore base set for scaffolding.

2 RETENTION OF EXISTING TREES AND HEDGEROWS
Precautions must be taken to ensure that trees and hedges shown for retention remain undisturbed with roots and branches protected with robust barriers in accordance with the most current BS 5837 Trees in Relation to Design, Demolition and Construction. Any tree surgery work should be in accordance with the most current BS 3998 Recommendation for Tree Work and must comply with any Conservation Area, Tree Preservation Orders or specific planning conditions where appropriate.
Reference must be made to Tree Protection Drawings.

3 PRE-PLANTING AND PRE-TURFING GROUND PREPARATION (Groundworking)

3.1 Subsoil Cultivation
Prior to any topsoiling all subsoil should be thoroughly 'ripped' to relieve compaction using suitable machinery, or by hand in confined areas or in proximity to existing tree roots to a depth of 150mm.

3.2 Imported and Stored Topsoil
Wherever possible store and re-spread existing topsoil to POS areas to encourage re-generation of localised native species.
Topsoil, all topsoiling and soil storage operations are to be carried out in accordance with the current BS 3882 Specification for Topsoil. Topsoil spreading should be carried out to the depths shown below and all topsoiled areas should be cleared of all extraneous matter such as perennial weeds, plastic, wood, metal and stones greater than 50mm in any dimension which should be removed from site to a licensing facility.
Minimum depths of topsoil after firming and of subsoil cultivation to be achieved:
Type of Soft Landscaping Topsoil Depth Depth of subsoil to be broken up
Planted areas* 300mm 150mm
Grass Areas 150mm 150mm
Rear Gardens 150mm 150mm
* Remove extraneous matter within cultivated subsoil above 75mm in any dimension.

3.3 Levelling/Grading
In final grading operations finished soil levels adjacent to buildings are to be 150mm below damp proof course. For planted areas where 75mm depth bark mulch is specified the soil should be graded down towards adjacent paved or grass surfaces to 90mm below the paving or grass. This allows for full depth of bark mulch with 15mm clearance. For turfed areas final soil levels should be 10mm above the adjacent paving ready to receive the turf and for seeded areas at least 30mm above.

3.4 Weed Treatment
Only where necessary, because significant weed growth has started to establish, treat existing weeds with a non-residual based, herbicide and allow a suitable period as recommended by the manufacturer for this to take effect. Herbicide should be used strictly in accordance with The Pesticides Act 1999 (or otherwise updated/superseded legislation), according to manufacturer's instructions and only by qualified staff. Use products that are approved by the Soil Association.
Remove small amounts of weed growth within shrub beds by hand at time of planting.

4 PLANTING

4.1 Ground Preparation
Planting shall not be carried out when the ground is waterlogged, frost-bound or during periods of cold drying winds.
All planting, seeding and turfing operations are to be in accordance with latest BS 4428 Code of Practice for General Landscape Operations.
A general purpose organic slow release fertilizer at the rate of 100g/m² is to be incorporated into the top 150mm of topsoil during final cultivations.

4.2 Setting Out
Shrubs and hedges are to be set out as shown on the drawing at the specified densities and centres. The operatives carrying out the works should be able to interpret drawings, set out landscaping areas and communicate any discrepancies with our Site Manager.
Ornamental hedges are to be planted in a staggered row unless otherwise stated.
Trees are to be planted in the positions shown on the drawing ensuring that they are at the correct distances from adjacent buildings and 1.5m from drainage runs.
It is imperative that trees are planted with the correct species and locations as specified in the drawings in accordance with the NHBC Standards Chapter 4.2, or the LABC Standards, whichever is applicable.
It is the contractor's responsibility to ensure that all underground services have been located and identified in advance of tree pit excavation to avoid damage to any underground services or cables.

4.3 Planting
Bare rooted and root balled stock to be planted between mid-November and end-February.
Planting pit sizes should be relative to the container size or root ball of the plant and shall be sufficiently large enough to accommodate the plants without root damage and to allow for backfill of topsoil and planting compost.
All ornamental hedgerow/ boundary plants are to be 'topped' cut to form a level hedge across each section of new hedging.
Plants are to be pit planted into the prepared soil incorporating peat free tree and shrub compost in quantities shown below, and firmed in.
Quantities of peat free tree and shrub planting compost:
2-3L Shrubs and Herbaceous 3 Litres
5-10L Shrubs 5 Litres
25L Specimens 10 Litres
Trees 20 Litres plus 100g/m² organic slow release fertiliser and 150ml mycorrhizal dressing such as 'Rootgrow'

All trees and shrubs are to be watered thoroughly, to full ground capacity, immediately after planting and before the application of mulch. The landscape contractor shall allow for provision of all equipment to complete this initial watering, using water supply point as directed on site.

4.4 Tree Planting
Tree planting operations shall be in accordance with part 10 of the current BS 8545 Trees from Nursery to Independence in the Landscape.
Tree pits are to be excavated to 1m X 1m X 600mm with the sides well scarified to prevent smearing. The base of tree pits are to remain undisturbed and should only be broken up if there is a drainage problem and/or soil pan. If conditions make drainage necessary this should be provided away from the tree, with the base of the pit sloped to direct water into a drainage pipe.
Backfill of tree pits should be in layers of 150mm at a time starting with subsoil followed by layers of topsoil with compost etc, as shown above.
Root flare of the newly planted tree should be clearly visible at the soil surface. It should not be buried by excess soil or by mulch.
Ensure trees in hard surfaces and in restricted areas are planted in accordance with the appropriate tree planting detail with sufficient volumes of tree soil.
All trees are to be watered thoroughly, immediately after planting. The landscape contractor shall allow for provision of all equipment to complete this initial watering, using water supply point as directed on site.
Each tree is to receive at least 30 gallons when watered.

4.5 Tree Support
All trees are to be double staked with 100mm diameter stakes and a half-round timber cross-brace fitted to the windward side of the tree within 25mm of the top of the stakes ensuring that the tree is vertical and straight.
Stakes are to be securely driven into the ground prior to planting to a height above ground that is one third of the height above ground that the tree when planted to allow free movement of the crown.
Secure street trees to cross-brace with an adjustable plastic / rubber tie with spacer and buckle (buckle end to be nailed to stake).
Secure POS trees with a bio-degradable hessian tree tie, wrapping the material round half to form a spacer and nailing it to the stake or cross-brace.
Each tree should be fitted with a tree irrigation/aeration system unit fitted to fully surround the root ball in accordance with the details. Refer to specific tree planting details.
Linear root barriers where required should be installed as near to the surface or service route to be protected as possible to provide as much rooting area for the trees as possible. Ensure that there are no sharp objects close to either side of the barrier and that the top edge of the root barrier remains 10mm above the surface on the tree side with no growing medium over the top of the barrier. Overlapping ends should be joined by taping both sides with jointing tape.

4.6 Climber Support
Climbers are to be supported by timber trellis screwed to the wall or fence.
Supporting canes supplied with climbers are to be carefully removed and the climbers are to be fanned out and tied into the trellis with appropriate plant ties as required. Climbers supplied on frames can be left on the frame and the frame fixed to the fence or wall.

4.7 Mulch
All trees and shrubs are to be watered thoroughly, to full ground capacity, immediately after planting and before the application of mulch. The landscape contractor shall allow for provision of all equipment to complete this initial watering, using water supply point as directed on site.
Ensure the area to be mulched is entirely free from annual and perennial weeds and has been watered prior to applying an even spread of mulch to planting areas to control weeds and retain moisture.
Unless instructed otherwise apply good quality bark mulch to a depth of 75mm to ornamental planting beds, hedgerows and tree stations.
Where stone mulch is requested by the regional office apply 40mm of stone over Plantex Geotextile membrane or equivalent pegging down with metal pegs.
Finished soil levels adjacent to buildings are to be 150mm below damp proof course. For planted areas where 75mm depth bark mulch is specified the soil should be graded down to adjacent paved or grass surfaces to 90mm below the paving or grass. This allows for full depth of bark mulch with 15mm clearance.
Where 40mm depth stone mulch is specified with geo-textile membrane grade to 55mm below paving or grass within 500mm.
Finished mulch levels should be no higher than 15mm below adjacent pavement or grass levels to avoid any spillages.

4.8 Whip Planting
Bare root plants are to be notch planted, ensuring the notch is vertical and deep enough for the roots to hang freely. The notch is to be closed and the soil well firmed around the roots. Any container grown or root balled plants are to be pit planted. All stock is to be fitted with a 60cm minimum size clear plastic spiral rabbit guard secured to a bamboo cane, or with a tree shelter secured to a stake as appropriate. Whip planting NOT to be mulched.

4.9 Native Hedge Planting
Hedges are to be trench planted in a trench 500mm wide, planting in a double staggered row at 300mm centres with 300mm between rows, backfilling with the excavated material incorporated with a general purpose slow release fertilizer at a rate of 100g/m². Each plant is to be fitted with a clear plastic spiral rabbit guard secured to a bamboo cane support. Any container grown or root balled plants are to be fitted with a suitable tree shelter secured to stake.

5 GRASS
5.1 Turf Preparation
The area to be turfed shall be cultivated to a minimum depth of 150mm removing all weeds, debris and stones over 25mm diameter which should be placed in waste skips provided or as directed by the site manager. The surface shall be raked to smooth flowing contours with a fine tilth, incorporating pre-turfing fertiliser at 50 g/m².

5.2 Delivery and Storage
Turf shall be supplied in accordance with the most current BS 3969 Recommendations for Turf for General Purposes.
Turf shall be cultivated high grade turf well rooted seeded turf free from stones, weeds and coarse grasses. It shall be close textured, green in colour and be sufficiently fibrous to withstand handling. Turf rolls shall be regular in shape, 300mm wide and of uniform thickness (minimum 25mm). The grass shall be closely mown and shall not exceed 25mm in height.
Turf shall be stacked in piles of up to 1 metre. It shall not be laid in frosty or waterlogged conditions and shall not be stacked in rolls for more than three days. Any turf deemed to be substandard shall be replaced at the landscape sub-contractors cost.

5.3 Turf
Turfing operations shall be in accordance with the most current BS 4428.
Turf should be laid when weather conditions are suitable and not during exceptionally frosty or dry weather conditions.
Turf is to be laid with staggered joints, well butted together, and in firm contact with the soil working from planks positioned on turves already laid. At no time should freshly laid turf be walked on without the use of boards.
The turf shall be watered immediately on completion. The landscape contractor shall allow for provision of all equipment to complete this initial watering, using water supply point as directed on site.

PLANTING SCHEDULE

- All areas

PROPOSED TREES - Heavy Standard				
Number	Abbreviation Species	Girth	Height	Pot Size Specification
10 -	ACECAM	Acer campestre	12-14cm	350-425cm
3 -	BETPE	Betula pendula	12-14cm	350-425cm
3 -	CARBET	Carpinus betulus	12-14cm	350-425cm
3 -	CASCA	Castanea sativa	12-14cm	350-425cm
5 -	CRAMON	Crataegus monogyna	12-14cm	350-425cm
1 -	FAGSY	Fagus sylvatica	12-14cm	350-425cm
1 -	PRULAV	Prunus avium	12-14cm	350-425cm
3 -	PYRCOM	Pyrus communis	12-14cm	350-425cm
3 -	QUERO	Quercus robur	12-14cm	350-425cm
3 -	SALCAP	Salix caprea	12-14cm	350-425cm
5 -	TILCO	Tilia cordata	12-14cm	350-425cm
Total :41 -				

PROPOSED TREES - Selected Standard				
Number	Abbreviation Species	Girth	Height	Pot Size Specification
2 -	AMEBA	Amelanchier 'Ballerina'	10-12cm	300-350cm
1 -	BETUTJ	Betula utilis jacquemontii	10-12cm	300-350cm
5 -	CARBEL	Carpinus betulus 'Lucas'	10-12cm	300-350cm
5 -	CORCOL	Corylus avellana 'Emerald n' Gold	10-12cm	25-30cm
2 -	LIRLU	Liriodendron tulipifera	10-12cm	300-350cm
1 -	MALRU	Malus 'Rudolph'	10-12cm	300-350cm
2 -	PRUSNG	Prunus 'Snow Goose'	10-12cm	300-350cm
3 -	SORAU	Sorbus aucuparia 'Streetwise'	10-12cm	300-350cm
Total :27 -				

SHRUBS - Specimen				
Number	Abbreviation Species	Height	Diameter	Pot Size Specification
1 -	CORAV	Corylus avellana	100-125cm	5 brks: Branched: RB
4 -	ILEAQ	Ilex aquifolium	100-125cm	Leader with Laterals: RB
Total :5 -				

ORNAMENTAL HEDGE - to be planted in a staggered row at 0.3m centres				
Number	Abbreviation Species	Height	Diameter	Pot Size Density Specification
1310 -	ELAEBAE	Elaeagnus x ebbingei 'Gilt Edge'	40-60cm	5-7.5L 0.3Ctr Branched: 4 brks: C
Total :1310 -				

NATIVE ORNAMENTAL HEDGE				
Number	Abbreviation Species	Height	Diameter	Pot Size Density Specification
1074 -	FAGSY	Fagus sylvatica	80-100cm	5L 0.3Ctr 1+2: Transplant - seed raised: 4 brks: C
Total :1074 -				

GROUND COVER SHRUBS AND PERENNIAL PLANTS - Shrubs				
Number	Abbreviation Species	Height	Diameter	Pot Size Density Specification
131 -	BRASU	Brachyglottis 'Sunshine'	40-60cm	5-7.5L 0.6Ctr Branched: 6 brks: C
168 -	ESCALGB	Escallonia laevis 'Gold Brian'	40-60cm	10L 0.7Ctr Bushy: 6 brks: C
185 -	ELIOFENG	Eunonymus fortunei 'Emerald n' Gold	25-30cm	5-7.5L 0.5Ctr Bushy: 9 brks: C
67 -	HEBGO	Hebe 'Great Orme'	40-60cm	10L 0.7Ctr Bushy: 7 brks: C
235 -	HEBALRE	Hebe 'Red Edge'	40-60cm	5-7.5L 0.5Ctr Bushy: 7 brks: C
147 -	LIGOVAU	Ligustrum ovalifolium 'Aureum'	60-80cm	5-7.5L 0.7Ctr Branched: 7 brks: C
34 -	MAHMEWIS	Mahonia x media 'Winter Sun'	60-80cm	10L 0.7Ctr Bushy: 3 brks: C
247 -	PRULLAOL	Prunus laurocerasus 'Otto Luyken'	40-60cm	10L 0.7Ctr Bushy: 6 brks: C
165 -	ROSOF	Rosmarinus officinalis	40-60cm	5L 0.6Ctr Bushy: 5 brks: C
Total :1349 -				

GROUND COVER SHRUBS AND PERENNIAL PLANTS - Herbaceous				
Number	Abbreviation	Species	Pot Size	Density Specification
183 -	BERCOP	Bergenia cordifolia 'Purpurea'	2L	0.45Ctr Full Pot: C
Total :183 -				

GROUND COVER SHRUBS AND PERENNIAL PLANTS - Grasses					
Number	Abbreviation	Species	Pot Size	Density	Specification
40 -	STIAR	Stipa arundinacea	3L	0.7Ctr	Full Pot: C
Total :40 -					


NATIVE HEDGE MIX - Individual species to be planted together in groups of 3-7				
Number	Abbreviation Species	Height	Pot Size	Density Specification
247 -	ACECAM	Acer campestre	60-80cm	0.3Ctr Double Staggered at 0.3m offset 1+1: Transplant - seed raised: B
187 -	CORAV	Corylus avellana	60-80cm	0.3Ctr Double Staggered at 0.3m offset 1+2: Transplant - seed raised: Branched: 3 brks: B
247 -	CRAMON	Crataegus monogyna	60-80cm	0.3Ctr Double Staggered at 0.3m offset 1+1: Transplant - seed raised: B
64 -	ILEAQ	Ilex aquifolium	60-80cm	3L 0.3Ctr Double Staggered at 0.3m offset Leader with Laterals: C
247 -	PRUSP	Prunus spinosa	60-80cm	0.3Ctr Double Staggered at 0.3m offset 1+1: Transplant - seed raised: Branched: 2 brks: B
247 -	ROSACA	Rosa canina	60-80cm	0.3Ctr Double Staggered at 0.3m offset 1+1: Transplant - seed raised: Branched: 3 brks: B
Total :1239 -				

NATIVE BUFFER MIX - Individual species to be planted together in groups of 3-7				
Number	Abbreviation/Species	Height	Pot Size	Density Specification
65	CORAV	Corylus avellana	60-80cm	1+2: Transplant - seed raised; Branched: 3 brks: B
22	CRAMON	Crataegus monogyna	60-80cm	1+1: Transplant - seed raised; B
22	CYTSC	Cytisus scoparius	40-60cm	2L Bushy: 5 brks: C
33	PRUSP	Prunus spinosa	60-80cm	1+1: Transplant - seed raised; Branched: 2 brks: B
22	SAMNI	Sambucus nigra	60-80cm	1+1: Transplant - seed raised; Branched: 3 brks: B
Total :164 -				

SENSORY MIX - Individual species to be planted together in groups of 3-7				
Number	Abbreviation Species	Height	Pot Size Mix	Species Density Specification
8 -	BERCO	Bergenia cordifolia	5L 0.58Ctr	Full Pot: C
10 -	BUDDA	Buddleia davidii	60-80cm 5L 0.7Ctr	Branched: 5 brks: C
15 -	HEMBB	Hebe 'Midsummer Beauty'	40-60cm 10L 0.7Ctr	Bushy: 9 brks: C
10 -	LAVAN	Lavandula angustifolia	30-40cm 10L 0.7Ctr	Bushy: 9 brks: C
15 -	PHYLFL	Phyllostachys flexuosa	100-150cm 10-15L 0.7Ctr	Several Shoots: 10 brks: C
15 -	PRULAE	Prunus laurocerasus Etna	60-80cm 10L 0.7Ctr	Bushy: 6 brks: C
15 -	ROSOFMIJU	Rosmarinus officinalis 'Miss Jessopp's Upright'	40-60cm 10L 0.7Ctr	Bushy: 7 brks: C
8 -	STABY	Stachys byzantina	5-7.5L 0.58Ctr	Full Pot: C
10 -	STIGI	Stipa gigantea	5-7.5L 0.7Ctr	Full Pot: C
Total :106 -				

SHRUB MIX				
Number	Abbreviation	Species	Height	Pot Size Density Specification
40 -	AUCJAV	Aucuba japonica 'Variegata'	30-40cm	3L 0.7Ctr Bushy: 3 brks: C
40 -	CEATHR	Ceanothus thyrsiflorus repens	3L 0.7Ctr	Bushy: 5 brks: C
40 -	CISPRU	Cistus x purpureus	30-40cm	3L 0.7Ctr Bushy: 4 brks: C
40 -	HYPH	Hypericum 'Hidcote'	30-40cm	3L 0.7Ctr Bushy: 5 brks: C
40 -	RIBSAKE	Ribes sanguineum 'King Edward VII'	60-80cm	3L 0.7Ctr Branched: 3 brks: C
40 -	STABYSIC	Stachys byzantina 'Silver Carpet'	3L 0.7Ctr	Full Pot: C
40 -	STIAR	Stipa arundinacea	3L 0.7Ctr	Full Pot: C
40 -	VIBDA	Viburnum davidii	20-30cm	3L 0.7Ctr Bushy: 3 brks: C
Total :320 -				


PROPOSED TREE PLANTING DETAIL

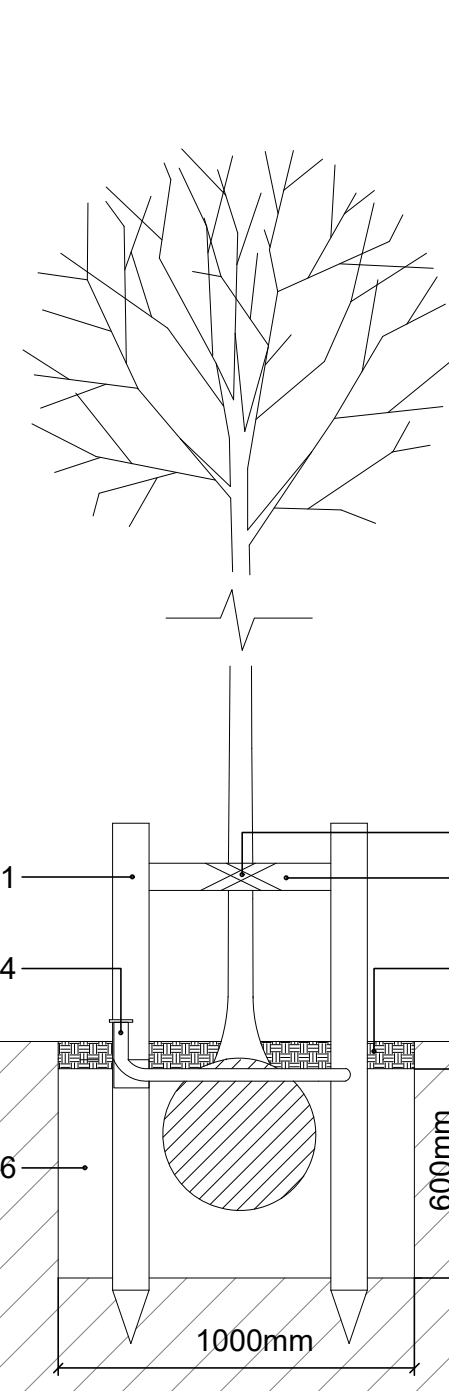

- 2x Timber tree stake - 100mm Ø 500mm apart (galvanised)
- Adjustable plastic / rubber tie with spacer and buckle (buckle end to be nailed to brace)
- FSC Timber cross brace *
- Irrigation System - nail to stake with 50mm galvanised nails. Ensure filler cap finishes slightly above mulch level
- Mulch layer - 75mm Ornamental Bark Nuggets 8-35mm
- Topsoil, compost and fertiliser. Base of tree pit to remain undisturbed, sides scarified


* NOTE: Secure at a height no more than 1/3 of the total height of the tree above ground when planted

PROPOSED NATIVE HEDGE DETAIL - Planted Double-staggered at 0.3m centres (Specified in schedule)

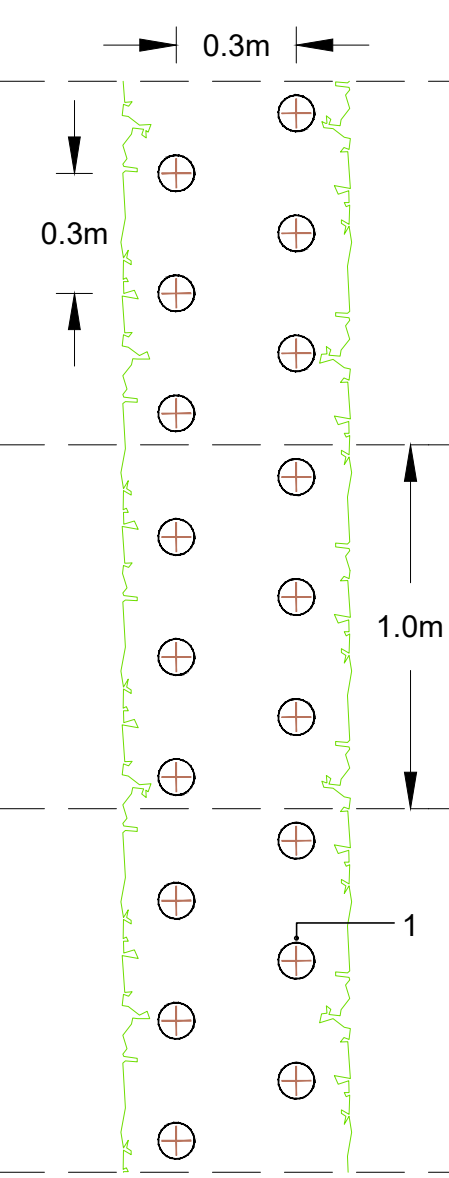

- Plants - Double-staggered at 0.3m centres. Bareroot plants to be secured with a spiral rabbit guard and bamboo support. Container grown plants to be fitted with a tree shelter secured to a stake


PROPOSED PLOT PLANTING DETAIL - Shrubs, Herbaceous, Grasses

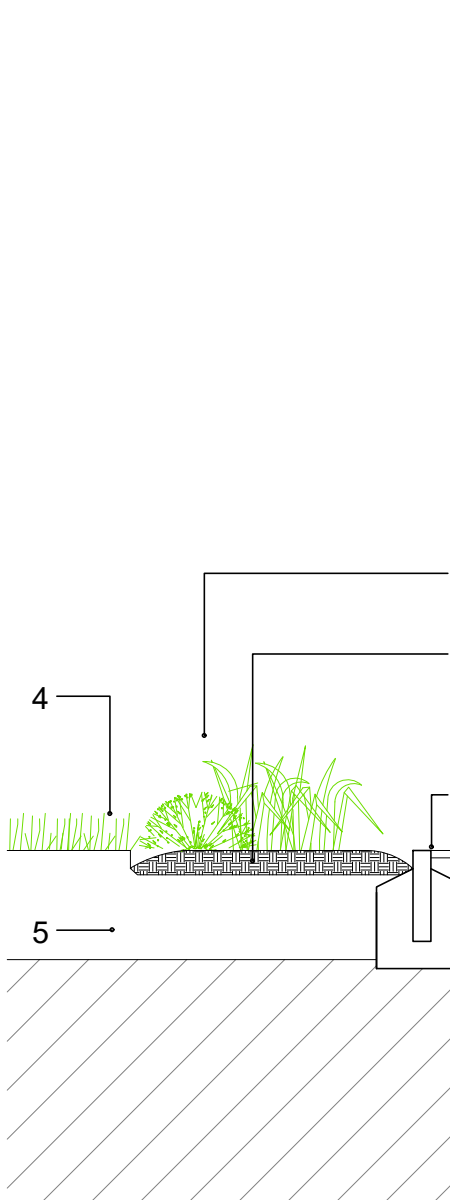

- Planting
- Mulch layer - 75mm Ornamental Bark Nuggets 8-35mm. Finished levels 15mm below adjacent surfaces
- Adjacent Hard Surfaces
- Turf
- 300mm of Topsoil, compost and fertiliser, graded to below 65mm below the paving or turf

* NOTE: Where trees are within 5m of roads and services and within 3m of footpaths a linear root barrier with root deflecting ribs, is to be installed in accordance with manufacturers instructions. Barrier is to be adjacent to the surface or service route to provide maximum rooting area.


PROPOSED STAGGERED-ROW HEDGE DETAIL - Planted at 0.3m centres (Specified in schedule)

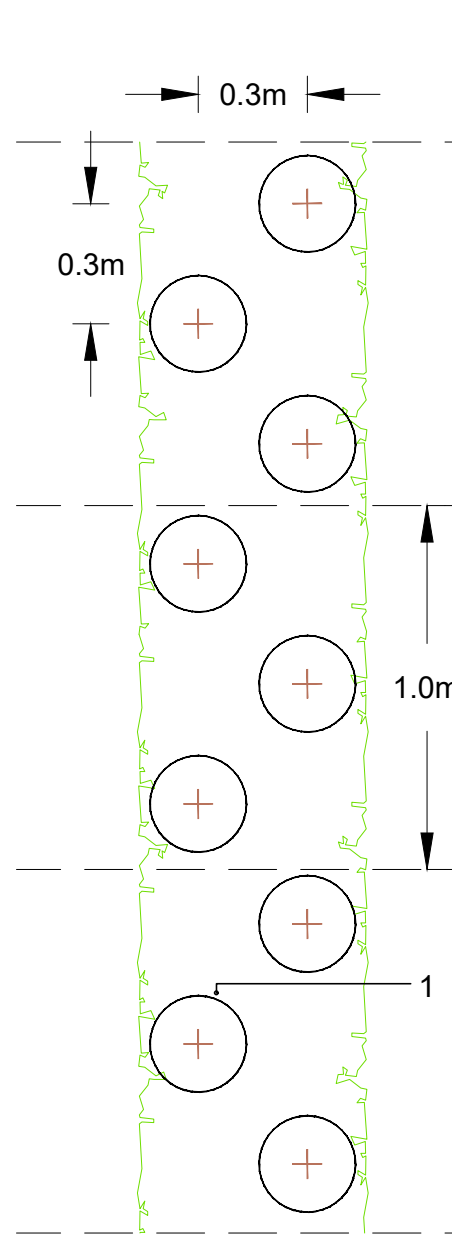

- Plants - Planted in a staggered row at 0.3m centres. Plants are to be 'topped' cut to form a level hedge across each section of new hedging

PROPOSED PLOT SHRUB PLANTING DETAIL

- Planted at 0.5/0.6/0.7m centres in a crows-foot pattern (Specified in schedule)

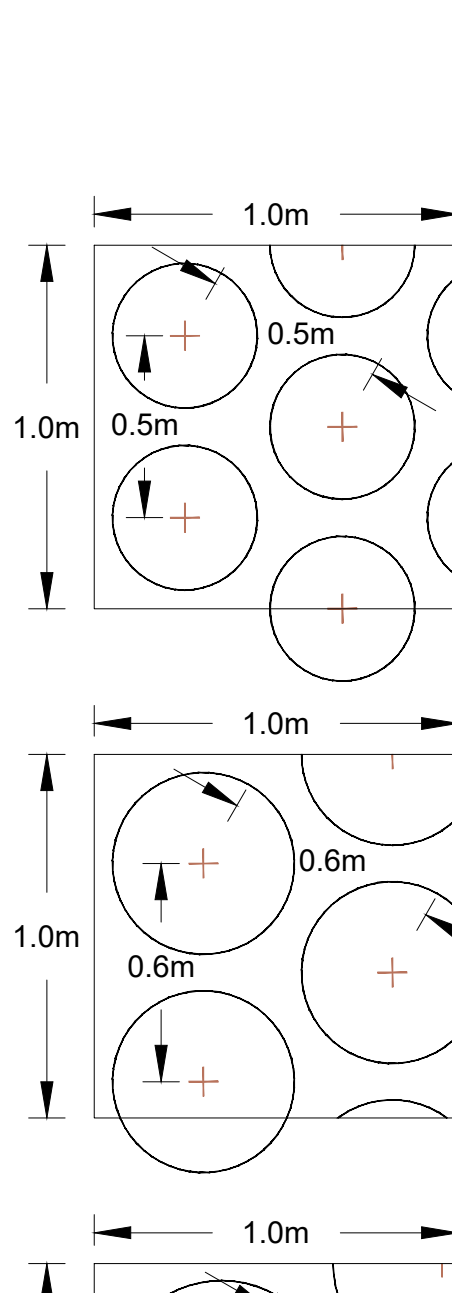

- Plants - at 1m centres. Bareroot plants to be secured with a spiral rabbit guard and bamboo support. Container grown plants to be fitted with a tree shelter secured to a stake

* Appropriate adaptations to be made around inspection chamber covers retaining same number of specified plants

THIS DRAWING IS TO BE READ IN CONJUNCTION WITH SEPARATE GROUP 1 SITE SPECIFIC CONSTRUCTION NOTES AND MATERIALS SPECIFICATION.

THIS SCHEDULE & THESE SPECIFICATIONS APPLY TO LANDSCAPING SHOWN ON DRAWINGS EM000-LS-001 TO 003

Revision		Date
a	Landscaping updated to latest layout	13.08.26
Job: Aston Flamville Rd		
Title: Site Landscaping Specification & Schedule		
Scale: NOT TO SCALE, PRINT @A0	Drawn: RB	
Date: Aug 2026	Checked: PmJ	

THIS DRAWING AND THE BUILDING WORKS DEPICTED ARE THE COPYRIGHT OF J S BLOOR (SERVICES) LIMITED AND MAY NOT BE REPRODUCED OR AMENDED EXCEPT BY WRITTEN PERMISSION. NO LIABILITY WILL BE ACCEPTED FOR AMENDMENTS MADE BY OTHER PERSONS