
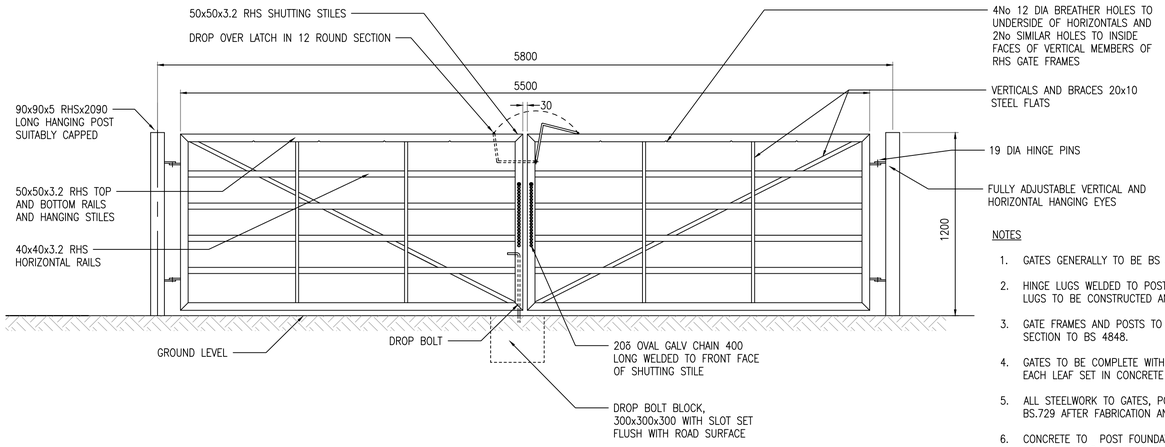


FARM GATE DETAIL
SCALE 1:20

NOTES

1. GATES GENERALLY TO BE BS 3470 CATTLE YARD TYPE.
2. HINGE LUGS WELDED TO POSTS AND DRILLED TO ACCOMMODATE SPLIT PINS, LUGS TO BE CONSTRUCTED AND POSITIONED TO ALLOW GATES TO OPEN 110°
3. GATE FRAMES AND POSTS TO BE CONSTRUCTED FROM SQUARE AND HOLLOW SECTION TO BS 4848.
4. GATES TO BE COMPLETE WITH COUNTERBALANCED HOLDING BACK CATCHES TO EACH LEAF SET IN CONCRETE BLOCK 300x300x300.
5. ALL STEELWORK TO GATES, POSTS ETC. TO BE HOT DIPPED GALVANISED TO BS.729 AFTER FABRICATION AND DRILLING.
6. CONCRETE TO POST FOUNDATIONS TO BE C30P IN ACCORDANCE WITH BS.5328:1981,S.R.CEMENT TO BS.4027, NOMINAL MAXIMUM AGGREGATE SIZE 20mm. WORKABILITY TO BE MEDIUM.
7. EXPOSED UPPER SURFACES OF CONCRETE TO RECEIVE HARD TROWELLED FINISH FALLING AWAY FROM POSTS AND WITH BULLNOSE TO TOP EDGES.
8. ALL CORNERS TO HAVE MITRED JOINTS.

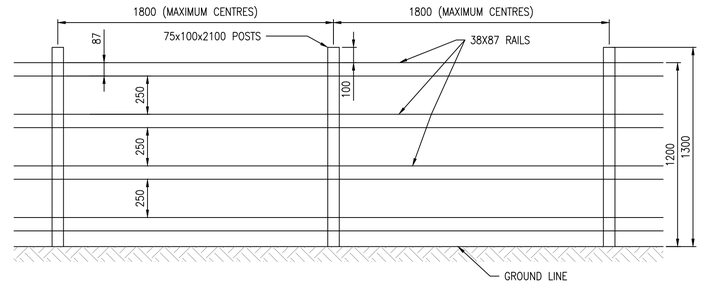

POST AND RAIL FENCE DETAIL
SCALE 1:20

Rev	Drawn	Chk'd	App'd	Date	Revision Note
A	JS	BC	KS	07.08.26	FOR INFORMATION

nationalgrid Electricity Distribution

Engineering Design Department (East Midlands)
Pegasus Business Park, Castle Donington, DE74 2TU.

Title: NAILSTONE SUBSTATION
PLANNING
PROPOSED BOUNDARY FENCING DETAILS

Scale: 1:50@A1

Drg. No. LE42_12_0006

Rev No. A

ALL RIGHTS ARE RESERVED TO NGED (East Midlands) plc. NO PART OF THIS DRAWING MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, INCLUDING PHOTOCOPYING AND RECORDING, OR STORED IN A RETRIEVAL SYSTEM OF ANY NATURE, WITHOUT PERMISSION. A1